

**Subject: 2026 PWS Monitoring Schedules Now Available**

Dear Public Water System (PWS) Owner:

**The 2026 Contaminant Monitoring Schedules have been created and are now available online at:** <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

**IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING**

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

**When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.**

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

**The distribution requirements only need to be met by your overall system**, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
  - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
  - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
  - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

**Subscribe to Updates:** Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

**For Transient Non-Community (TNC) PWSs Only**

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Northwest District Office at: 419-352-8461  
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)



**OH0200012 BEAVERDAM VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252629</b>	Facility Name: <b>BEAVERDAM VILLAGE</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>GROSS ALPHA - 4002 RADIUM-228 - 4030</b>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026



**OH0200012 BEAVERDAM VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: BEAVERDAM VILLAGE DISTRIBUTION</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: BEAVERDAM VILLAGE DISTRIBUTION</b>	<b>Monitoring Requirements</b>
	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	
Chemicals		
LEAD - 1030 AND COPPER - 1022		5 Sample(s) Required between 6/1/2026 and 9/30/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*



**OH0200012 BEAVERDAM VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BEAVERDAM VILLAGE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>312 W MAIN ST</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS		Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
		Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
		Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
		Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0200112 BLUFFTON VILLAGE**

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: BLUFFTON VILLAGE DISTRIBUTION</b> <b>SMP ID: DS000</b>	
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100		5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: BLUFFTON VILLAGE DISTRIBUTION</b> <b>SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs</b>	
<b>Chemicals</b>		<b>Monitoring Requirements</b>
LEAD - 1030 AND COPPER - 1022		20 Sample(s) Required between 6/1/2026 and 9/30/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*



**OH0200112 BLUFFTON VILLAGE**

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BLUFFTON VILLAGE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>700 MAPLE CREST COURT</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS201
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS201
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS201
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS201

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BLUFFTON VILLAGE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS202</b>	<b>405 ETHAN CIRCLE</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS202
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS202
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS202
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS202

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262193</b>	Facility Name: <b>DELPHOS CITY</b>
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>	
<b>BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2026 and 1/31/2026 1 Paired Sample Set Required between 2/1/2026 and 2/28/2026 1 Paired Sample Set Required between 3/1/2026 and 3/31/2026 1 Paired Sample Set Required between 4/1/2026 and 4/30/2026



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262193</b>	Facility Name: <b>DELPHOS CITY</b>
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 5/1/2026 and 5/31/2026
	1 Paired Sample Set Required between 6/1/2026 and 6/30/2026
	1 Paired Sample Set Required between 7/1/2026 and 7/31/2026
	1 Paired Sample Set Required between 8/1/2026 and 8/31/2026
	1 Paired Sample Set Required between 9/1/2026 and 9/30/2026
	1 Paired Sample Set Required between 10/1/2026 and 10/31/2026
	1 Paired Sample Set Required between 11/1/2026 and 11/30/2026
	1 Paired Sample Set Required between 12/1/2026 and 12/31/2026

***A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.***



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262193</b>	Facility Name: <b>DELPHOS CITY</b>
<b>Location</b>	SMP ID: <b>EP002/LT200</b> Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL MICROCYSTINS	See Instructions Below
--------------------	------------------------

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

**Current monitoring schedules can be found at:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262193</b>	Facility Name: <b>DELPHOS CITY</b>
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**Chemicals** **Monitoring Requirements**

CYANOBACTERIA SCREENING	See Instructions Below
-------------------------	------------------------

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

**Current monitoring schedules can be found at:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: DELPHOS CITY DISTRIBUTION SYSTEM</b>	<b>SMP ID: DS000</b>
<b>Chemicals</b>	<b>Monitoring Requirements</b>	
ASBESTOS - 1094	Not Required	
TOTAL COLIFORM (TCR) - 3100	8 Sample(s) Required between 8 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	8 Sample(s) Required between 8 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*



**OH0200412 DELPHOS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DELPHOS CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DELPHOS CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>901 WILDCAT LANE</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>DELPHOS CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS202</b>	<b>1090 SOUTHRIDGE DRIVE</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS202
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS202
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS202
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS202

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0200503 ELIDA VILLAGE**

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>LC###</b> Refer to your Lead and Copper plan for SMP IDs	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 1/1/2026 and 6/30/2026
-------------------------------	---



**OH0200503 ELIDA VILLAGE**

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER:** \*\* Consumer Confidence Report (CCR) is due July 1, 2026

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 7/1/2026 and 12/31/2026
-------------------------------	---

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>4180 NORTH DUTCH HOLLOW</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS201
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS201
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS201
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS201

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS202</b>	<b>2390 BATY ROAD</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS202
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS202
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS202
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS202

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0200712 INDIAN VILLAGE MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252633</b>	Facility Name: <b>INDIAN VILLAGE MHP</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074	BARIUM - 1010	
BERYLLIUM, TOTAL - 1075	CADMIUM - 1015	
CHROMIUM - 1020	CYANIDE - 1024	
FLUORIDE - 1025	MERCURY - 1035	
NICKEL - 1036	SELENIUM - 1045	
THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002	RADON - 222 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051	ATRAZINE - 2050	
SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and 5/31/2026



**OH0200712 INDIAN VILLAGE MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: INDIAN VILLAGE MHP DISTRIBUTION</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: INDIAN VILLAGE MHP DISTRIBUTION</b>	<b>Monitoring Requirements</b>
	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	
Chemicals		Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2026 and 9/30/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*



**OH0200712 INDIAN VILLAGE MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: INDIAN VILLAGE MHP DISTRIBUTION**

**Location SMP ID: DS201 504 CATAWBA**

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

**Sampling Facility ID: DS1 Facility Name: INDIAN VILLAGE MHP DISTRIBUTION**

**Location SMP ID: DS202 228 MAHONING**

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252634</b>	Facility Name: <b>LIMA CITY</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
<i>Sample for all the analytes listed below:</i>			
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>			
NITRITE - 1041	Not Required		
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	1/31/2026
	1 Sample(s) Required between	2/1/2026 and	2/28/2026
	1 Sample(s) Required between	3/1/2026 and	3/31/2026
	1 Sample(s) Required between	4/1/2026 and	4/30/2026
	1 Sample(s) Required between	5/1/2026 and	5/31/2026
	1 Sample(s) Required between	6/1/2026 and	6/30/2026
	1 Sample(s) Required between	7/1/2026 and	7/31/2026
	1 Sample(s) Required between	8/1/2026 and	8/31/2026
	1 Sample(s) Required between	9/1/2026 and	9/30/2026
	1 Sample(s) Required between	10/1/2026 and	10/31/2026
	1 Sample(s) Required between	11/1/2026 and	11/30/2026
	1 Sample(s) Required between	12/1/2026 and	12/31/2026
RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
<i>Sample for all the analytes listed below:</i>			
<b>GROSS ALPHA - 4002 RADIUM-228 - 4030</b>			
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2026 and	6/30/2026
<i>Sample for all the analytes listed below:</i>			
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>			
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2026 and	1/31/2026
	1 Paired Sample Set Required between	2/1/2026 and	2/28/2026
	1 Paired Sample Set Required between	3/1/2026 and	3/31/2026
	1 Paired Sample Set Required between	4/1/2026 and	4/30/2026
	1 Paired Sample Set Required between	5/1/2026 and	5/31/2026
	1 Paired Sample Set Required between	6/1/2026 and	6/30/2026
	1 Paired Sample Set Required between	7/1/2026 and	7/31/2026
	1 Paired Sample Set Required between	8/1/2026 and	8/31/2026
	1 Paired Sample Set Required between	9/1/2026 and	9/30/2026
	1 Paired Sample Set Required between	10/1/2026 and	10/31/2026
	1 Paired Sample Set Required between	11/1/2026 and	11/30/2026



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252634</b>	Facility Name: <b>LIMA CITY</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 12/1/2026 and 12/31/2026

***A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.***



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252634</b>	Facility Name: <b>LIMA CITY</b>
<b>Location</b>	SMP ID: <b>EP001/LT200</b> Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

See Instructions Below

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

**Current monitoring schedules can be found at:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252634</b>	Facility Name: <b>LIMA CITY</b>
<b>Location</b>	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**Chemicals**

**Monitoring Requirements**

CYANOBACTERIA SCREENING

See Instructions Below

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

**Current monitoring schedules can be found at:**

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: LIMA CITY DISTRIBUTION SYSTEM</b>	<b>SMP ID: DS000</b>
<b>Chemicals</b>	<b>Monitoring Requirements</b>	
ASBESTOS - 1094	Not Required	
TOTAL COLIFORM (TCR) - 3100	70 Sample(s) Required between 70 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	70 Sample(s) Required between 70 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	<b>Facility ID: DS1 Facility Name: LIMA CITY DISTRIBUTION SYSTEM</b>	<b>SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs</b>
<b>Chemicals</b>	<b>Monitoring Requirements</b>	
LEAD - 1030 AND COPPER - 1022	60 Sample(s) Required between	1/1/2026 and 6/30/2026



**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	60 Sample(s) Required between 7/1/2026 and 12/31/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>4675 ALLENTOWN ROAD</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS201
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS201
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS201
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS201

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS202</b>	<b>2850 W. ELM ST.</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS202
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS202
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS202
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS202

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS203</b>	<b>2110 EDGEWOOD DR</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS203
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS203
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS203





**OH0200811 LIMA CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS207</b>	<b>2101 CENTRAL POINT PARKWAY</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS		Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS207
		Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS207
		Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS207
		Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS207

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LIMA CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS208</b>	<b>2530 FT. AMANDA RD.</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS		Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS208
		Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS208
		Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS208
		Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS208

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



**OH020112 FULL CIRCLE RECOVERY REHAB PWS**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>FULL CIRCLE RECOVERY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

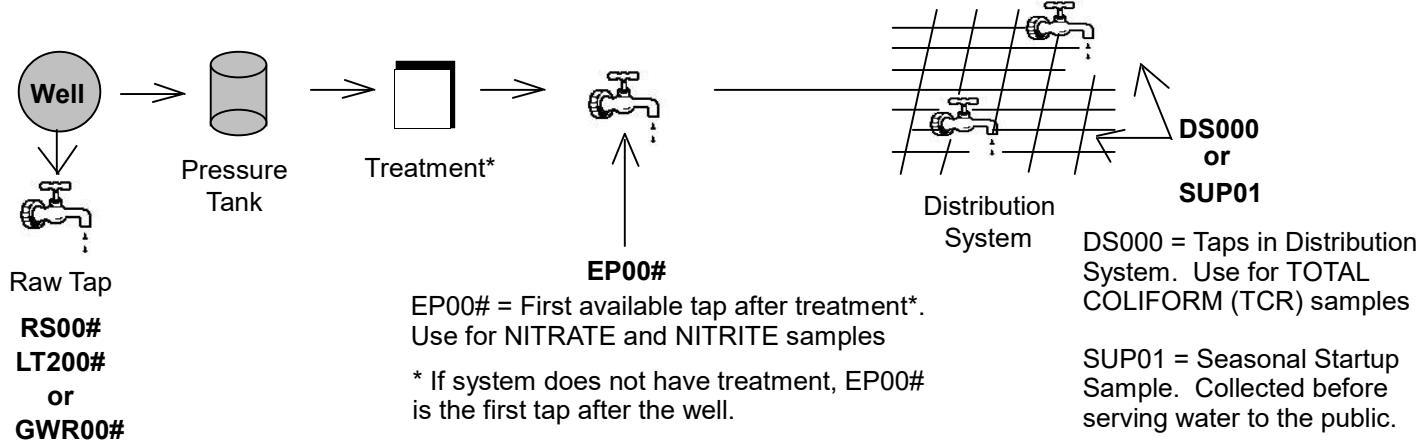

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH020112 FULL CIRCLE RECOVERY REHAB PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


**Sampling Facility ID: 252635      Facility Name: FULL CIRCLE RECOVERY REHAB**

**Location SMP ID: EP001      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

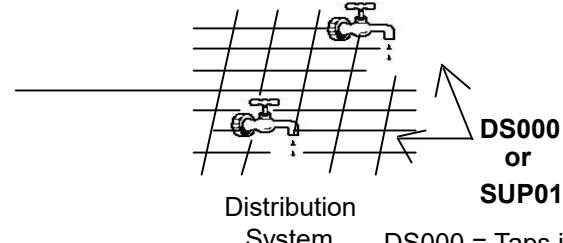

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0201312 SPENCERVILLE VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262320</b>	Facility Name: <b>SPENCERVILLE VILLAGE</b>
<b>Location</b>	SMP ID: <b>EP002</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>GROSS ALPHA - 4002 RADIUM-228 - 4030</b>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH0201312 SPENCERVILLE VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> Facility Name: <b>SPENCERVILLE VILLAGE DISTRIBUTION SYSTEM</b>
<b>Chemicals</b>	<b>Monitoring Requirements</b>
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*



**OH0201312 SPENCERVILLE VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER:** \*\* Consumer Confidence Report (CCR) is due July 1, 2026

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SPENCERVILLE VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

**Chemicals**

**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SPENCERVILLE VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>SPENCERVILLE SCHOOL - 2500 WISHER DRIVE</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SPENCERVILLE VILLAGE DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS202</b>	<b>1225 S ST. MARY'S ROAD - WWTP</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0231512 BLUFFTON GOLF CLUB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BLUFFTON GOLF CLUB DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	Facility Source: <b>Ground Water</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026	1/1/2026 and 3/31/2026

**Where to Collect Samples For a Small Public Water System**

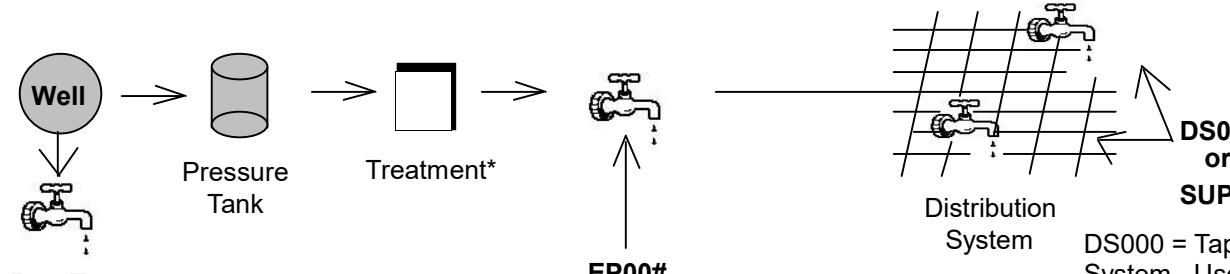

Raw Tap

**RS00#**

**LT200#**

or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0231512 BLUFFTON GOLF CLUB

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


### ENTRY POINT MONITORING SCHEDULE

**Sampling** Facility ID: 252641    Facility Name: **BLUFFTON GOLF CLUB**

**Location** SMP ID: EP001    Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

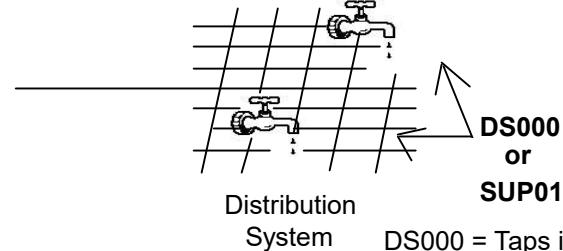

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0232312 LIMA RESCUE MISSION/CAMP ROBERTS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


**Sampling** Facility ID: DS1      Facility Name: **CAMP ROBERTS DISTRIBUTION**  
**Location**      SMP ID: SUP01      Facility Source: **Ground Water**

**Chemicals**      **Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP      At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

*\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\**

**Where to Collect Samples For a Small Public Water System**

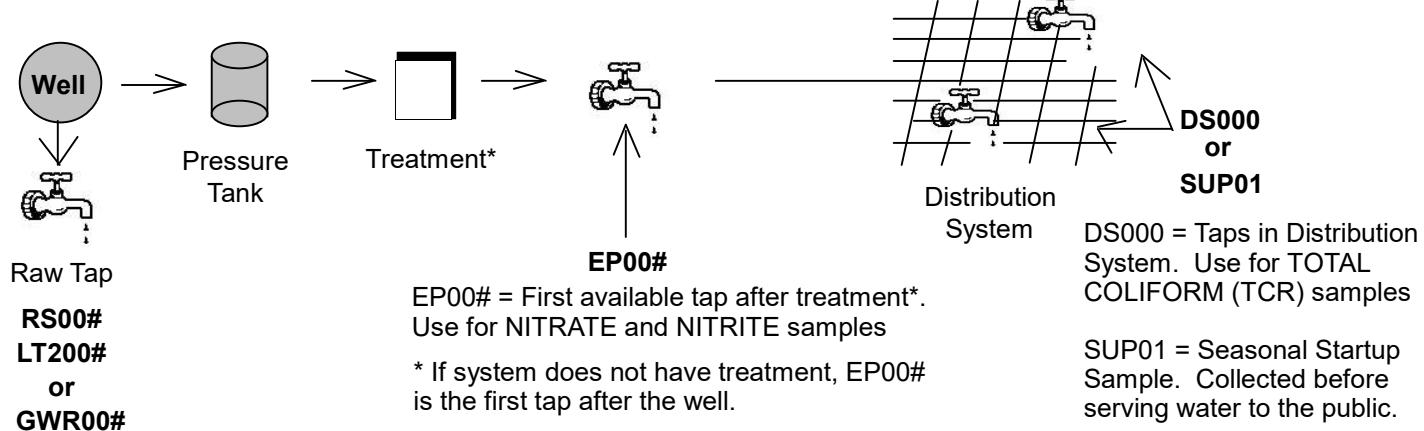

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0232312 LIMA RESCUE MISSION/CAMP ROBERTS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: CAMP ROBERTS DISTRIBUTION
<b>Location</b>	SMP ID: DS000	Facility Source: Ground Water
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 3/31/2026
		1 Sample(s) Required between 6/9/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 7/31/2026
		1 Sample(s) Required between 8/1/2026 and 8/31/2026
		1 Sample(s) Required between 9/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 10/31/2026
		1 Sample(s) Required between 11/1/2026 and 11/30/2026
		1 Sample(s) Required between 12/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

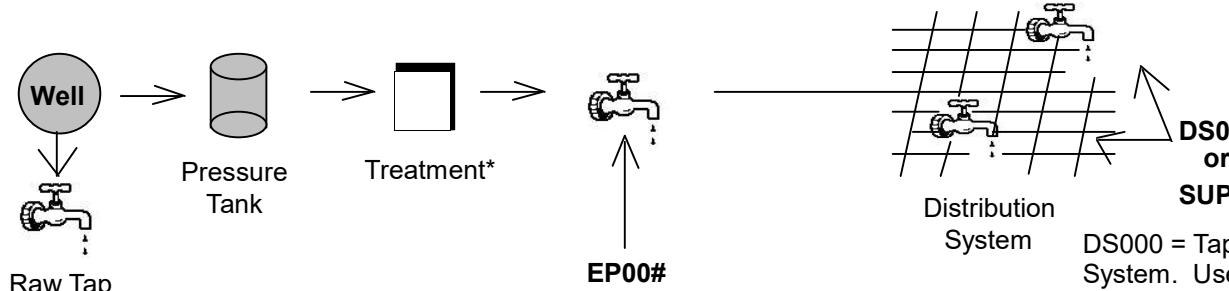

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0232312 LIMA RESCUE MISSION/CAMP ROBERTS**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252644	Facility Name: CAMP ROBERTS
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
----------------	--

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

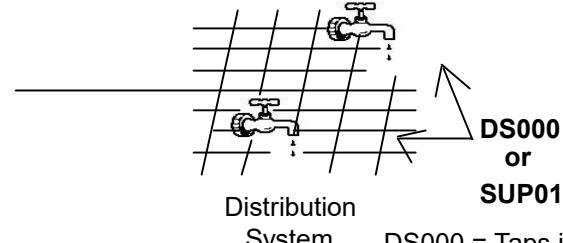

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0232812 CARTER LUMBER STORE 65-8**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>CARTER LUMBER STORE 65-8 DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

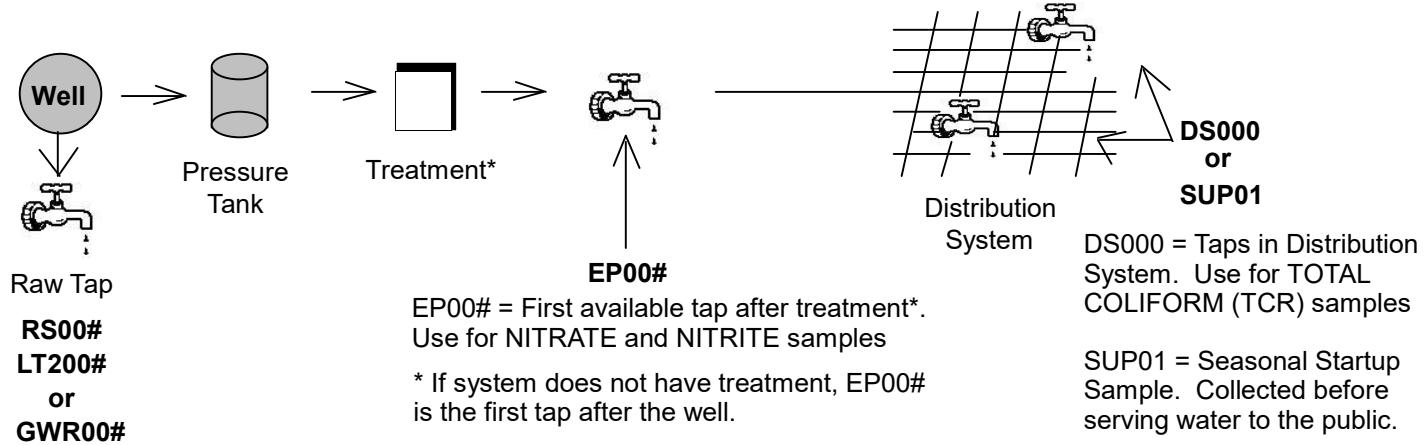

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0232812 CARTER LUMBER STORE 65-8

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

### ENTRY POINT MONITORING SCHEDULE

**Sampling** Facility ID: 252648      Facility Name: CARTER LUMBER  
**Location** SMP ID: EP001      Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure  
Tank

Treatment\*

EP00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

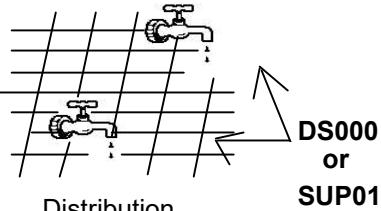

Distribution  
System

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0233112 COLONIAL GOLFERS CLUB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>COLONIAL GOLFERS CLUB DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

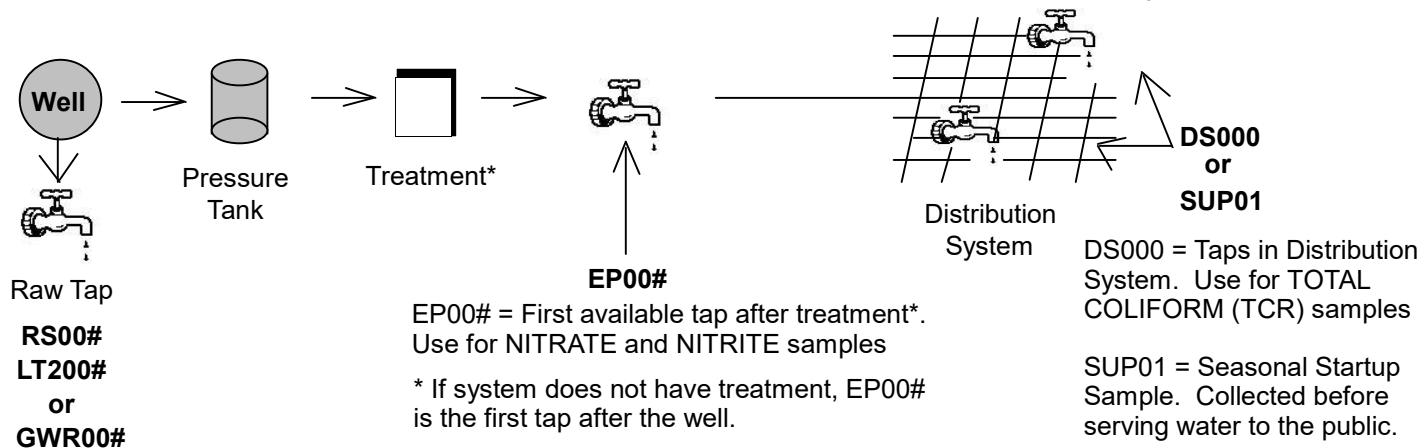

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0233112 COLONIAL GOLFERS CLUB

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

### ENTRY POINT MONITORING SCHEDULE


<b>Sampling</b>	Facility ID: 252649	Facility Name: <b>COLONIAL GOLFERS CLUB</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

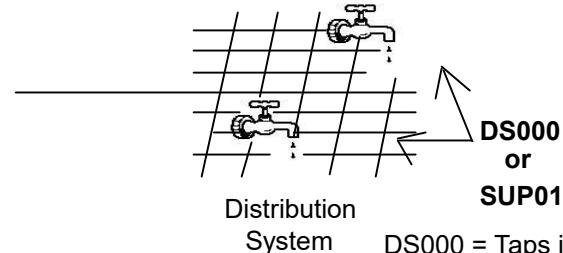

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0233612 DAIRY HAUS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 3/1 to 9/30

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: DAIRY HAUS DISTRIBUTION**


**Location SMP ID: DS000      Facility Source: Ground Water**

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 6/30/2026	3/24/2026 and 3/31/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026	

**Where to Collect Samples For a Small Public Water System**

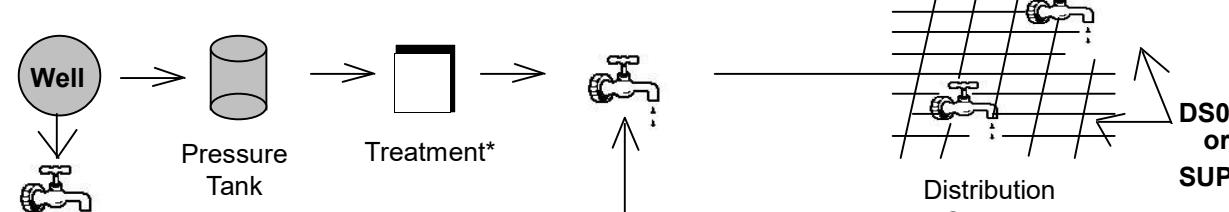

Raw Tap

**RS00#**

**LT200#**

or

**GWR00#**


Pressure  
Tank

Treatment\*

**EP00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

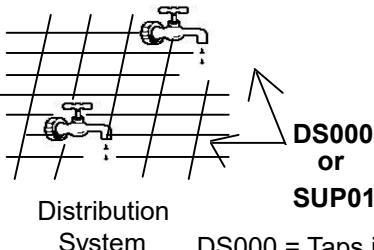

Distribution  
System

**DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples**

**SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.**

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

**<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>**

**Save a dime. Sample on time!**



## OH0233612 DAIRY HAUS

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 3/1 to 9/30

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


### ENTRY POINT MONITORING SCHEDULE

**Sampling** Facility ID: 252651      Facility Name: DAIRY HAUS

**Location** SMP ID: EP001      Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure  
Tank

Treatment\*

EP00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

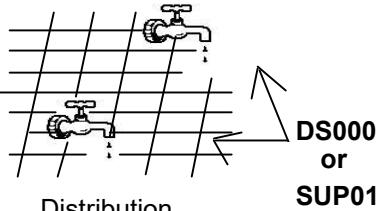

Distribution  
System

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0236412 ROBINS NEST CAMPGROUND**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 4/1 to 10/31

## Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

## DISTRIBUTION MONITORING SCHEDULE

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ROBINS NEST CAMPGROUND DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>SUP01</b>	Facility Source: <b>Ground Water</b>

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

## Where to Collect Samples For a Small Public Water System

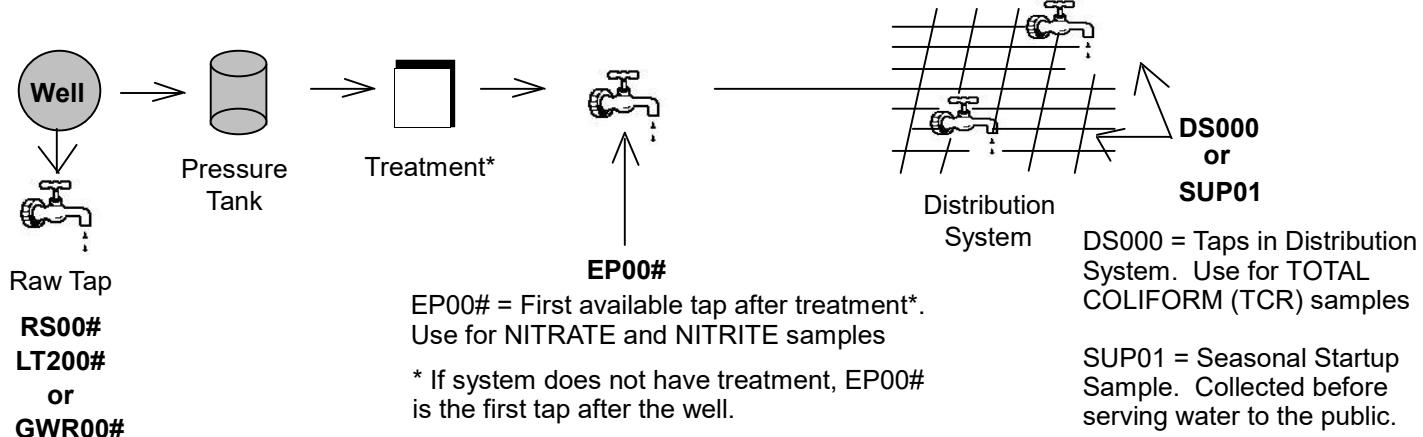

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0236412 ROBINS NEST CAMPGROUND

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 4/1 to 10/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

### DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Facility</b>	Facility ID: DS1	Facility Name: <b>ROBINS NEST CAMPGROUND DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/17/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

### Where to Collect Samples For a Small Public Water System

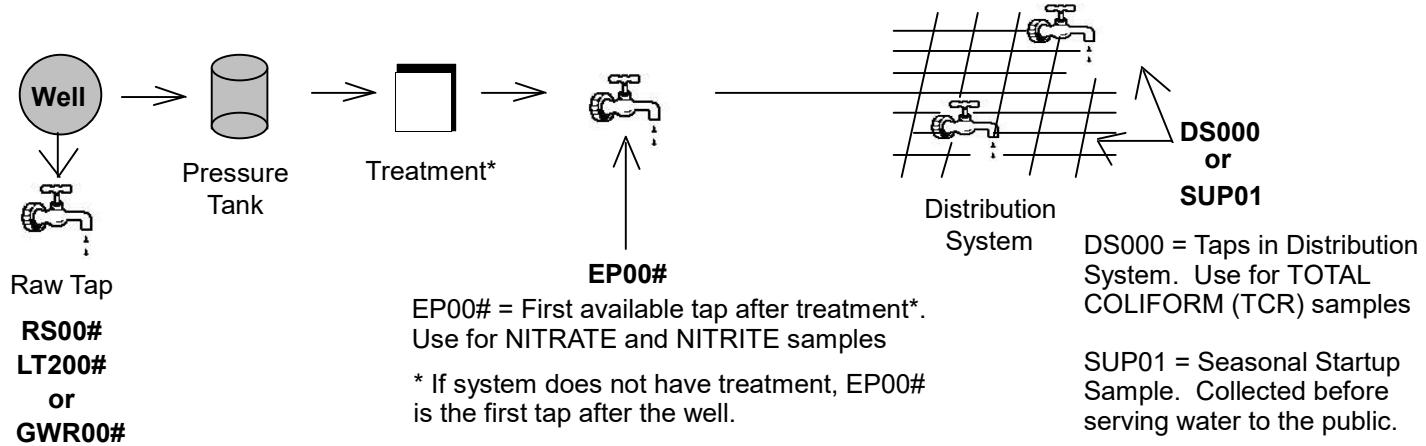

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0236412 ROBINS NEST CAMPGROUND

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 4/1 to 10/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

### ENTRY POINT MONITORING SCHEDULE


<b>Sampling</b>	Facility ID: 252662	Facility Name: <b>ROBINS NEST CAMPGROUND</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

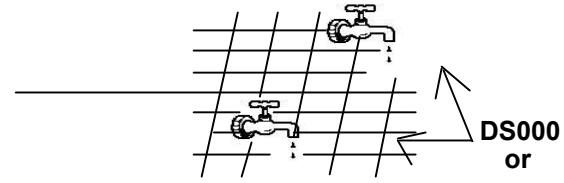

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0239312 SALEM MENNONITE CHURCH - ELIDA**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>SALEM MENNONITE CHURCH DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

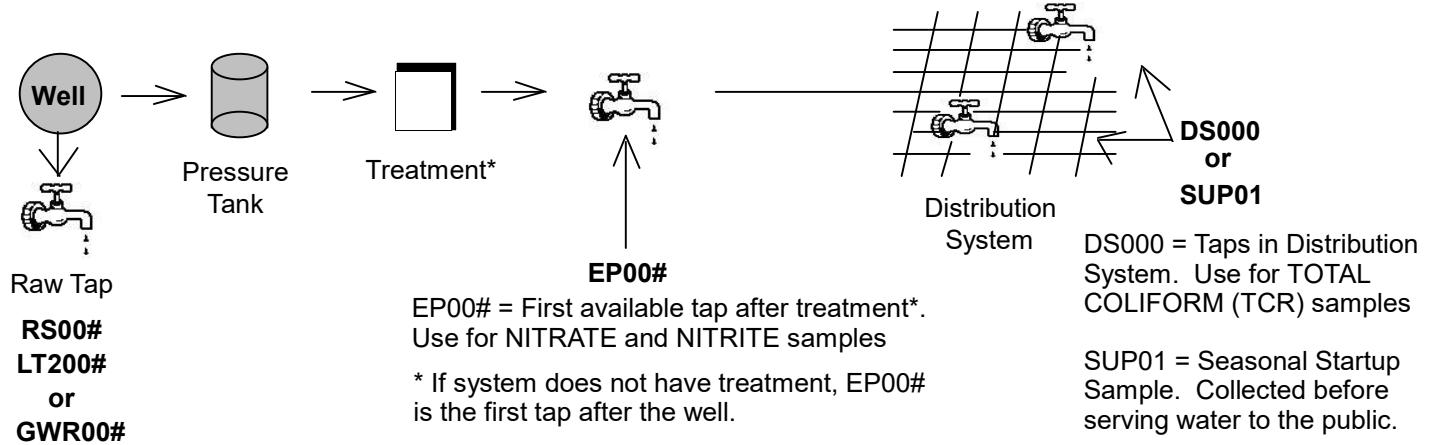

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0239312 SALEM MENNONITE CHURCH - ELIDA**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


**Sampling Facility ID: 252668      Facility Name: SALEM MENNONITE CHURCH**

**Location SMP ID: EP001      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**




Raw Tap

RS00#

LT200#


or

GWR00#



EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

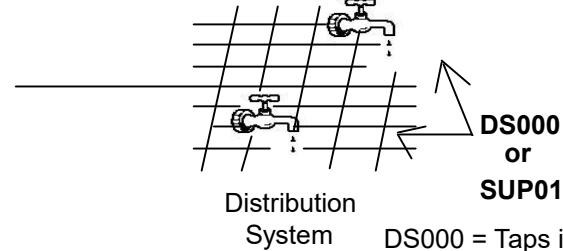

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0239412 SANDY POINT LAKE CAMPGROUND PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 5/1 to 9/30

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: SANDY POINT LAKE DISTRIBUTION**


**Location SMP ID: SUP01      Facility Source: Ground Water**

**Chemicals      Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP      At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

*\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\**

**Where to Collect Samples For a Small Public Water System**

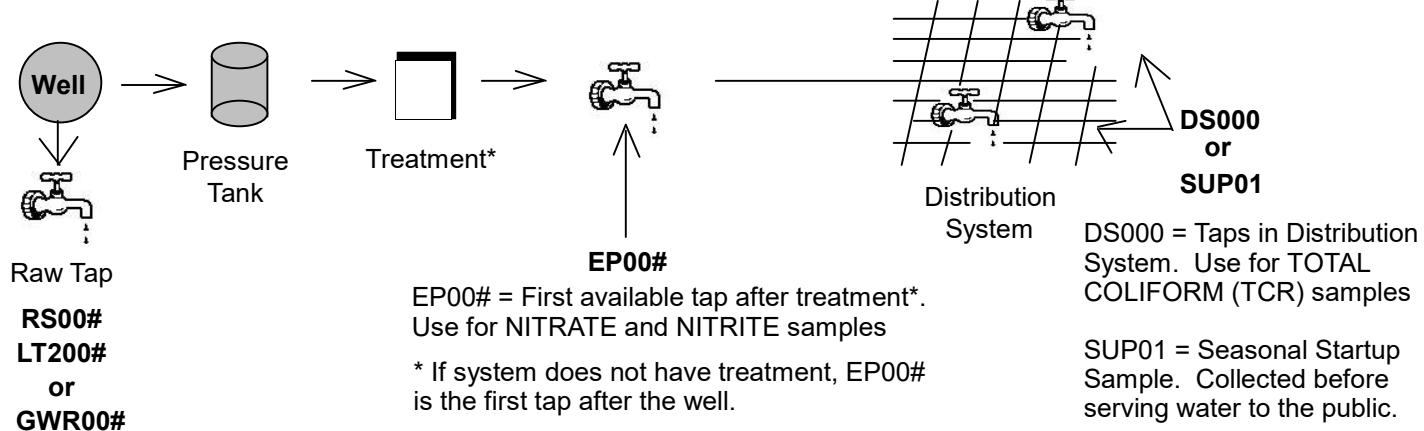

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0239412 SANDY POINT LAKE CAMPGROUND PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 5/1 to 9/30

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>SANDY POINT LAKE DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/10/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026

**Where to Collect Samples For a Small Public Water System**

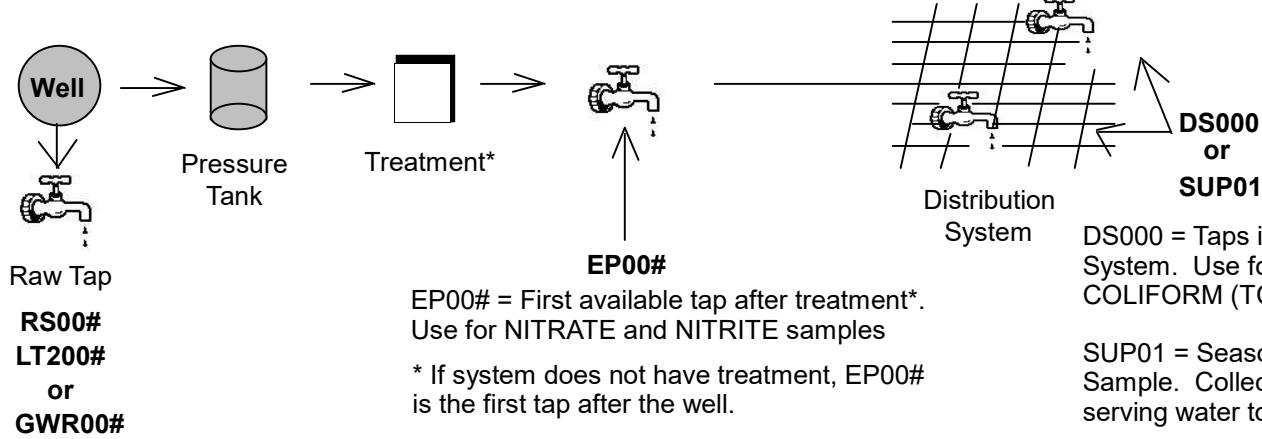

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0239412 SANDY POINT LAKE CAMPGROUND PWS**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 5/1 to 9/30

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252669	Facility Name: <b>SANDY POINT LAKE CAMPGROUND</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
----------------	--

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

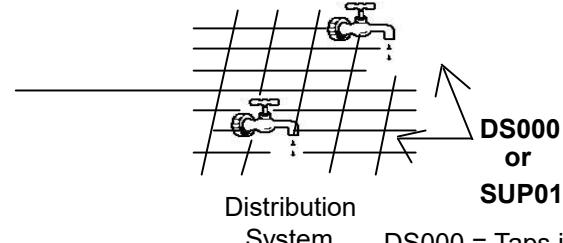

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0241812 LANDECK TAVERN PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>LANDECK TAVERN DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

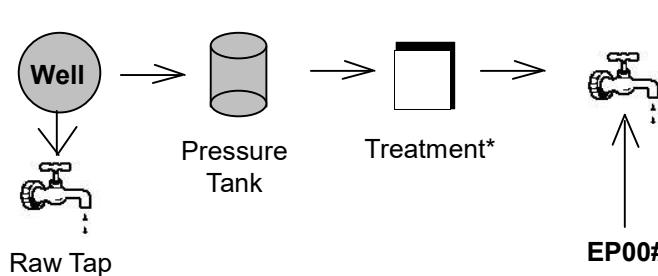

Raw Tap

**RS00#**

**LT200#**


or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

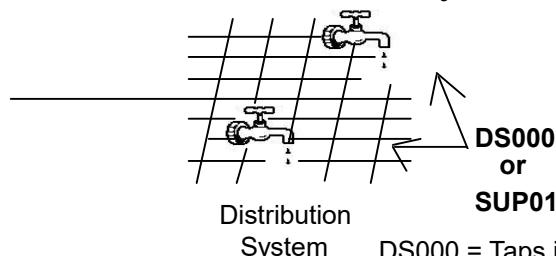

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0241812 LANDECK TAVERN PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252674	Facility Name: LANDECK TAVERN
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

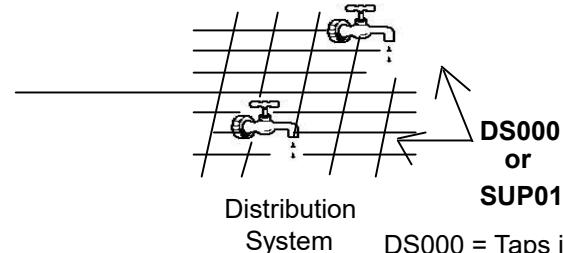

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0242012 UNION CHAPEL MISSIONARY CHURCH**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>UNION CHAPEL CHURCH DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

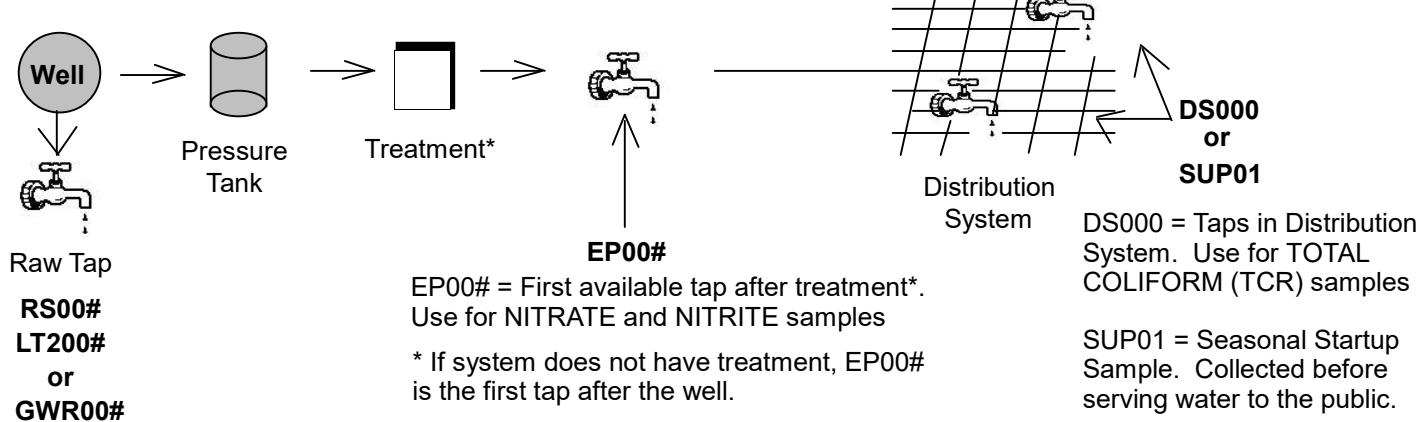

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0242012 UNION CHAPEL MISSIONARY CHURCH**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252675	Facility Name: UNION CHAPEL CHURCH
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

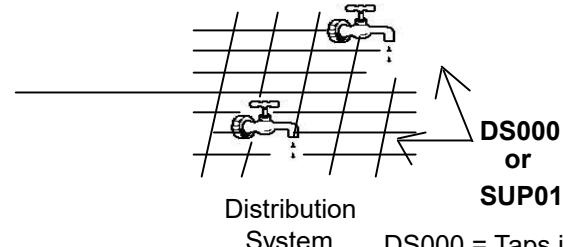

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0242712 THE OAKS GOLF CLUB**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: OAKS GOLF CLUB DISTRIBUTION SYSTEM**  
**Location SMP ID: DS000      Facility Source: Ground Water**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

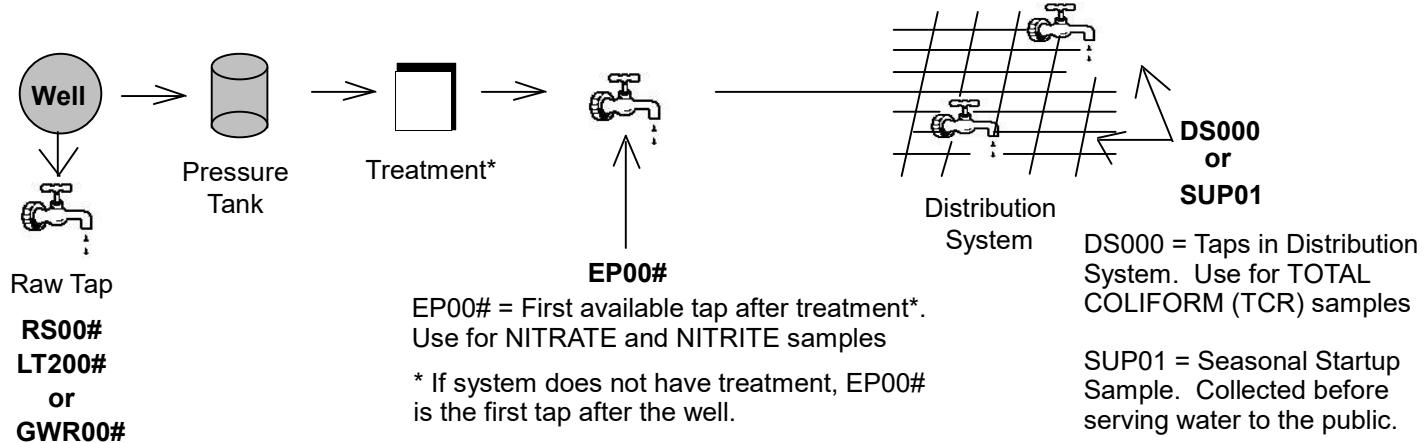

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0242712 THE OAKS GOLF CLUB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252676	Facility Name: <b>OAKS GOLF CLUB</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure  
Tank

Treatment\*

EP00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

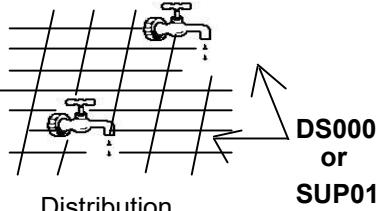

Distribution  
System

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0243012 WINONA LAKE SWIM N TENNIS CLUB**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**


**Sampling** Facility ID: DS1      Facility Name: **WINONA LAKE DISTRIBUTION**  
**Location**      SMP ID: SUP01      Facility Source: **Ground Water**

**Chemicals**      **Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP      At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

**Where to Collect Samples For a Small Public Water System**

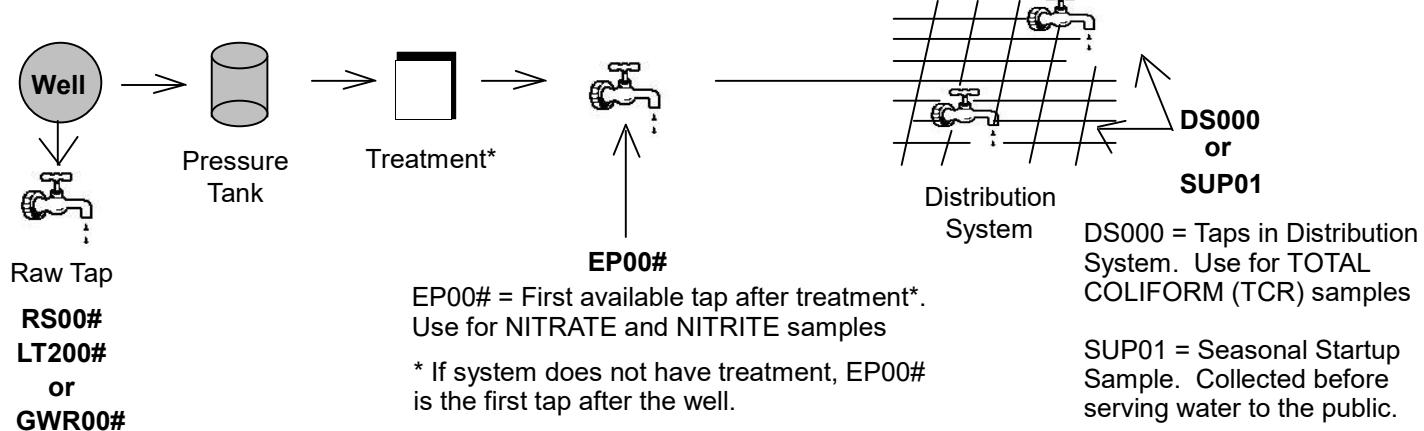

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0243012 WINONA LAKE SWIM N TENNIS CLUB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>WINONA LAKE DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 3/31/2026
		1 Sample(s) Required between 5/1/2026 and 5/31/2026
		1 Sample(s) Required between 6/1/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 7/31/2026
		1 Sample(s) Required between 8/1/2026 and 8/31/2026
		1 Sample(s) Required between 9/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

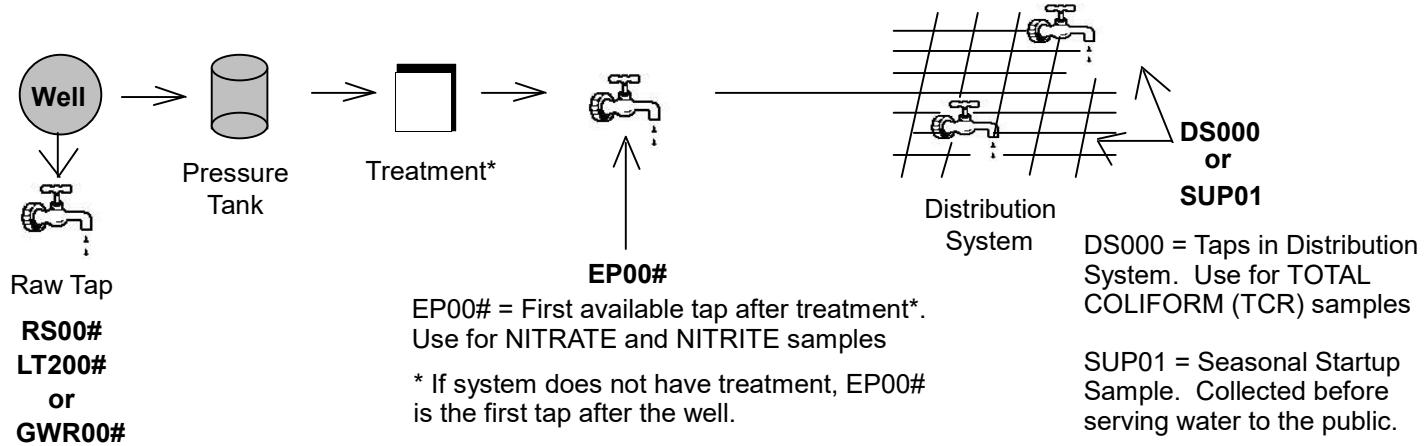

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**





**OH0244312 RUSH TRUCK CENTER OF LIMA**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>RUSH TRUCK CENTER - LIMA DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

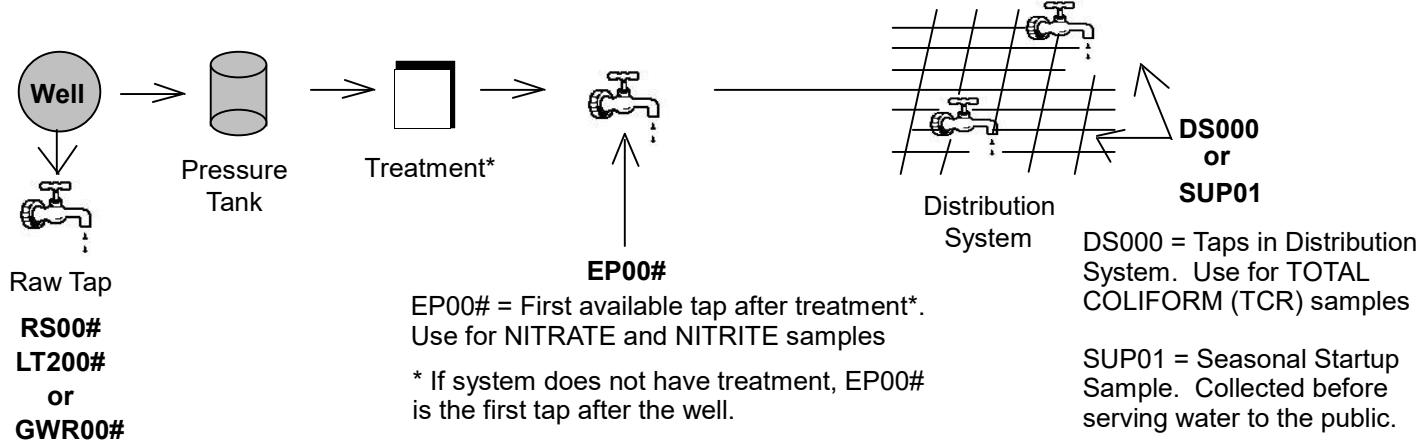

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0244312 RUSH TRUCK CENTER OF LIMA**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252682	Facility Name: <b>RUSH TRUCK CENTER - LIMA</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

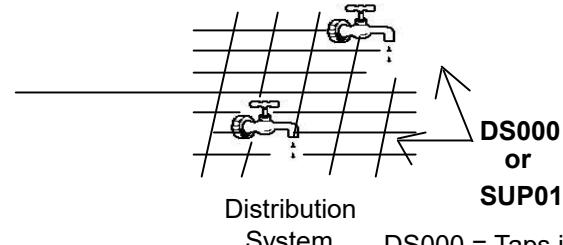

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0247812 ODOT REST AREA 1-31 EB**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>ODOT-REST AREA 1-31 EB DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

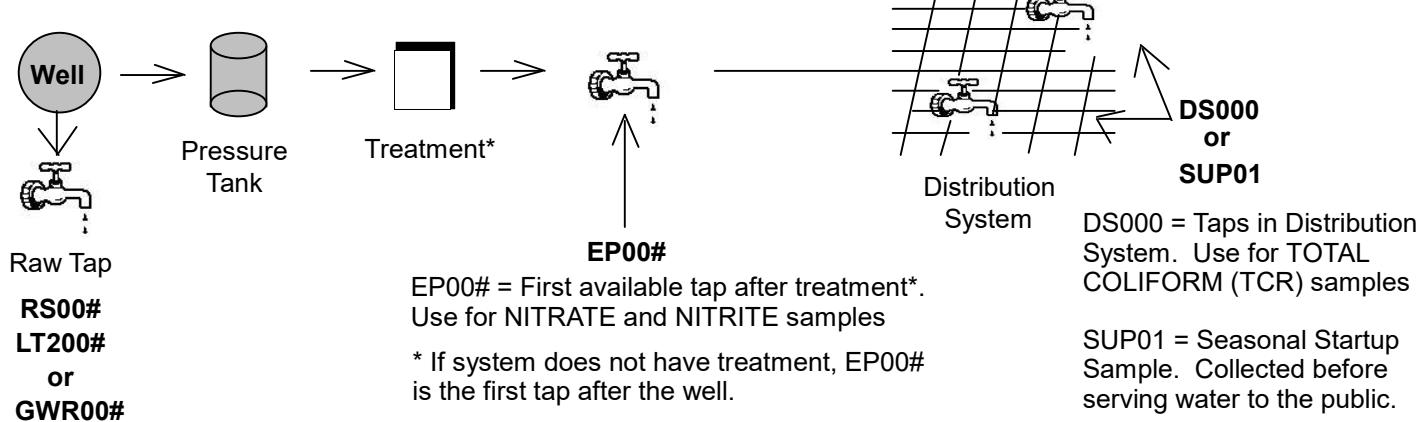

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0247812 ODOT REST AREA 1-31 EB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252686	Facility Name: <b>ODOT REST AREA NO 1-31 EB</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

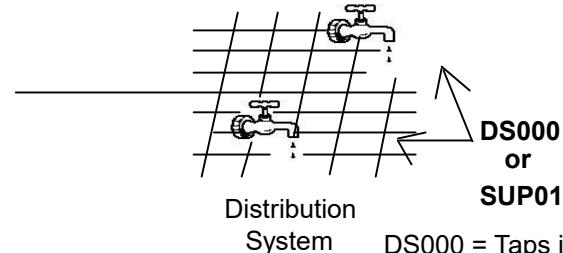

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0247912 ODOT REST AREA 1-32 WB**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>ODOT-REST AREA 1-32 WB DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

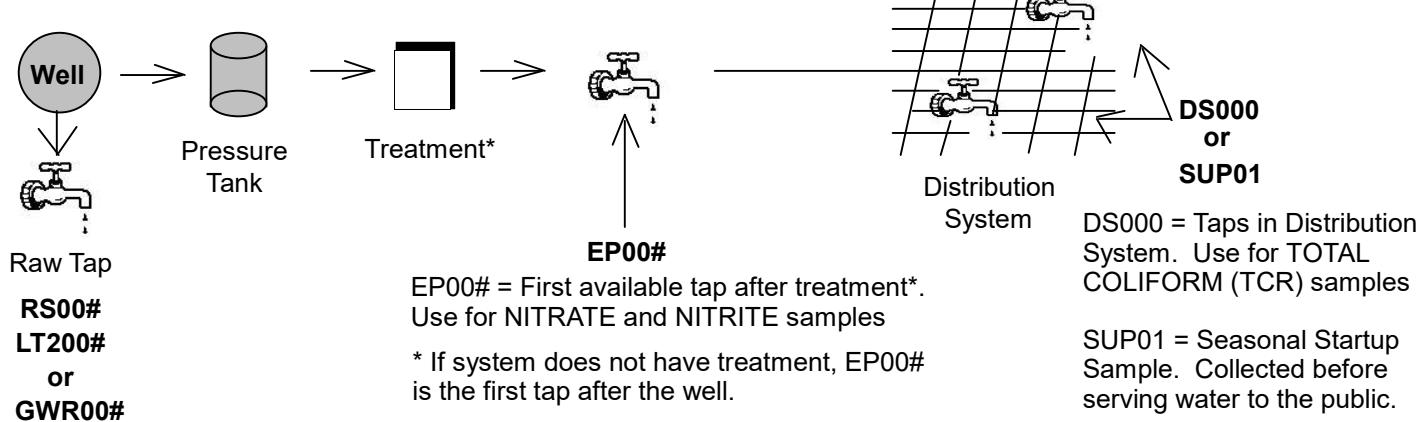

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0247912 ODOT REST AREA 1-32 WB**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252687	Facility Name: <b>ODOT REST AREA NO 1-32 WB</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**




Raw Tap

RS00#

LT200#


or

GWR00#

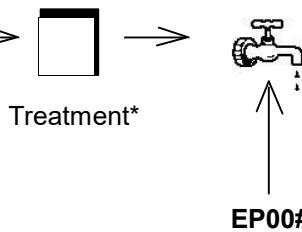

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

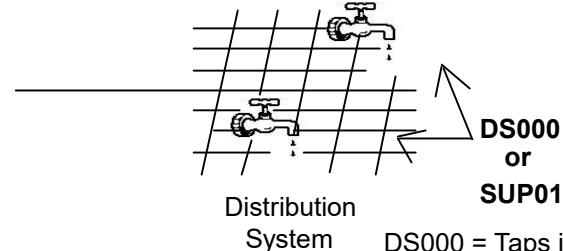

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0248212 PIKE MENNONITE CHURCH**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>PIKE MENNONITE CHURCH DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

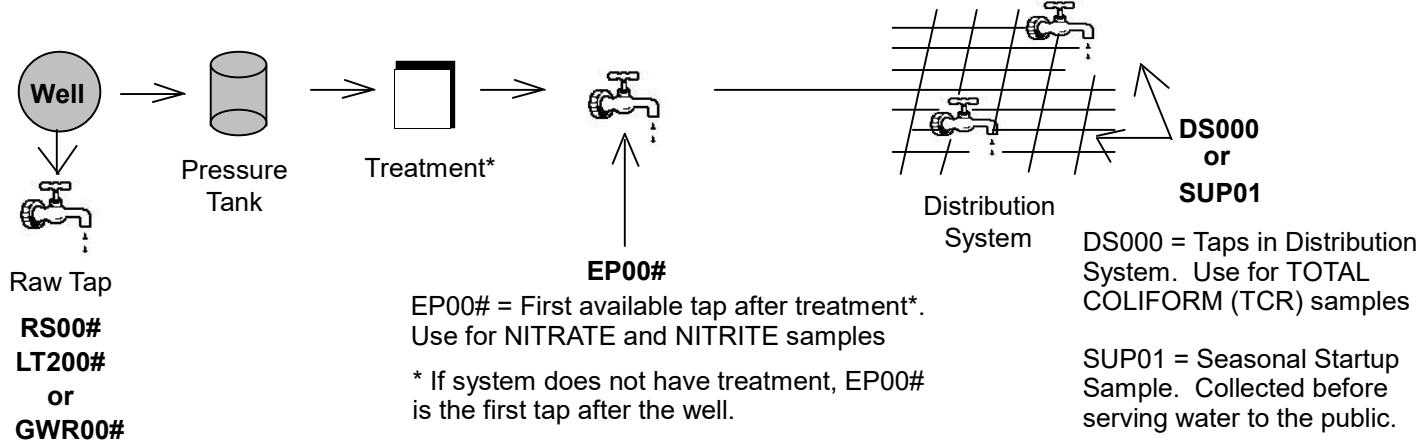

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



## OH0248212 PIKE MENNONITE CHURCH

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

### ENTRY POINT MONITORING SCHEDULE


<b>Sampling</b>	Facility ID: 252688	Facility Name: PIKE MENNONITE CHURCH
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

### Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

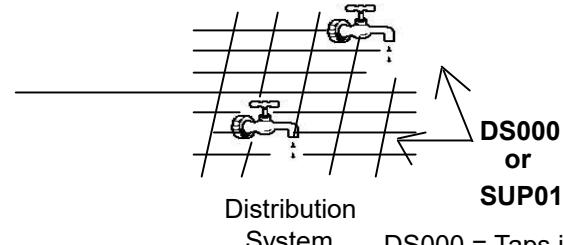

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0251112 EBENEZER MENNONITE CHURCH**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>EBENEZER MENNONITE CH DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

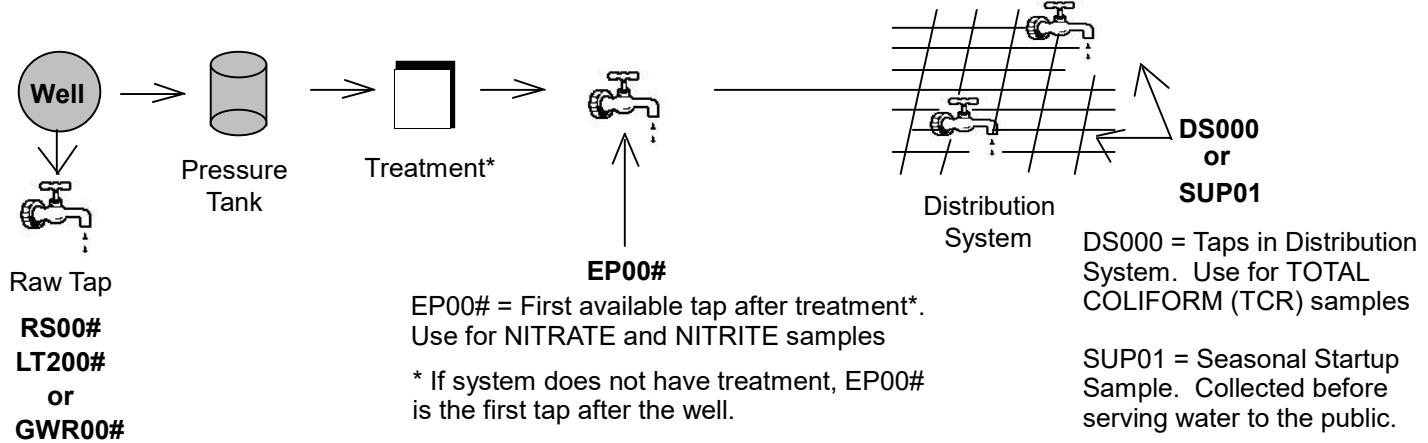

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH025112 EBENEZER MENNONITE CHURCH**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 252694      Facility Name: EBENEZER MENNONITE CHURCH**

**Location SMP ID: EP001      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure  
Tank

Treatment\*

EP00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

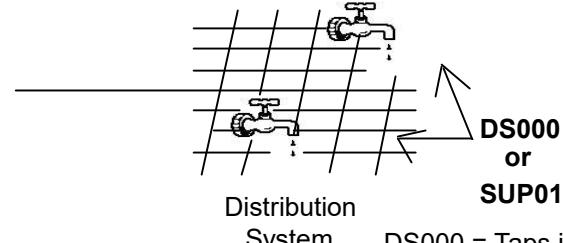

Distribution  
System

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0251312 PLEASANT VIEW CHURCH OF BRETHREN**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>PLEASANT VIEW CH BRETHREN DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

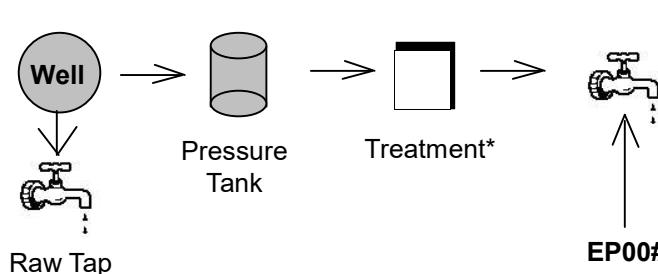

Raw Tap

**RS00#**

**LT200#**


or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

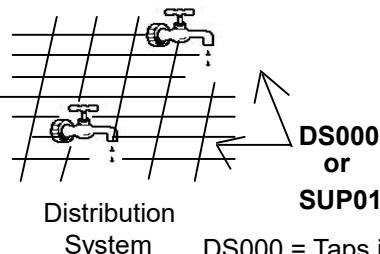

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0251312 PLEASANT VIEW CHURCH OF BRETHREN**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252695	Facility Name: <b>PLEASANT VIEW CHURCH OF BRETHREN</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

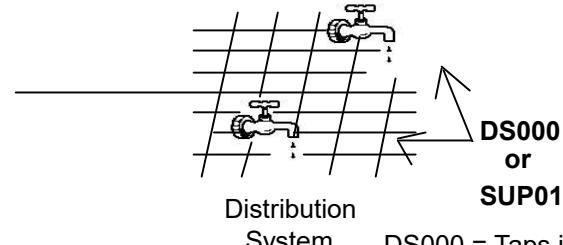

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0251912 ELIDA MENNONITE SCHOOL**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252699</b>	Facility Name: <b>ELIDA MENNONITE SCHOOL</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026



**OH0251912 ELIDA MENNONITE SCHOOL**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA MENNONITE SCHOOL DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>ELIDA MENNONITE SCHOOL DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>LC###</b>	Refer to your Lead and Copper plan for SMP IDs

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



**OH0252212 SUN VALLEY FAMILY CAMPGROUND**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>252701</b>	Facility Name: <b>SUN VALLEY FAMILY CAMPGROUND</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>GROSS ALPHA - 4002 RADIUM-228 - 4030</b>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH0252212 SUN VALLEY FAMILY CAMPGROUND**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: <b>DS1</b> Facility Name: <b>SUN VALLEY FAMILY CMPGRD DISTRIBUTION</b> SMP ID: <b>DS000</b>	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

Sampling Location	Facility ID: <b>DS1</b> Facility Name: <b>SUN VALLEY FAMILY CMPGRD DISTRIBUTION</b> SMP ID: <b>LC###</b> Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		5 Sample(s) Required between 6/1/2026 and 9/30/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*



**OH0252212 SUN VALLEY FAMILY CAMPGROUND**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SUN VALLEY FAMILY CMPGRD DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>LOT 138</b>
Chemicals	Monitoring Requirements	

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0253512 ST JOHN THE BAPTIST CATHOLIC CHURCH**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: ST JOHN BAPTIST CATHOLIC DISTRIBUTION
<b>Location</b>	SMP ID: DS000	Facility Source: Ground Water

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

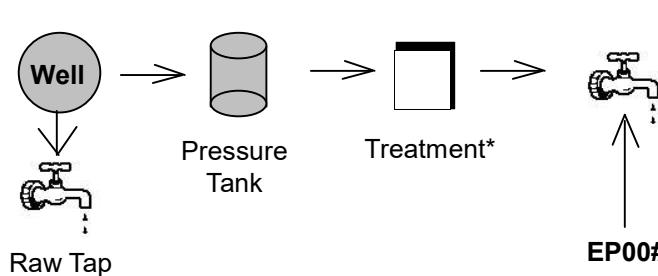

Raw Tap

**RS00#**

**LT200#**


or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

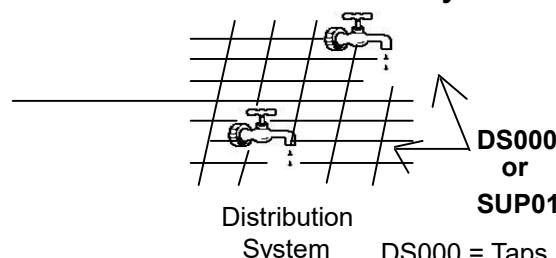

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0253512 ST JOHN THE BAPTIST CATHOLIC CHURCH**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 252710	Facility Name: ST JOHN THE BAPTIST CATHOLIC CHURCH
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

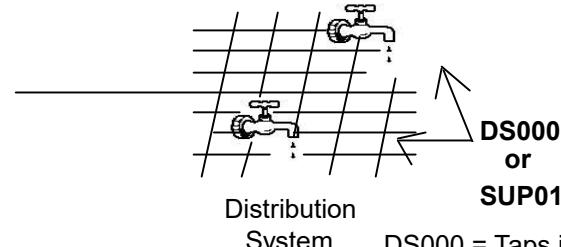

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0253812 CROSSROADS CHURCH OF GOD**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>261005</b>	Facility Name: <b>CROSSROADS CHURCH OF GOD</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026



**OH0253812 CROSSROADS CHURCH OF GOD**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CROSSROADS CHURCH OF GOD DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CROSSROADS CHURCH OF GOD DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>LC###</b>	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*



**OH0254312 PROCTER N GAMBLE DIST CTR - LIMA**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>262032</b>	Facility Name: <b>PROCTER &amp; GAMBLE</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



**OH0254312 PROCTER N GAMBLE DIST CTR - LIMA**

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>PROCTER &amp; GAMBLE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>PROCTER &amp; GAMBLE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>LC###</b>	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>PROCTER &amp; GAMBLE DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS201</b>	<b>WEL CEN BREAKROOM SINK</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM – 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*



**OH0254712 ST MATTHEW LUTHERAN CHURCH**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: ST MATTHEW LUTHERAN CHURCH DISTRIBUTION
<b>Location</b>	SMP ID: DS000	Facility Source:
<b>Chemicals</b>		<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

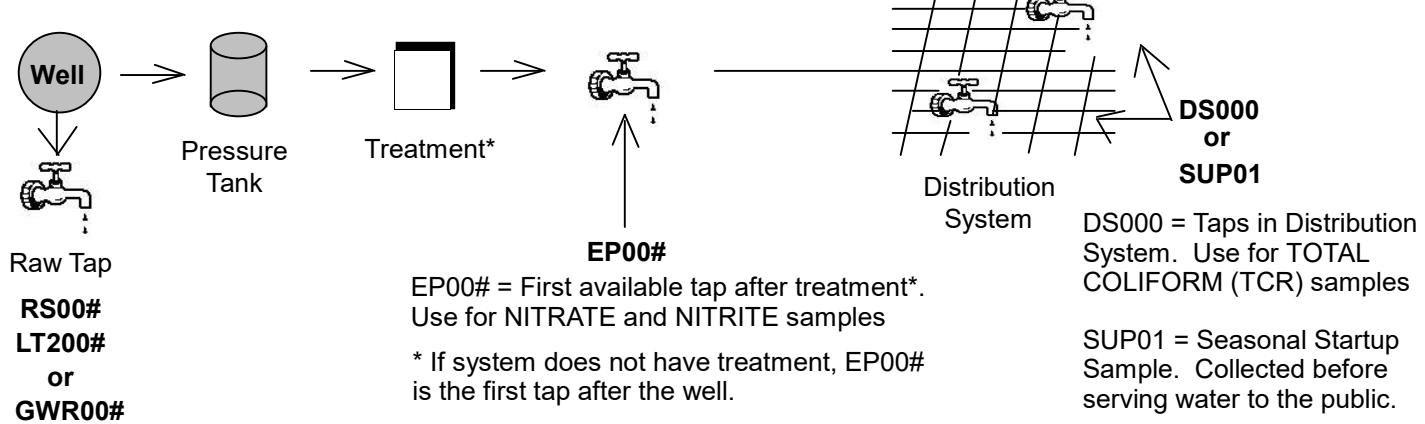

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254712 ST MATTHEW LUTHERAN CHURCH**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262246	Facility Name: ST MATTHEW LUTHERAN CHURCH
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

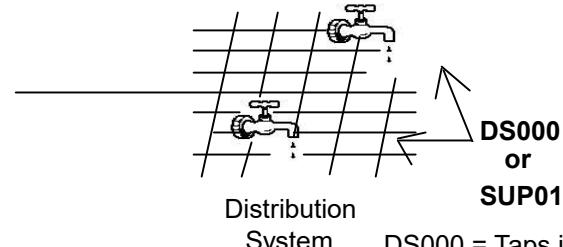

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254913 SYCAMORE LAKE WINE CO**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**


**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: DS1	Facility Name: <b>SYCAMORE LAKE WINE CO DISTRIBUTION</b>
<b>Location</b>	SMP ID: DS000	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

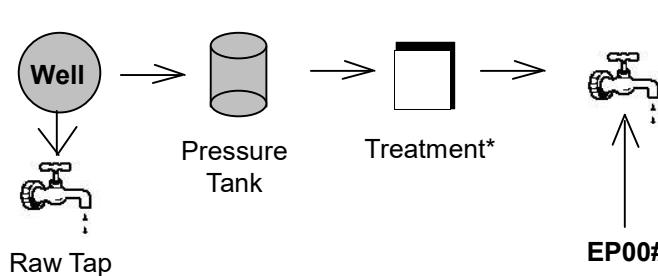

Raw Tap

**RS00#**

**LT200#**


or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

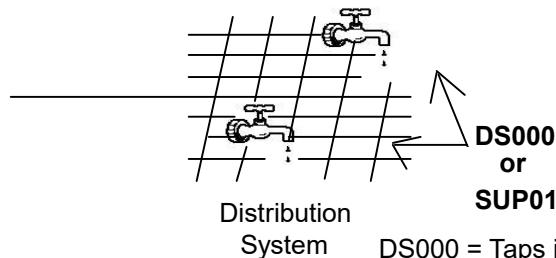

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254913 SYCAMORE LAKE WINE CO**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262319	Facility Name: SYCAMORE LAKE WINE CO
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

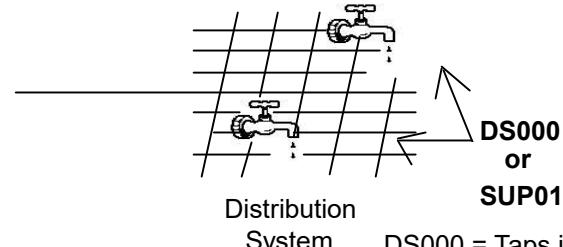

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254914 MORRIS CHIROPRACTIC CLINIC PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>MORRIS CHIROPRACTIC DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS000</b>	Facility Source:

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

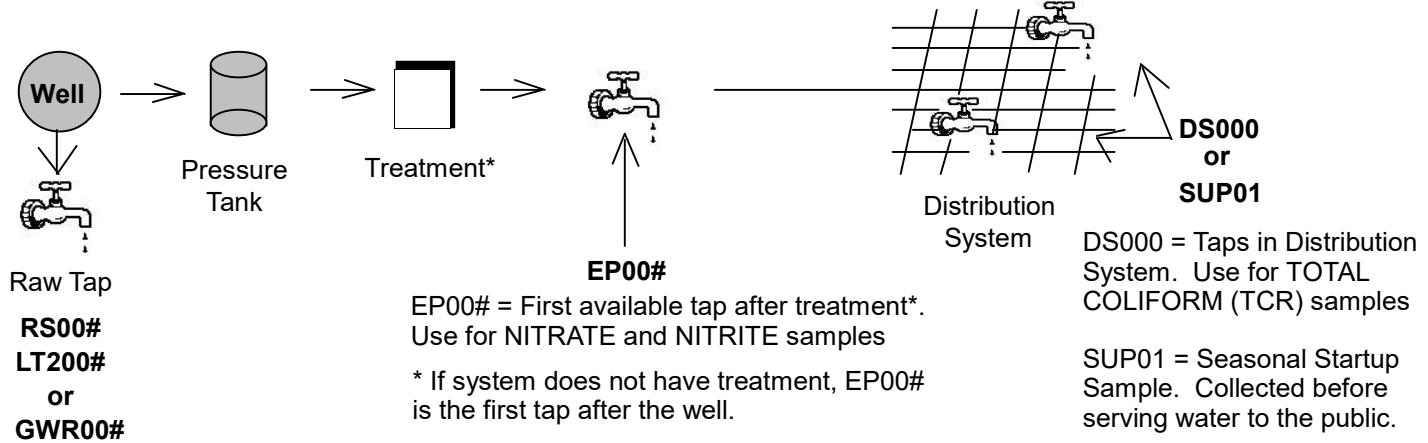

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254914 MORRIS CHIROPRACTIC CLINIC PWS**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling Facility ID: 262321      Facility Name: MORRIS CHIROPRACTIC CLINIC**

**Location SMP ID: EP001      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure  
Tank

Treatment\*

EP00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

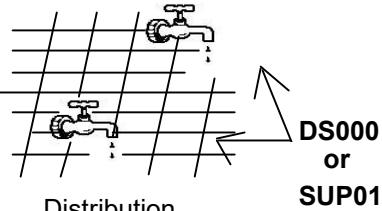

Distribution  
System

DS000 = Taps in Distribution  
System. Use for TOTAL  
COLIFORM (TCR) samples

SUP01 = Seasonal Startup  
Sample. Collected before  
serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254915 SHARON MENNONITE CHURCH PWS**

System Type: Transient Noncommunity

Source: Ground Water

*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


**For water emergencies that occur after hours, please call 800-282-9378**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SHARON MENNONITE CHURCH DISTRIBUTION</b>
<b>Location</b>	SMP ID: <b>DS000</b>	Facility Source:

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

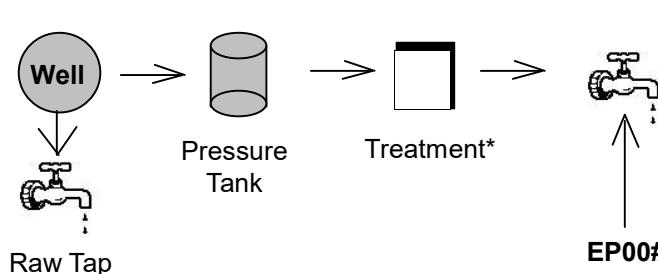

Raw Tap

**RS00#**


**LT200#**

or

**GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

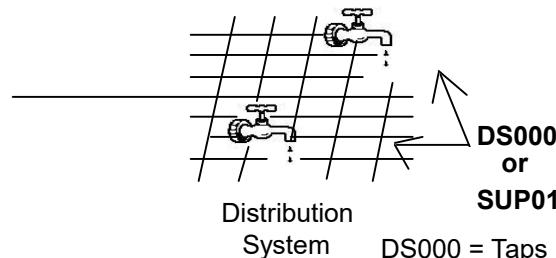

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254915 SHARON MENNONITE CHURCH PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262322	Facility Name: SHARON MENNONITE CHURCH
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

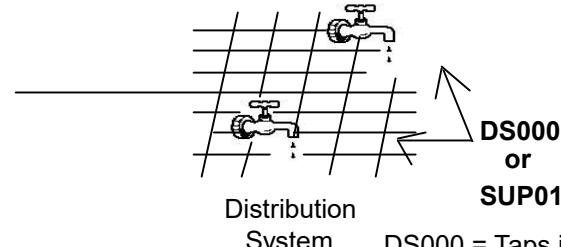

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254916 COUNTY LINE CHURCH OF THE BRETHREN PWS**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>COUNTY LINE CHURCH DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS000</b>	Facility Source:

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

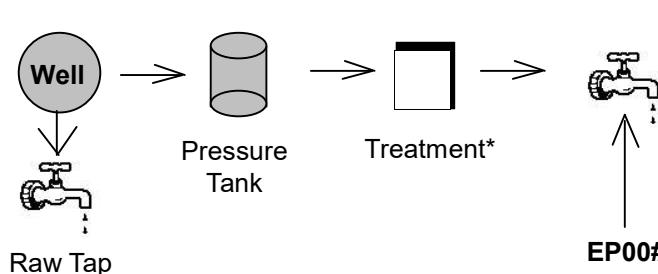

Raw Tap

**RS00#**


**LT200#**

or

**GWR00#**

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00#  
is the first tap after the well.

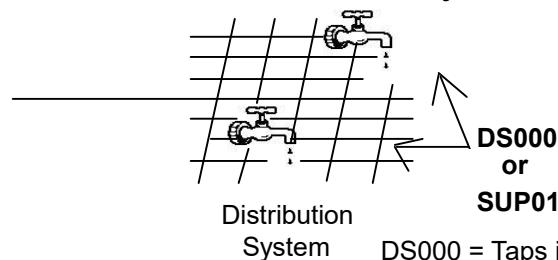

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254916 COUNTY LINE CHURCH OF THE BRETHREN PWS**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262323	Facility Name: <b>COUNTY LINE CHURCH OF THE BRETHREN</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**




Raw Tap

RS00#

LT200#


or

GWR00#



EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

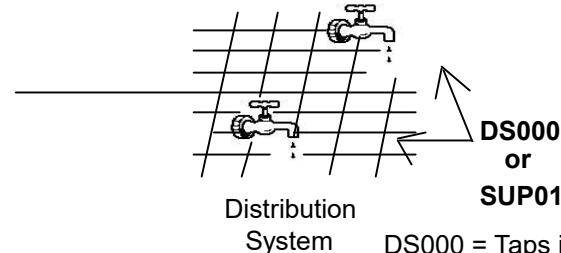

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254917 DOLLAR GENERAL STORE - HARROD #21885**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1 Facility Name: DISTRIBUTION**

**Location SMP ID: DS000 Facility Source:**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

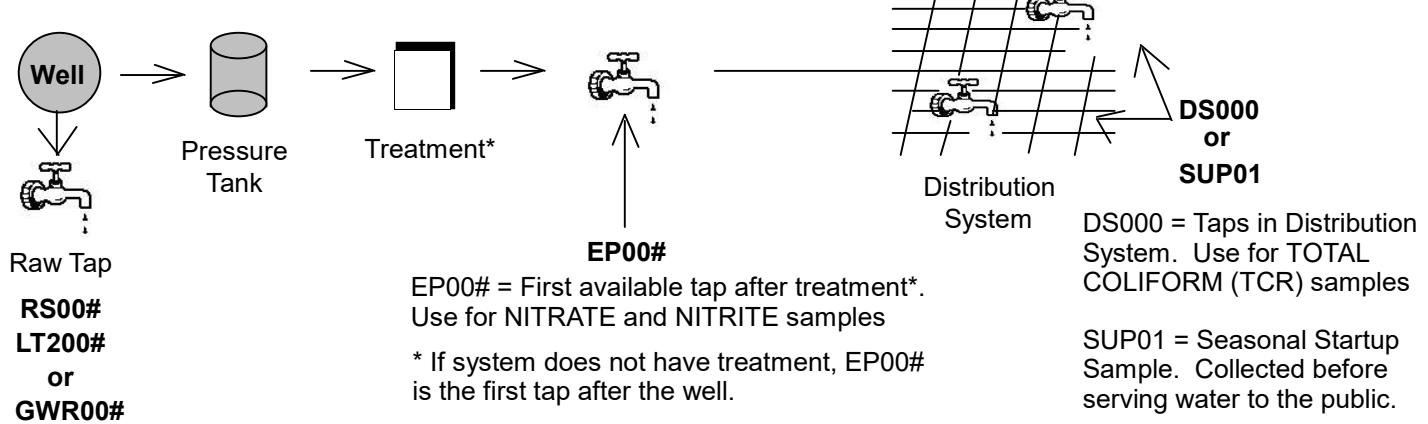

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254917 DOLLAR GENERAL STORE - HARROD #21885**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262324	Facility Name: <b>DOLLAR GENERAL 21885 - HARROD</b>
<b>Location</b>	SMP ID: EP001	Facility Source:

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

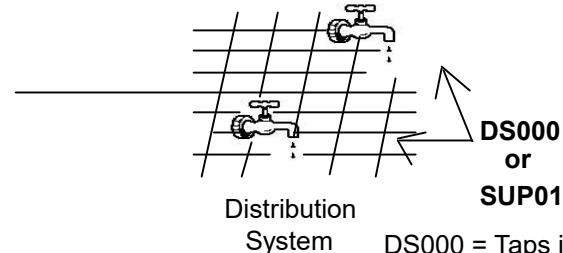

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254918 ROUSCULP CHURCH OF CHRIST**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: ROUSCULP CH OF CHRIST DISTRIBUTION**  
**Location SMP ID: DS000      Facility Source:**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

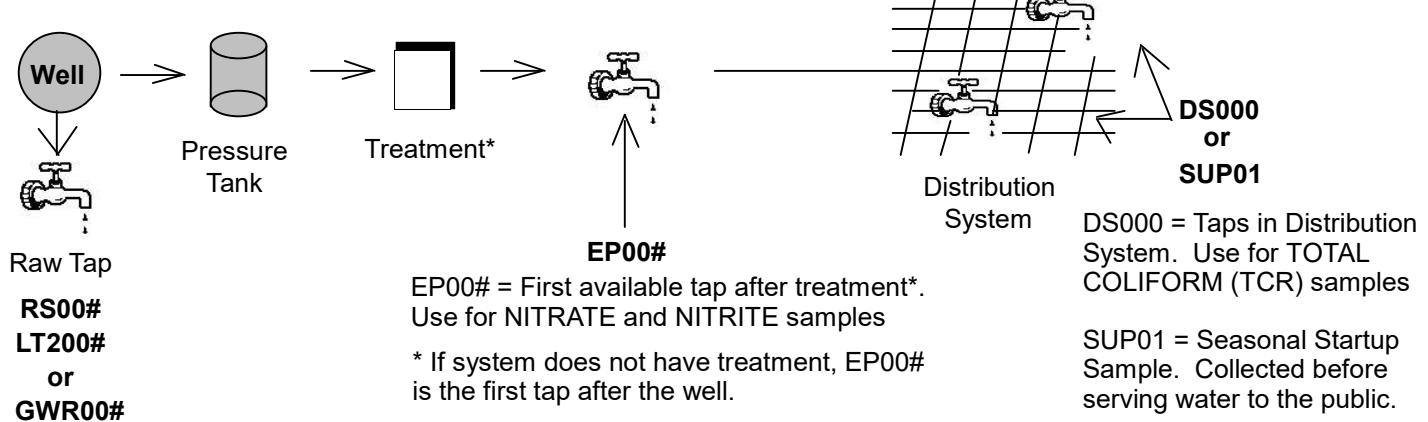

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254918 ROUSCULP CHURCH OF CHRIST**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262325	Facility Name: <b>ROUSCULP CHURCH OF CHRIST</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

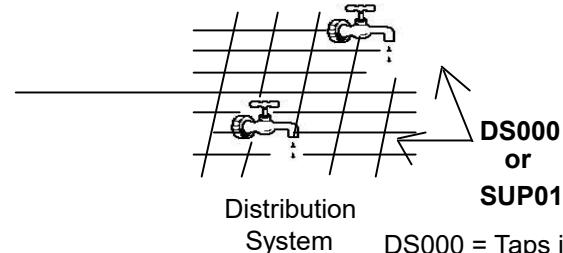

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254920 EMMANUEL UNITED CHURCH OF CHRIST**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: DISTRIBUTION**


**Location SMP ID: DS000      Facility Source:**

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

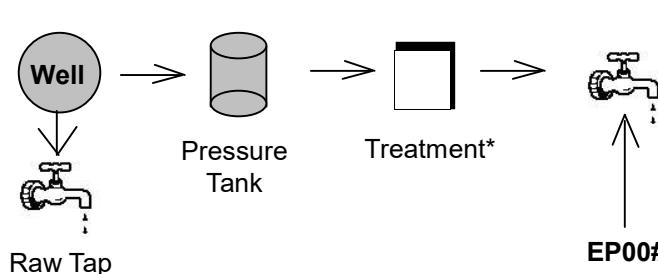

Raw Tap

**RS00#**

**LT200#**


or

**GWR00#**

EP00# = First available tap after treatment\*.

Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

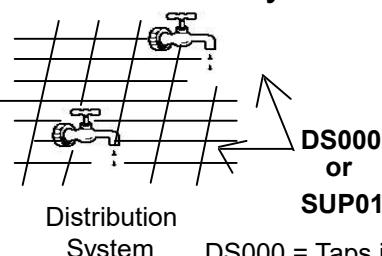

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254920 EMMANUEL UNITED CHURCH OF CHRIST**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262327	Facility Name: EMMANUEL UNITED CHURCH OF CHRIST
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*. Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

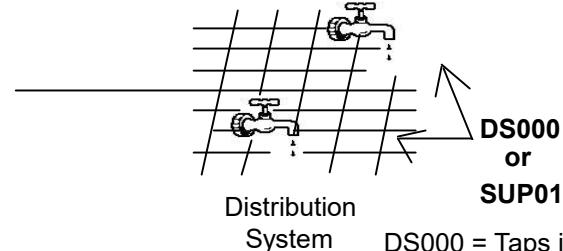

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254924 STITES DISCOUNT GROCERY STORE**

System Type: Transient Noncommunity      Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: DISTRIBUTION**

**Location SMP ID: DS000      Facility Source:**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

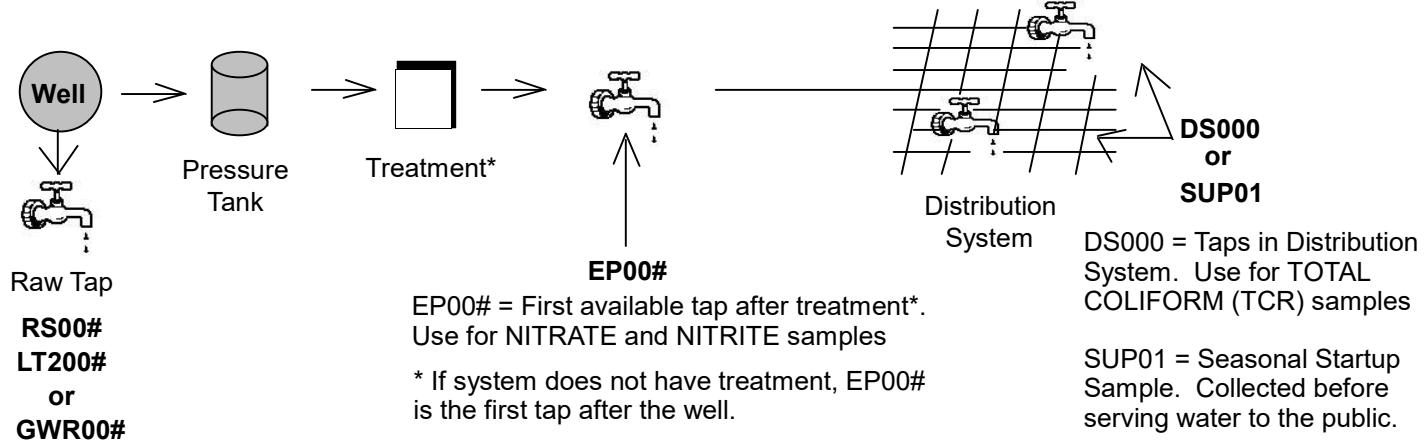

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**



**OH0254924 STITES DISCOUNT GROCERY STORE**

System Type: Transient Noncommunity    Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**


<b>Sampling</b>	Facility ID: 262328	Facility Name: STITES DISCOUNT GROCERY
<b>Location</b>	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

**Where to Collect Samples For a Small Public Water System**



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment\*.  
Use for NITRATE and NITRITE samples

\* If system does not have treatment, EP00# is the first tap after the well.

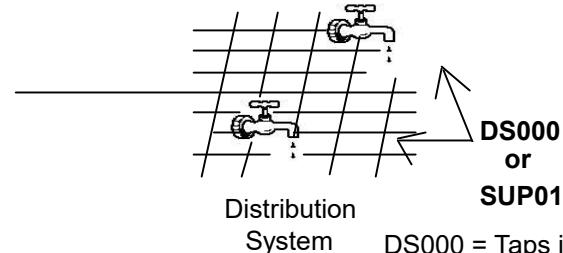

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**