



Subject: 2026 PWS Monitoring Schedules Now Available

Dear Public Water System (PWS) Owner:

The 2026 Contaminant Monitoring Schedules have been created and are now available online at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/ddgw-programs/contaminant-monitoring/drinking-water-monitoring>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.

- For the chemicals listed on the [Entry Point Schedule](#), the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the [Distribution Schedule](#), sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish

to hire someone to collect samples for you, a list of drinking water sampling services that can assist you with collecting water samples is located online at:
<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

The distribution requirements only need to be met by your overall system, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
 - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revise-total-coliform-rule>.
 - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
 - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.

- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

Subscribe to Updates: Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

For Transient Non-Community (TNC) PWSs Only

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Southwest District Office at: 937-285-6357
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Elam](#), [Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)

OH1100112 CHRISTIANSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153158	Facility Name: CHRISTIANSBURG VILLAGE
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026

OH1100112 CHRISTIANSBURG VILLAGE PWS

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CHRISTIANSBURG, VILLAGE DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 1/31/2026
	1 Sample(s) Required between	2/1/2026 and 2/28/2026
	1 Sample(s) Required between	3/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 4/30/2026
	1 Sample(s) Required between	5/1/2026 and 5/31/2026
	1 Sample(s) Required between	6/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 7/31/2026
	1 Sample(s) Required between	8/1/2026 and 8/31/2026
	1 Sample(s) Required between	9/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 10/31/2026
	1 Sample(s) Required between	11/1/2026 and 11/30/2026
	1 Sample(s) Required between	12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2026 and 1/31/2026
	1 Sample(s) Required between	2/1/2026 and 2/28/2026
	1 Sample(s) Required between	3/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 4/30/2026
	1 Sample(s) Required between	5/1/2026 and 5/31/2026
	1 Sample(s) Required between	6/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 7/31/2026
	1 Sample(s) Required between	8/1/2026 and 8/31/2026
	1 Sample(s) Required between	9/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 10/31/2026
	1 Sample(s) Required between	11/1/2026 and 11/30/2026
	1 Sample(s) Required between	12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: CHRISTIANSBURG, VILLAGE DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements	
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between	6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1100112 CHRISTIANSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System***THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026****DISTRIBUTION MONITORING SCHEDULE****Sampling** Facility ID: **DS1** Facility Name: **CHRISTIANSBURG, VILLAGE DISTRIBUTION****Location** SMP ID: **DS201** **113 N MAIN ST****Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.***Sampling** Facility ID: **DS1** Facility Name: **CHRISTIANSBURG, VILLAGE DISTRIBUTION****Location** SMP ID: **DS202** **5526 N ADDISON****Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

OH1100312 SPRING MEADOWS CARE CENTER

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153159	Facility Name: SPRING MEADOWS CARE CENTER
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1100312 SPRING MEADOWS CARE CENTER

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SPRING MEADOWS CARE CENT DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: SPRING MEADOWS CARE CENT DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1100312 SPRING MEADOWS CARE CENTER

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SPRING MEADOWS CARE CENT DISTRIBUTION
Location	SMP ID: DS201	1649 PARK RD

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1100412 GRANDVIEW HEIGHTS CIVIC ASSOCIATION PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153160	Facility Name: GRANDVIEW HEIGHTS CIVIC ASSOC
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1100412 GRANDVIEW HEIGHTS CIVIC ASSOCIATION PWS

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE
Sampling Location Facility ID: **DS1** Facility Name: **GRANDVIEW HTS CIVIC ASSN DISTRIBUTION**
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.
Sampling Location Facility ID: **DS1** Facility Name: **GRANDVIEW HTS CIVIC ASSN DISTRIBUTION**
 SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2026 and 6/30/2026
	10 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1100412 GRANDVIEW HEIGHTS CIVIC ASSOCIATION PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GRANDVIEW HTS CIVIC ASSN DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1100512 HARVEST SQUARE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153161	Facility Name: HARVEST SQUARE MHP
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	4/1/2026 and 6/30/2026
RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and 5/31/2026

OH1100512 HARVEST SQUARE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE
Sampling Location Facility ID: **DS1** Facility Name: **HARVEST SQUARE MHP DISTRIBUTION**
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.
Sampling Location Facility ID: **DS1** Facility Name: **HARVEST SQUARE MHP DISTRIBUTION**
 SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1100512 HARVEST SQUARE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: HARVEST SQUARE MHP DISTRIBUTION
Location	SMP ID: DS201	OFFICE - 5646 SPRINGFIELD

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1100712 MECHANICSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153163	Facility Name: MECHANICSBURG WTP
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1100712 MECHANICSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MECHANICSBURG,VILLAGE OF DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2026 and 1/31/2026
	2 Sample(s) Required between	2/1/2026 and 2/28/2026
	2 Sample(s) Required between	3/1/2026 and 3/31/2026
	2 Sample(s) Required between	4/1/2026 and 4/30/2026
	2 Sample(s) Required between	5/1/2026 and 5/31/2026
	2 Sample(s) Required between	6/1/2026 and 6/30/2026
	2 Sample(s) Required between	7/1/2026 and 7/31/2026
	2 Sample(s) Required between	8/1/2026 and 8/31/2026
	2 Sample(s) Required between	9/1/2026 and 9/30/2026
	2 Sample(s) Required between	10/1/2026 and 10/31/2026
	2 Sample(s) Required between	11/1/2026 and 11/30/2026
	2 Sample(s) Required between	12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2026 and 1/31/2026
	2 Sample(s) Required between	2/1/2026 and 2/28/2026
	2 Sample(s) Required between	3/1/2026 and 3/31/2026
	2 Sample(s) Required between	4/1/2026 and 4/30/2026
	2 Sample(s) Required between	5/1/2026 and 5/31/2026
	2 Sample(s) Required between	6/1/2026 and 6/30/2026
	2 Sample(s) Required between	7/1/2026 and 7/31/2026
	2 Sample(s) Required between	8/1/2026 and 8/31/2026
	2 Sample(s) Required between	9/1/2026 and 9/30/2026
	2 Sample(s) Required between	10/1/2026 and 10/31/2026
	2 Sample(s) Required between	11/1/2026 and 11/30/2026
	2 Sample(s) Required between	12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: MECHANICSBURG,VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements	
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between	6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1100712 MECHANICSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System***THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026****DISTRIBUTION MONITORING SCHEDULE****Sampling** Facility ID: **DS1** Facility Name: **MECHANICSBURG,VILLAGE OF DISTRIBUTION****Location** SMP ID: **DS201** **18 N MAIN STREET****Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.***Sampling** Facility ID: **DS1** Facility Name: **MECHANICSBURG,VILLAGE OF DISTRIBUTION****Location** SMP ID: **DS202** **90 MILL STREET****Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

OH1100812 NORTH LEWISBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153164	Facility Name: NORTH LEWISBURG WATER SYSTEM
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	4/1/2026 and 6/30/2026

OH1100812 NORTH LEWISBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: NORTH LEWISBURG, VLG. OF DISTRIBUTION
	SMP ID: DS000	

Chemicals
Monitoring Requirements

ASBESTOS - 1094

Not Required

TOTAL COLIFORM (TCR) - 3100

2 Sample(s) Required between	1/1/2026	and	1/31/2026
2 Sample(s) Required between	2/1/2026	and	2/28/2026
2 Sample(s) Required between	3/1/2026	and	3/31/2026
2 Sample(s) Required between	4/1/2026	and	4/30/2026
2 Sample(s) Required between	5/1/2026	and	5/31/2026
2 Sample(s) Required between	6/1/2026	and	6/30/2026
2 Sample(s) Required between	7/1/2026	and	7/31/2026
2 Sample(s) Required between	8/1/2026	and	8/31/2026
2 Sample(s) Required between	9/1/2026	and	9/30/2026
2 Sample(s) Required between	10/1/2026	and	10/31/2026
2 Sample(s) Required between	11/1/2026	and	11/30/2026
2 Sample(s) Required between	12/1/2026	and	12/31/2026

TOTAL CHLORINE - 1000

2 Sample(s) Required between	1/1/2026	and	1/31/2026
2 Sample(s) Required between	2/1/2026	and	2/28/2026
2 Sample(s) Required between	3/1/2026	and	3/31/2026
2 Sample(s) Required between	4/1/2026	and	4/30/2026
2 Sample(s) Required between	5/1/2026	and	5/31/2026
2 Sample(s) Required between	6/1/2026	and	6/30/2026
2 Sample(s) Required between	7/1/2026	and	7/31/2026
2 Sample(s) Required between	8/1/2026	and	8/31/2026
2 Sample(s) Required between	9/1/2026	and	9/30/2026
2 Sample(s) Required between	10/1/2026	and	10/31/2026
2 Sample(s) Required between	11/1/2026	and	11/30/2026
2 Sample(s) Required between	12/1/2026	and	12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

OH1100912 SAINT PARIS VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153165	Facility Name: SAINT PARIS STU 1
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1100912 SAINT PARIS VILLAGE PWS

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SAINT PARIS, VILLAGE OF DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026
	2 Sample(s) Required between 2/1/2026 and 2/28/2026
	2 Sample(s) Required between 3/1/2026 and 3/31/2026
	2 Sample(s) Required between 4/1/2026 and 4/30/2026
	2 Sample(s) Required between 5/1/2026 and 5/31/2026
	2 Sample(s) Required between 6/1/2026 and 6/30/2026
	2 Sample(s) Required between 7/1/2026 and 7/31/2026
	2 Sample(s) Required between 8/1/2026 and 8/31/2026
	2 Sample(s) Required between 9/1/2026 and 9/30/2026
	2 Sample(s) Required between 10/1/2026 and 10/31/2026
	2 Sample(s) Required between 11/1/2026 and 11/30/2026
	2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026
	2 Sample(s) Required between 2/1/2026 and 2/28/2026
	2 Sample(s) Required between 3/1/2026 and 3/31/2026
	2 Sample(s) Required between 4/1/2026 and 4/30/2026
	2 Sample(s) Required between 5/1/2026 and 5/31/2026
	2 Sample(s) Required between 6/1/2026 and 6/30/2026
	2 Sample(s) Required between 7/1/2026 and 7/31/2026
	2 Sample(s) Required between 8/1/2026 and 8/31/2026
	2 Sample(s) Required between 9/1/2026 and 9/30/2026
	2 Sample(s) Required between 10/1/2026 and 10/31/2026
	2 Sample(s) Required between 11/1/2026 and 11/30/2026
	2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: SAINT PARIS, VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH1100912 SAINT PARIS VILLAGE PWS

System Type: Community

Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SAINT PARIS, VILLAGE OF DISTRIBUTION
	SMP ID: DS201	9751 US-36

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Location	Facility ID: DS1	Facility Name: SAINT PARIS, VILLAGE OF DISTRIBUTION
	SMP ID: DS202	11921 WICK COURT

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1101012 ROLLING HILLS MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153166	Facility Name: ROLLING HILLS MHP STP
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1101012 ROLLING HILLS MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ROLLING HILLS MOBILE HOM DISTRIBUTION
	SMP ID: DS000	

Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026	and	1/31/2026
	1 Sample(s) Required between	2/1/2026	and	2/28/2026
	1 Sample(s) Required between	3/1/2026	and	3/31/2026
	1 Sample(s) Required between	4/1/2026	and	4/30/2026
	1 Sample(s) Required between	5/1/2026	and	5/31/2026
	1 Sample(s) Required between	6/1/2026	and	6/30/2026
	1 Sample(s) Required between	7/1/2026	and	7/31/2026
	1 Sample(s) Required between	8/1/2026	and	8/31/2026
	1 Sample(s) Required between	9/1/2026	and	9/30/2026
	1 Sample(s) Required between	10/1/2026	and	10/31/2026
	1 Sample(s) Required between	11/1/2026	and	11/30/2026
	1 Sample(s) Required between	12/1/2026	and	12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2026	and	1/31/2026
	1 Sample(s) Required between	2/1/2026	and	2/28/2026
	1 Sample(s) Required between	3/1/2026	and	3/31/2026
	1 Sample(s) Required between	4/1/2026	and	4/30/2026
	1 Sample(s) Required between	5/1/2026	and	5/31/2026
	1 Sample(s) Required between	6/1/2026	and	6/30/2026
	1 Sample(s) Required between	7/1/2026	and	7/31/2026
	1 Sample(s) Required between	8/1/2026	and	8/31/2026
	1 Sample(s) Required between	9/1/2026	and	9/30/2026
	1 Sample(s) Required between	10/1/2026	and	10/31/2026
	1 Sample(s) Required between	11/1/2026	and	11/30/2026
	1 Sample(s) Required between	12/1/2026	and	12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: ROLLING HILLS MOBILE HOM DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

OH1101012 ROLLING HILLS MOBILE HOME PARK

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ROLLING HILLS MOBILE HOM DISTRIBUTION
	SMP ID: DS201	224 MAPLEWOOD

Chemicals
Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Location	Facility ID: DS1	Facility Name: ROLLING HILLS MOBILE HOM DISTRIBUTION
	SMP ID: DS202	LOT #6

Chemicals
Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1101112 SUNSET TERRACE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153167	Facility Name: SUNSET TERRACE MHP
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	4/1/2026 and	6/30/2026
----------------	------------------------------	--------------	-----------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1101112 SUNSET TERRACE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SUNSET TERRACE MOBILE PK DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: SUNSET TERRACE MOBILE PK DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1101112 SUNSET TERRACE MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SUNSET TERRACE MOBILE PK DISTRIBUTION
-----------------	-------------------------	---

Location	SMP ID: DS201	LOT 45
-----------------	----------------------	---------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1101212 URBANA CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1160493	Facility Name: URBANA WTP 2
	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
Chemicals
Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 6/1/2026 and 10/31/2026

NITRATE - 1040 1 Sample(s) Required between 7/1/2026 and 9/30/2026

RADIOLOGICALS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:
GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2 Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3 Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4 1 Sample(s) Required between 4/1/2026 and 6/30/2026

Sample for all the analytes listed below:
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039
ENDOTHALL - 2033

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2026 and 3/31/2026

1 Sample(s) Required between 4/1/2026 and 6/30/2026

1 Sample(s) Required between 7/1/2026 and 9/30/2026

1 Sample(s) Required between 10/1/2026 and 12/31/2026

OH1101212 URBANA CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1162297	Facility Name: URBANA WTP 3
	SMP ID: EP003	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between	4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>		
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

OH1101212 URBANA CITY PWS

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE
Sampling Location Facility ID: **DS1** Facility Name: **URBANA, CITY OF DISTRIBUTION**
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2026 and 1/31/2026
	10 Sample(s) Required between 2/1/2026 and 2/28/2026
	10 Sample(s) Required between 3/1/2026 and 3/31/2026
	10 Sample(s) Required between 4/1/2026 and 4/30/2026
	10 Sample(s) Required between 5/1/2026 and 5/31/2026
	10 Sample(s) Required between 6/1/2026 and 6/30/2026
	10 Sample(s) Required between 7/1/2026 and 7/31/2026
	10 Sample(s) Required between 8/1/2026 and 8/31/2026
	10 Sample(s) Required between 9/1/2026 and 9/30/2026
	10 Sample(s) Required between 10/1/2026 and 10/31/2026
	10 Sample(s) Required between 11/1/2026 and 11/30/2026
	10 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2026 and 1/31/2026
	10 Sample(s) Required between 2/1/2026 and 2/28/2026
	10 Sample(s) Required between 3/1/2026 and 3/31/2026
	10 Sample(s) Required between 4/1/2026 and 4/30/2026
	10 Sample(s) Required between 5/1/2026 and 5/31/2026
	10 Sample(s) Required between 6/1/2026 and 6/30/2026
	10 Sample(s) Required between 7/1/2026 and 7/31/2026
	10 Sample(s) Required between 8/1/2026 and 8/31/2026
	10 Sample(s) Required between 9/1/2026 and 9/30/2026
	10 Sample(s) Required between 10/1/2026 and 10/31/2026
	10 Sample(s) Required between 11/1/2026 and 11/30/2026
	10 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.
Sampling Location Facility ID: **DS1** Facility Name: **URBANA, CITY OF DISTRIBUTION**
 SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1101312 HICKORY GROVE MOBILE HOME COMMUNITY

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153169	Facility Name: HICKORY GROVE MHC
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	10/1/2026 and	12/31/2026
----------------	------------------------------	---------------	------------

RADIOLOGICALS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	Not Required
----------------------------------	--------------

OH1101312 HICKORY GROVE MOBILE HOME COMMUNITY

System Type: Community

 Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE
Sampling Location Facility ID: **DS1** Facility Name: **HICKORY GROVE MHC DISTRIBUTION**
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.
Sampling Location Facility ID: **DS1** Facility Name: **HICKORY GROVE MHC DISTRIBUTION**
 SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH1101312 HICKORY GROVE MOBILE HOME COMMUNITY

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System***THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026****DISTRIBUTION MONITORING SCHEDULE****Sampling** Facility ID: **DS1** Facility Name: **HICKORY GROVE MHC DISTRIBUTION****Location** SMP ID: **DS201** **ADDRESS NOT KNOWN****Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

OH1130412 URBANA COUNTRY CLUB

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: URBANA COUNTRY CLUB DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

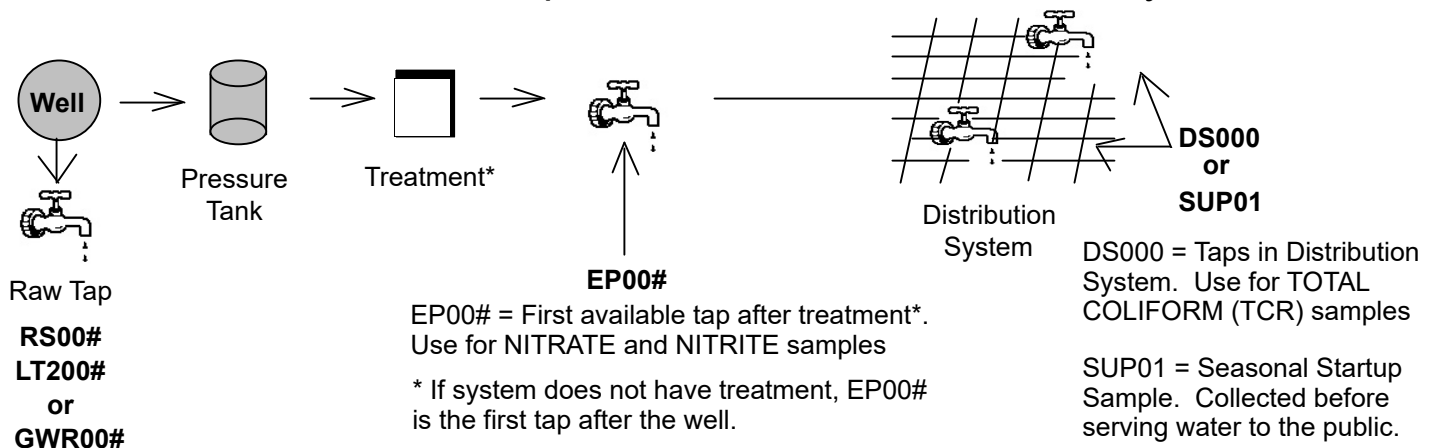

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1130412 URBANA COUNTRY CLUB

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1153172 Facility Name: URBANA COUNTRY CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

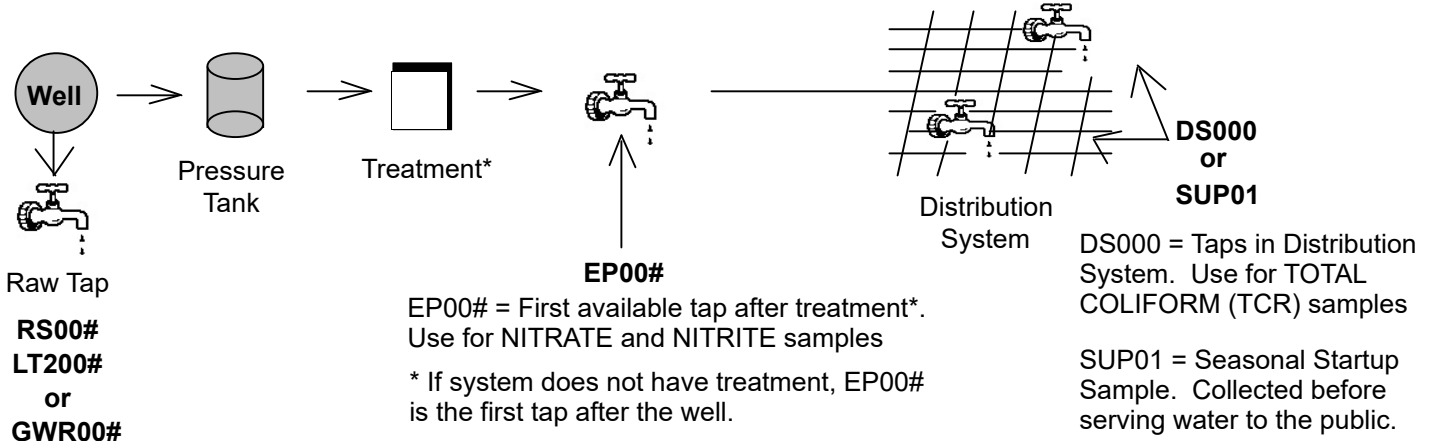

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1130512 STOCKHOUSE BAR & GRILL

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: STOCKHOUSE BAR & GRILL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

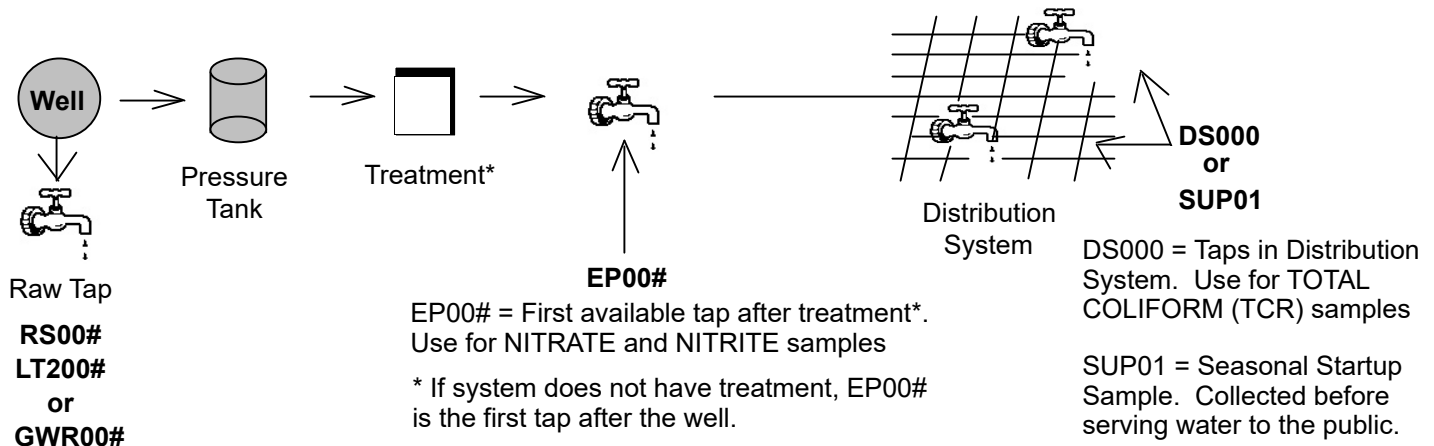

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1130512 STOCKHOUSE BAR & GRILL

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153173	Facility Name: STOCKHOUSE BAR & GRILL
	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

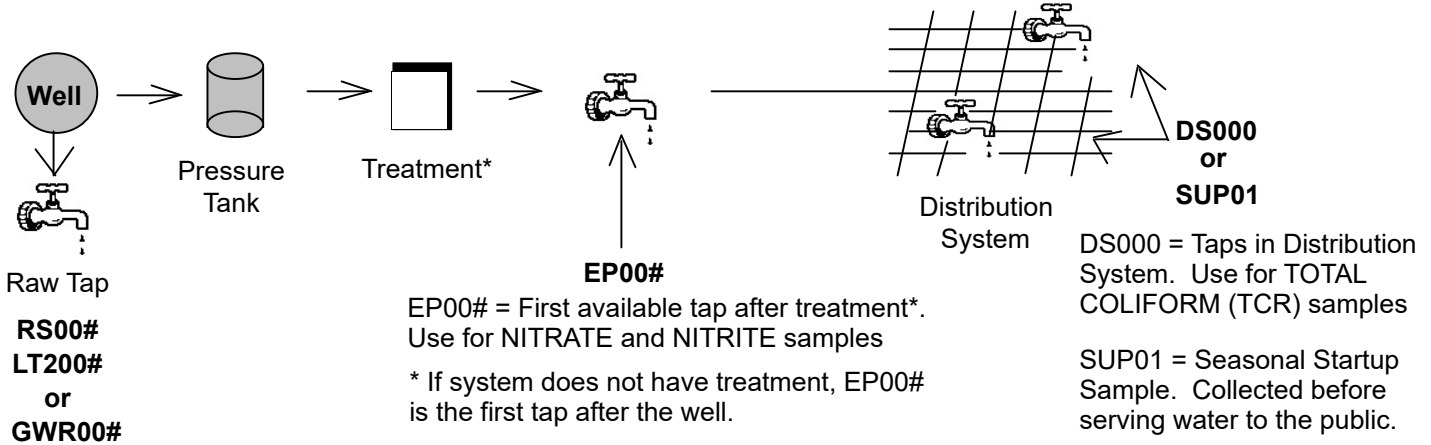

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1130812 ODNR-KISER LAKE STATE PARK-2

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODNR-KISER LAKE-2 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

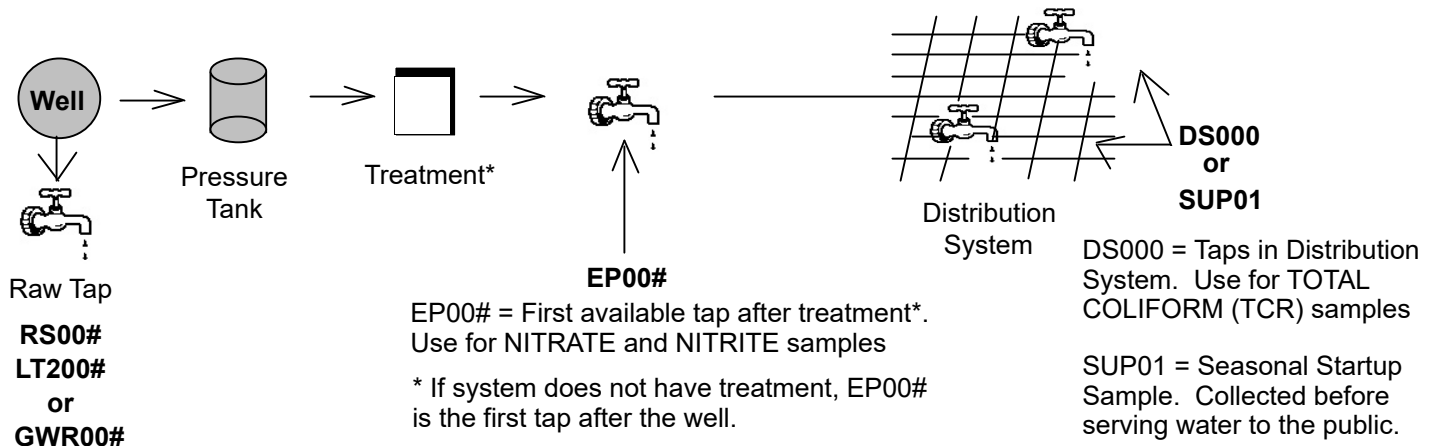

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1130812 ODNR-KISER LAKE STATE PARK-2

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153175 Facility Name: ODNR KISER LAKE-2

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

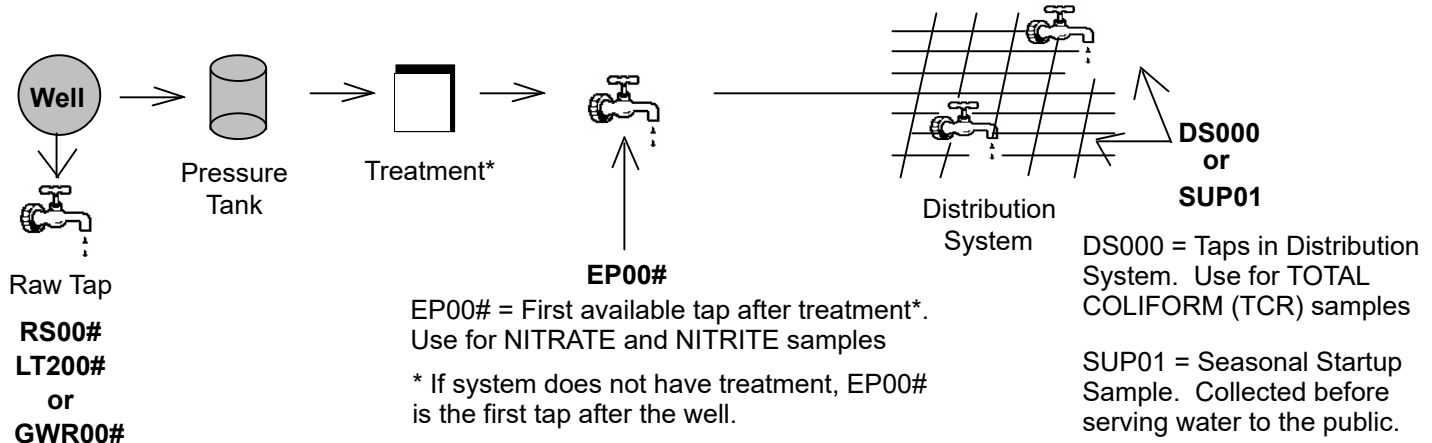

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131312 ODNR-KISER LAKE STATE PARK-7

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODNR-KISER LAKE-7 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

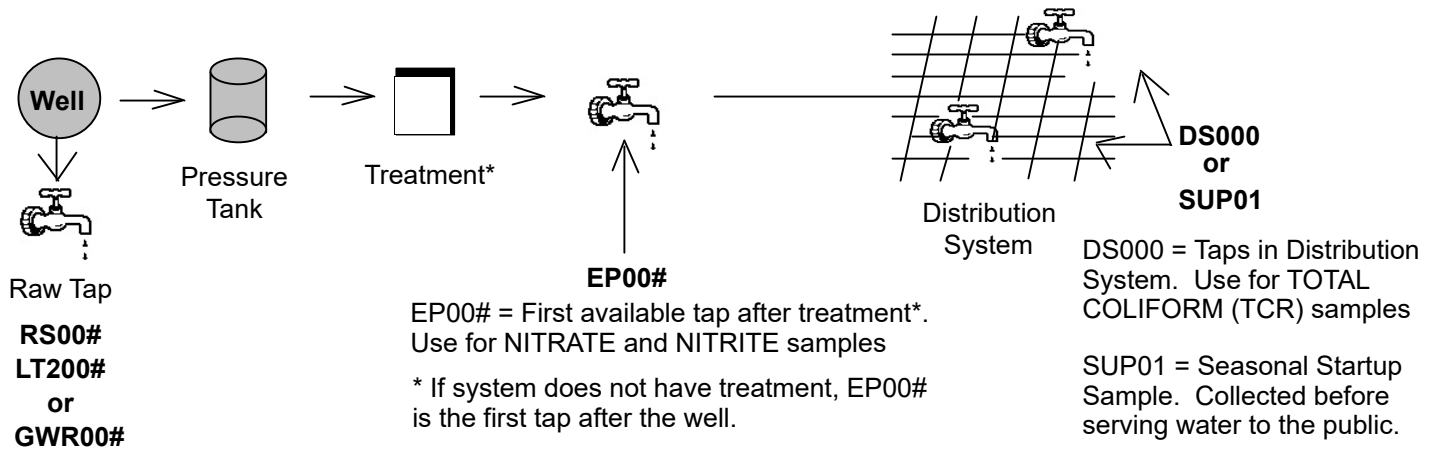

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131312 ODNR-KISER LAKE STATE PARK-7

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153180 Facility Name: ODNR KISER LAKE-7

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

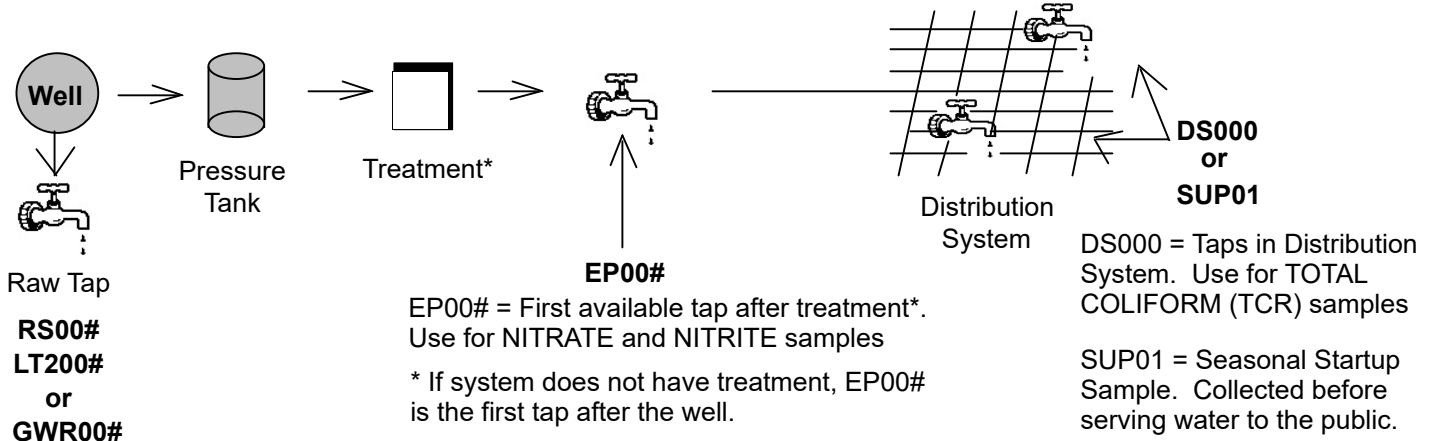

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131612 ODNR-KISER LAKE STATE PARK-10

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: ODNR-KISER LAKE-10 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

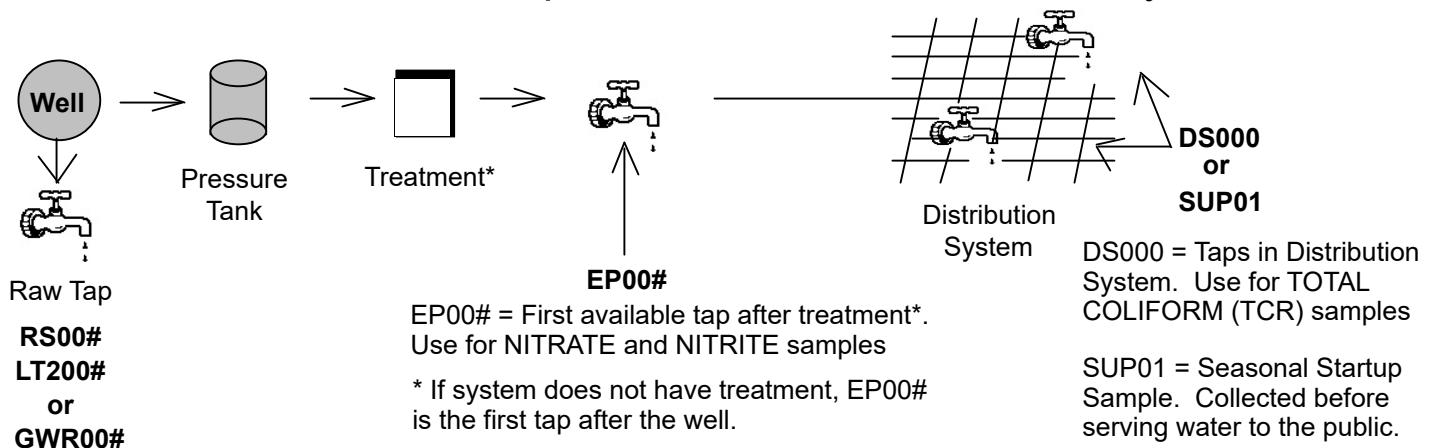

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131612 ODNR-KISER LAKE STATE PARK-10

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153181 Facility Name: ODNR KISER LAKE-10

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals
Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

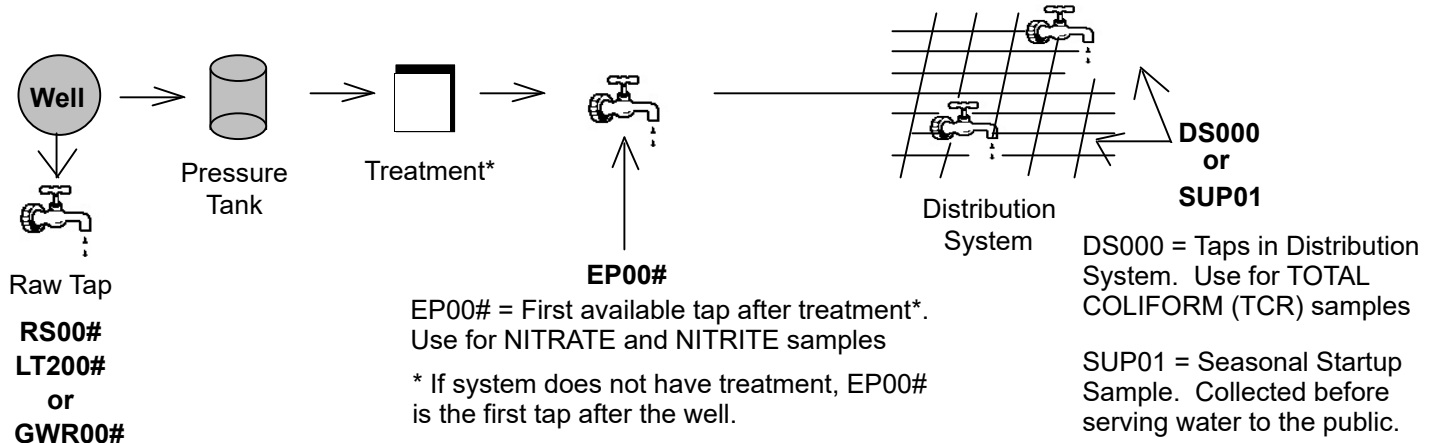

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131812 STUDEBAKER'S COUNTRY RESTAURANT PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: STUDEBAKER'S COUNTRY REST DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

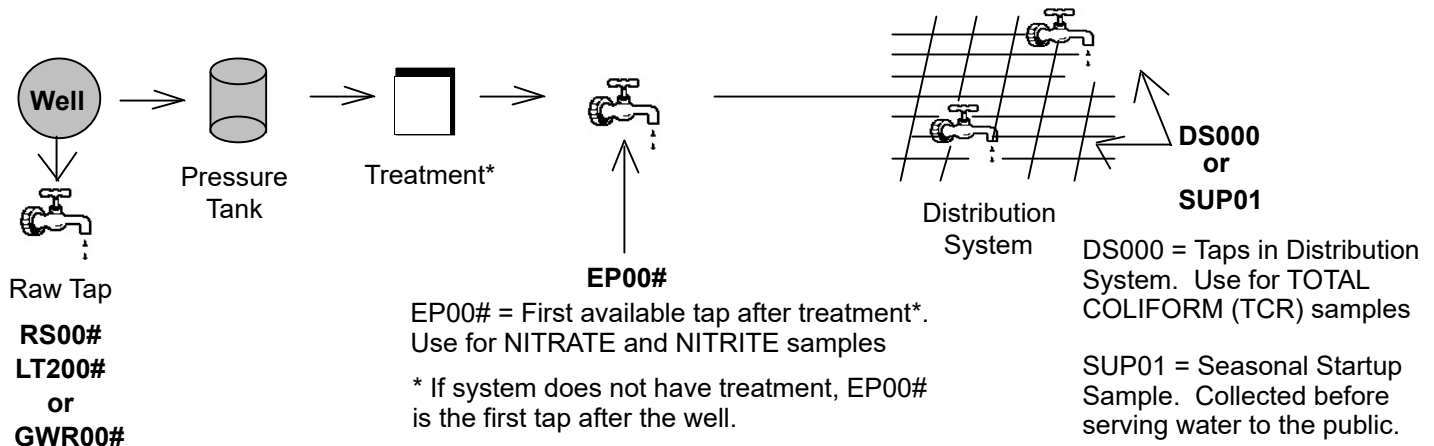

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1131812 STUDEBAKER'S COUNTRY RESTAURANT PWS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1153182	Facility Name: STUDEBAKER'S COUNTRY RESTAURANT
	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

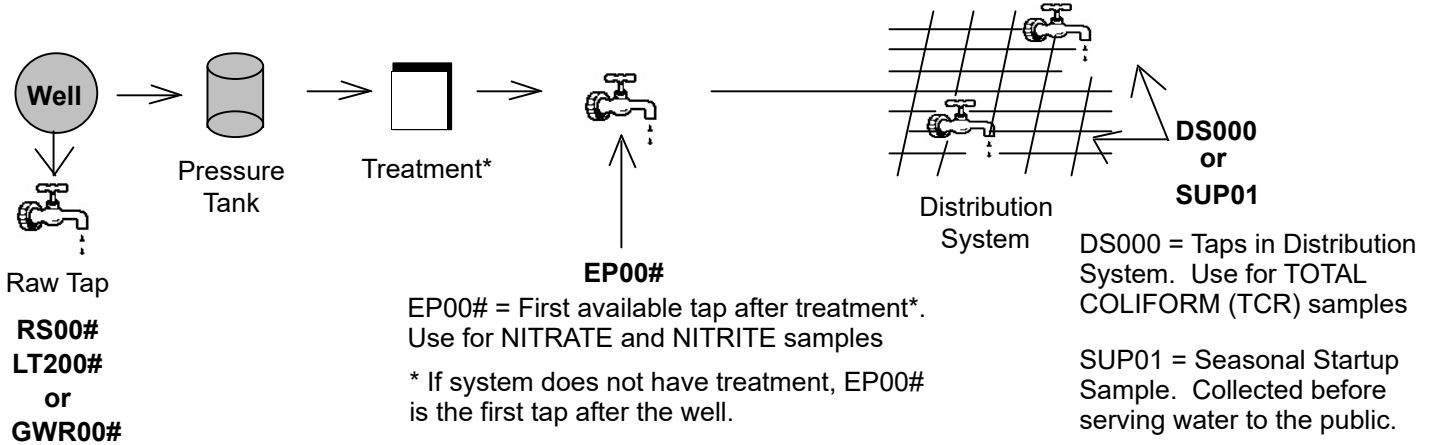

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1132212 GRAHAM HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1153183	Facility Name: GRAHAM HIGH SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
Chemicals
Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and	3/31/2026
	1 Sample(s) Required between	4/1/2026 and	6/30/2026
	1 Sample(s) Required between	7/1/2026 and	9/30/2026
	1 Sample(s) Required between	10/1/2026 and	12/31/2026

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:
**ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085**

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1132212 GRAHAM HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GRAHAM HIGH SCHOOL DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GRAHAM HIGH SCHOOL DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

Sampling Location	Facility ID: DS1	Facility Name: GRAHAM HIGH SCHOOL DISTRIBUTION
	SMP ID: DS201	TRAINING ROOM

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950
A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Location	Facility ID: DS1	Facility Name: GRAHAM HIGH SCHOOL DISTRIBUTION
	SMP ID: DS202	TEACHER'S LOUNGE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950
A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1132412 LAKELAND GOLF CLUB

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKELAND GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

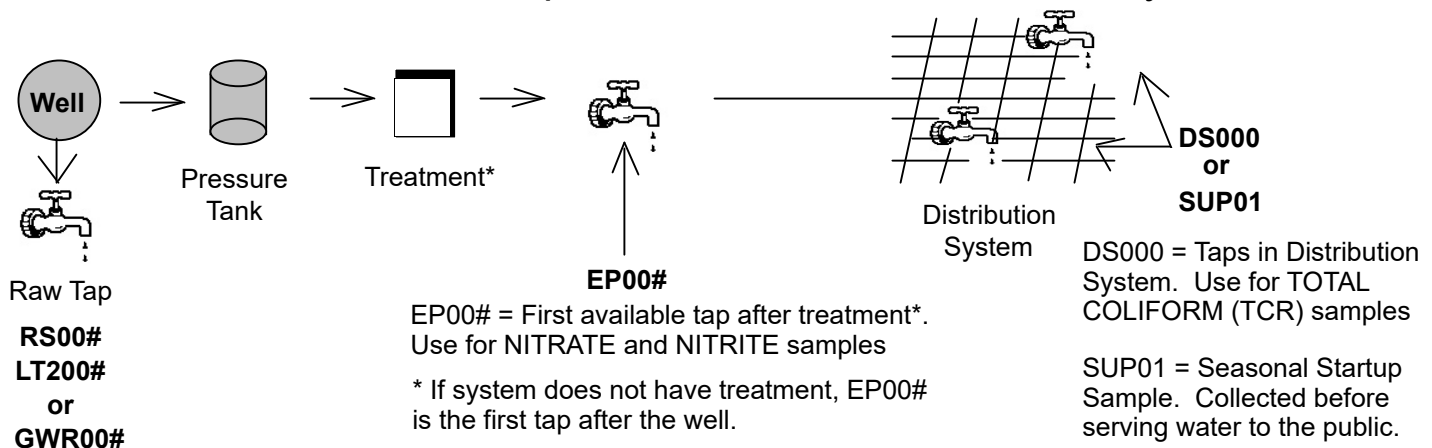

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1132412 LAKELAND GOLF CLUB

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153185 Facility Name: LAKELAND GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

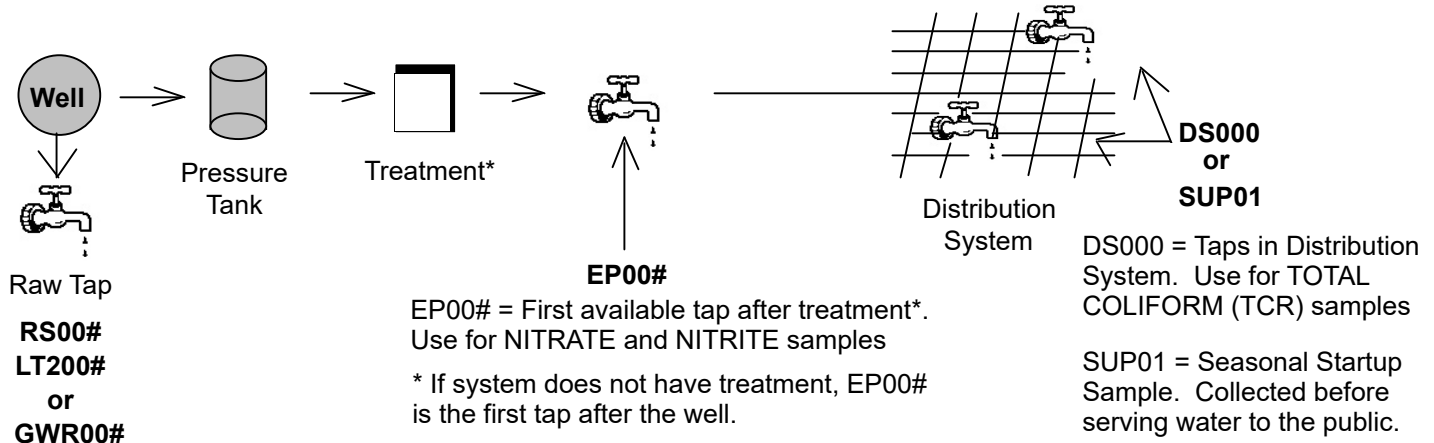

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133012 OHIO CAVERNS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: OHIO CAVERNS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

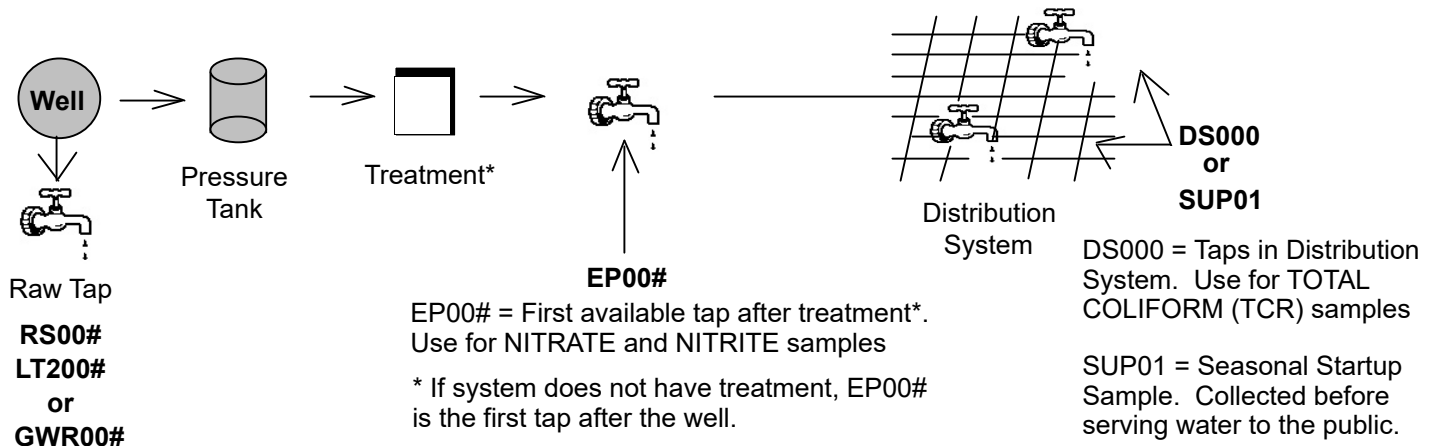

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133012 OHIO CAVERNS


 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: **1153188** Facility Name: **OHIO CAVERNS**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

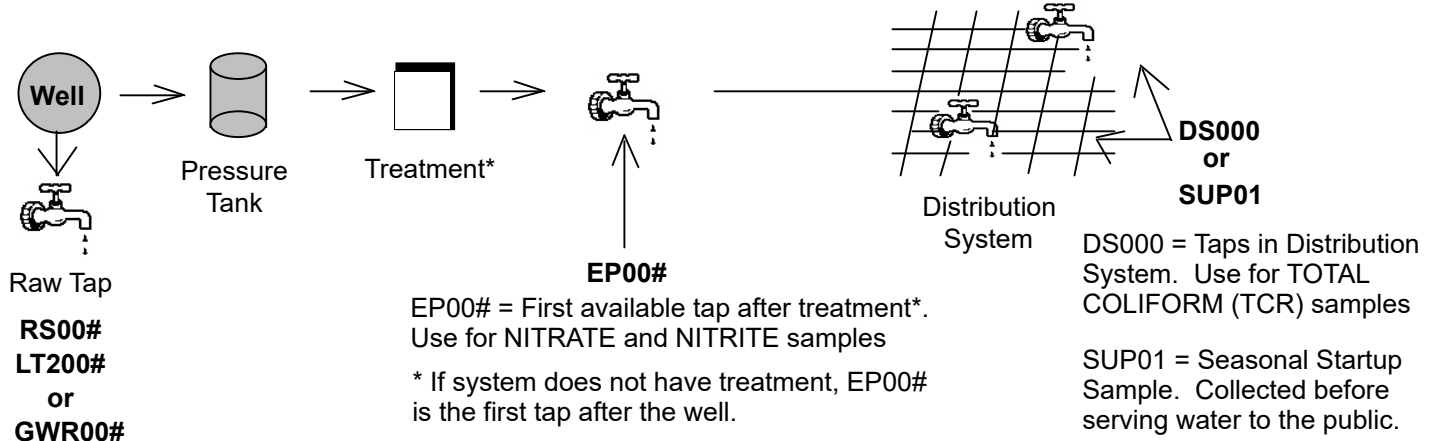

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133312 WOODLAND GOLF CLUB

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WOODLAND GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

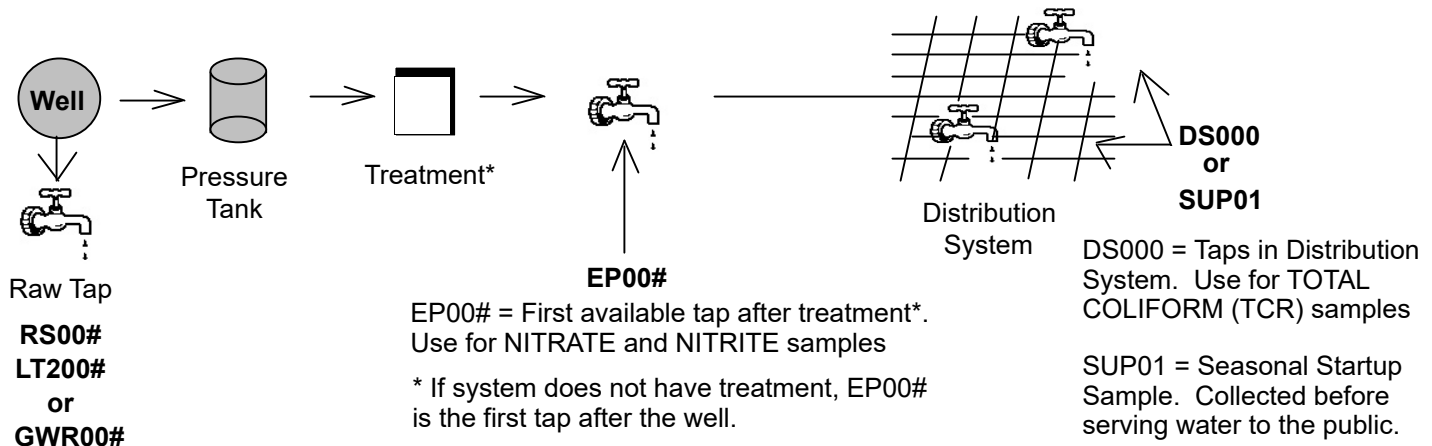

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133312 WOODLAND GOLF CLUB

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153189 Facility Name: **WOODLAND GOLF CLUB**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

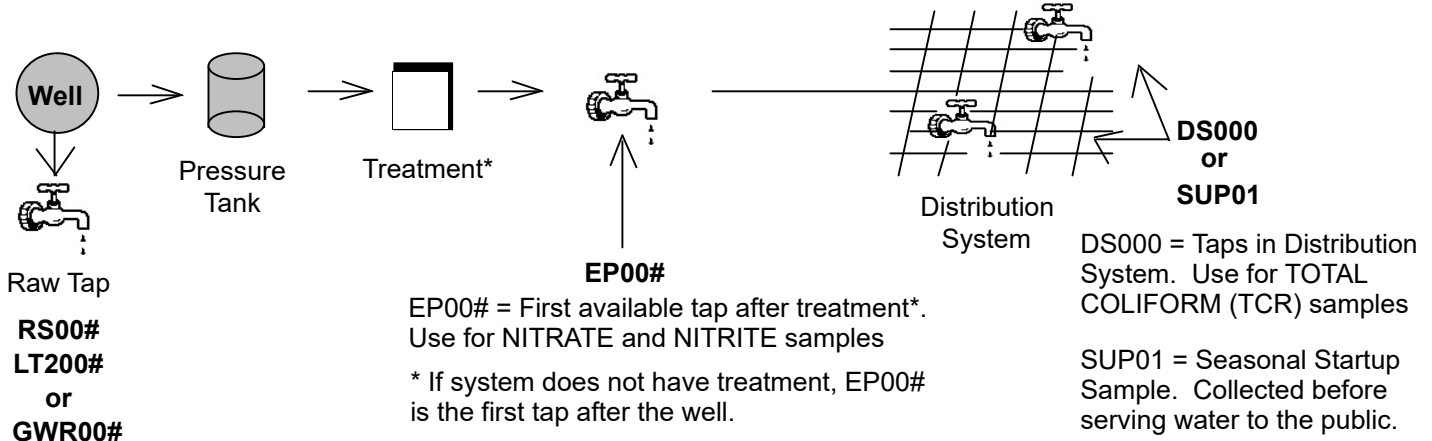

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133512 RITTENHOUSE RESORT

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: RITTENHOUSE RESORT DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

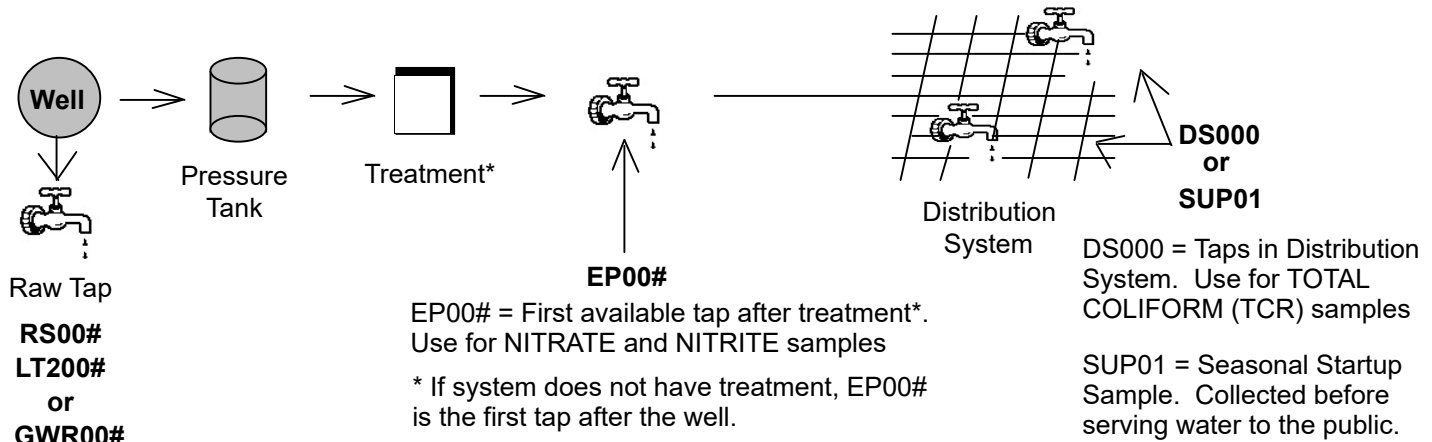

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133512 RITTENHOUSE RESORT

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 5/1 to 10/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RITTENHOUSE RESORT DISTRIBUTION
	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

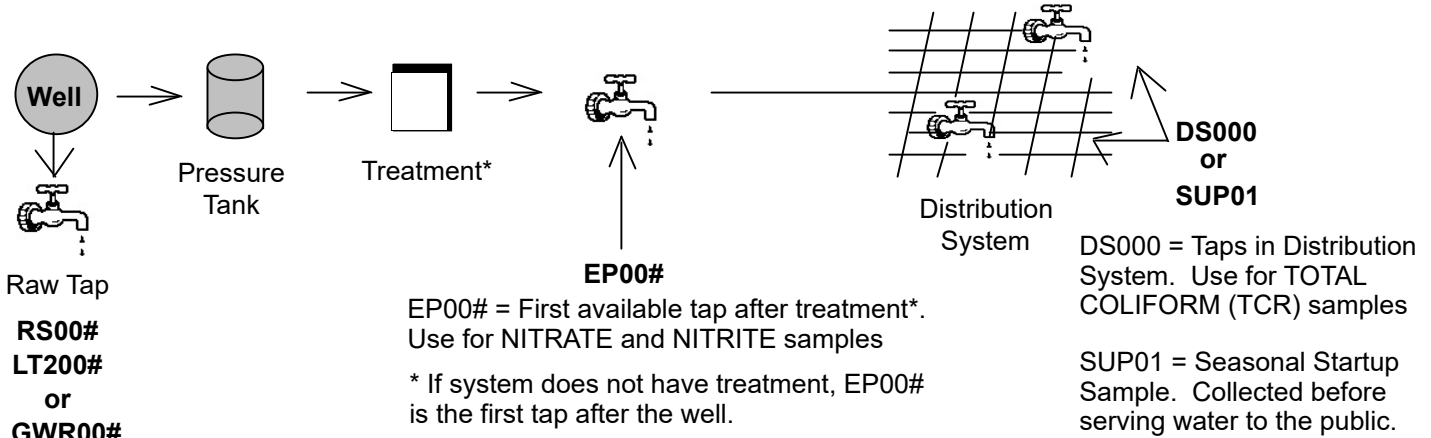

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133512 RITTENHOUSE RESORT

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 5/1 to 10/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153191 Facility Name: RITTENHOUSE RESORT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

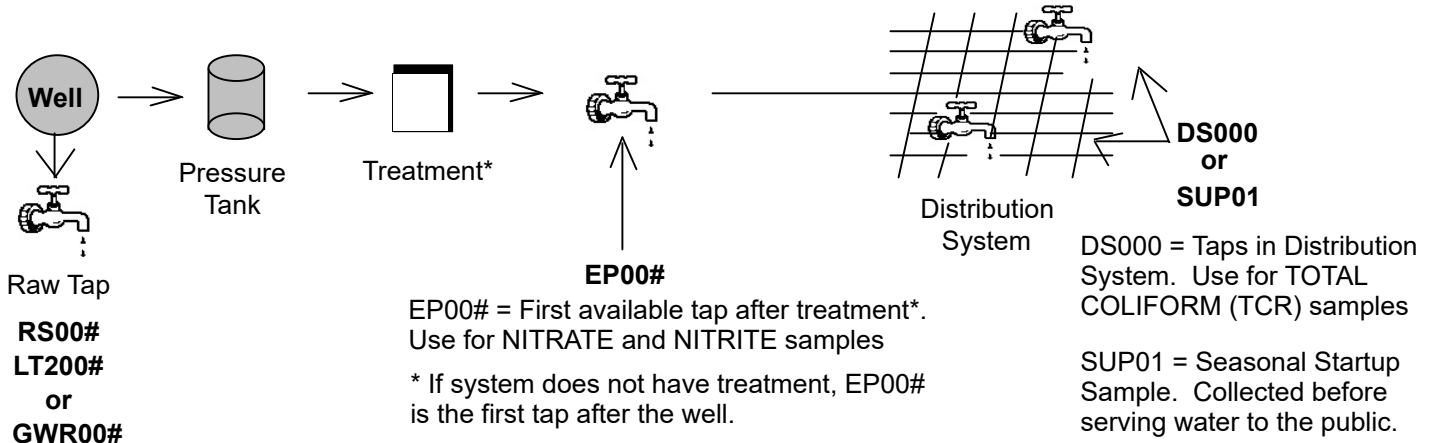

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133612 GAME TIME SPORTS CENTER

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: GAME TIME SPORTS CTR DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

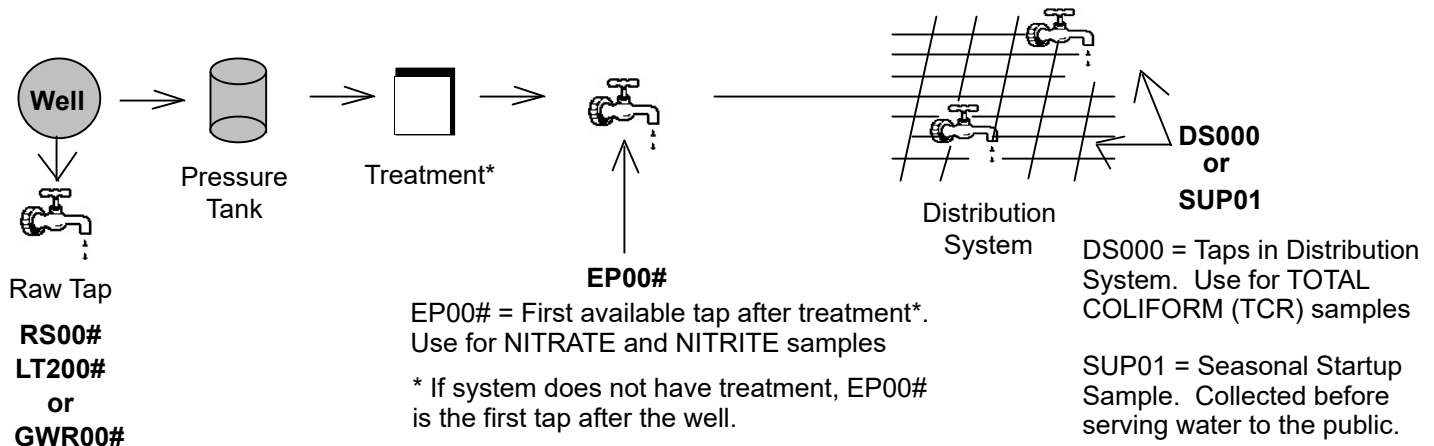

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133612 GAME TIME SPORTS CENTER

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153192 Facility Name: **GAME TIME SPORTS CTR STU 1**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2026 and 9/30/2026

Where to Collect Samples For a Small Public Water System

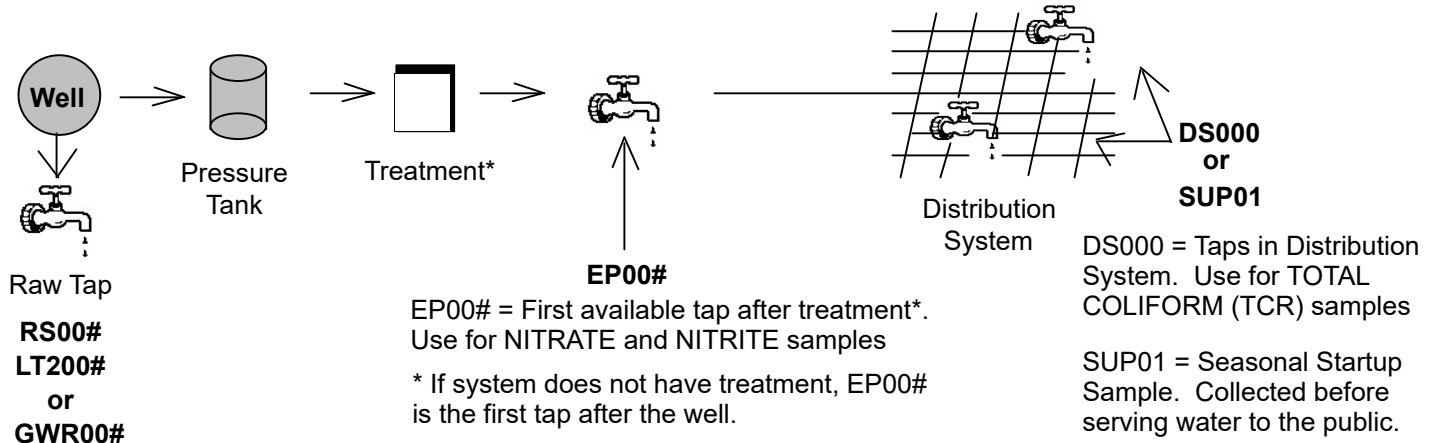

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133912 MICHAEL FARMS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 6/1 to 10/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MICHAEL FARMS DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

**** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.****

Where to Collect Samples For a Small Public Water System

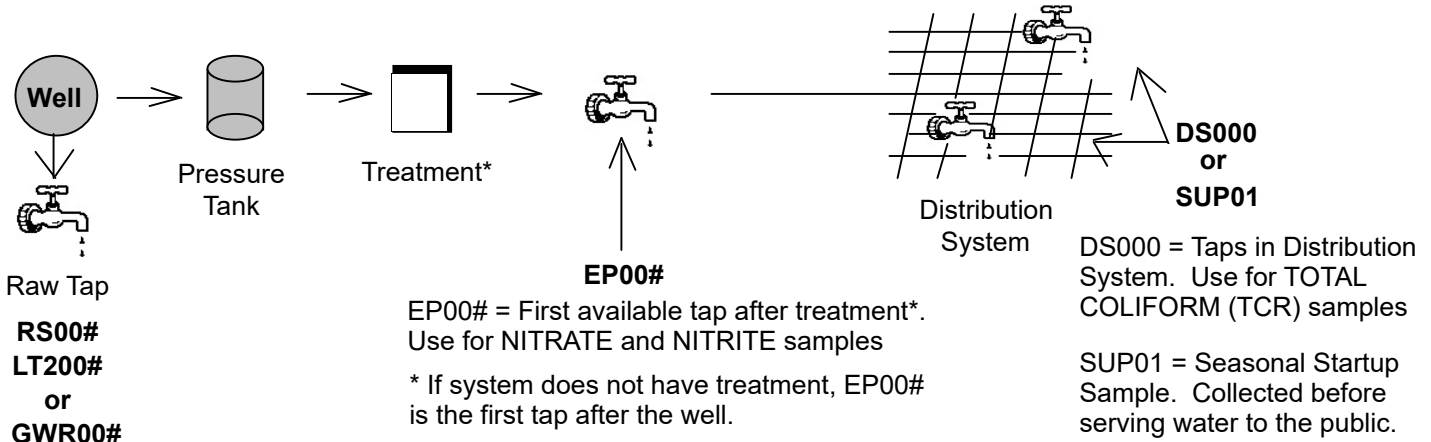

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133912 MICHAEL FARMS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 6/1 to 10/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: MICHAEL FARMS DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/10/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

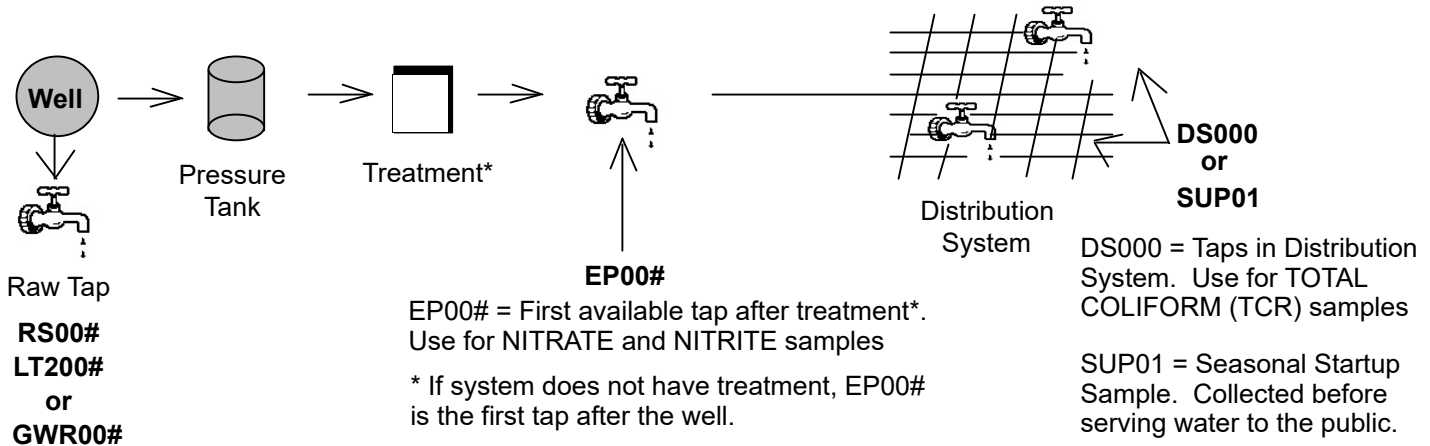

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1133912 MICHAEL FARMS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 6/1 to 10/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153195 Facility Name: MICHAEL FARMS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2026 and 9/30/2026

Where to Collect Samples For a Small Public Water System

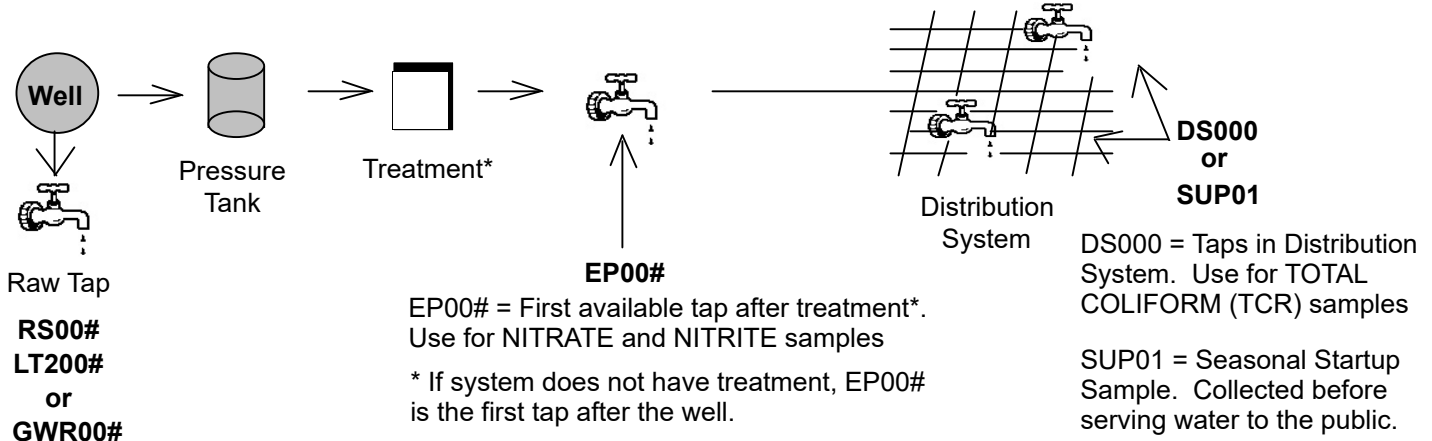

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1134012 WEST LIBERTY-SALEM SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1153196	Facility Name: WEST LIBERTY SALEM SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	10/1/2026 and	12/31/2026
----------------------------------	------------------------------	---------------	------------

OH1134012 WEST LIBERTY-SALEM SCHOOL

 System Type: Nontransient Noncommunity Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WEST LIBERTY-SALEM SCHOO DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026
	2 Sample(s) Required between 2/1/2026 and 2/28/2026
	2 Sample(s) Required between 3/1/2026 and 3/31/2026
	2 Sample(s) Required between 4/1/2026 and 4/30/2026
	2 Sample(s) Required between 5/1/2026 and 5/31/2026
	2 Sample(s) Required between 6/1/2026 and 6/30/2026
	2 Sample(s) Required between 7/1/2026 and 7/31/2026
	2 Sample(s) Required between 8/1/2026 and 8/31/2026
	2 Sample(s) Required between 9/1/2026 and 9/30/2026
	2 Sample(s) Required between 10/1/2026 and 10/31/2026
	2 Sample(s) Required between 11/1/2026 and 11/30/2026
	2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026
	2 Sample(s) Required between 2/1/2026 and 2/28/2026
	2 Sample(s) Required between 3/1/2026 and 3/31/2026
	2 Sample(s) Required between 4/1/2026 and 4/30/2026
	2 Sample(s) Required between 5/1/2026 and 5/31/2026
	2 Sample(s) Required between 6/1/2026 and 6/30/2026
	2 Sample(s) Required between 7/1/2026 and 7/31/2026
	2 Sample(s) Required between 8/1/2026 and 8/31/2026
	2 Sample(s) Required between 9/1/2026 and 9/30/2026
	2 Sample(s) Required between 10/1/2026 and 10/31/2026
	2 Sample(s) Required between 11/1/2026 and 11/30/2026
	2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: WEST LIBERTY-SALEM SCHOO DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1134012 WEST LIBERTY-SALEM SCHOOL

 System Type: Nontransient Noncommunity Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WEST LIBERTY-SALEM SCHOO DISTRIBUTION
	SMP ID: DS201	HS DRINKING FOUNTAIN

Chemicals
Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950
A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Location	Facility ID: DS1	Facility Name: WEST LIBERTY-SALEM SCHOO DISTRIBUTION
	SMP ID: DS202	JR HIGH MENS RR

Chemicals
Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950
A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

OH1134112 PARKER TRUTEC INDUSTRIES

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1153197	Facility Name: PARKER TRUTEC INDUSTRIES INC
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1134112 PARKER TRUTEC INDUSTRIES

 System Type: Nontransient Noncommunity Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: PARKER TRUTEC INDUSTRIES DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: PARKER TRUTEC INDUSTRIES DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1134412 FORTY-ONE PWS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FORTY-ONE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

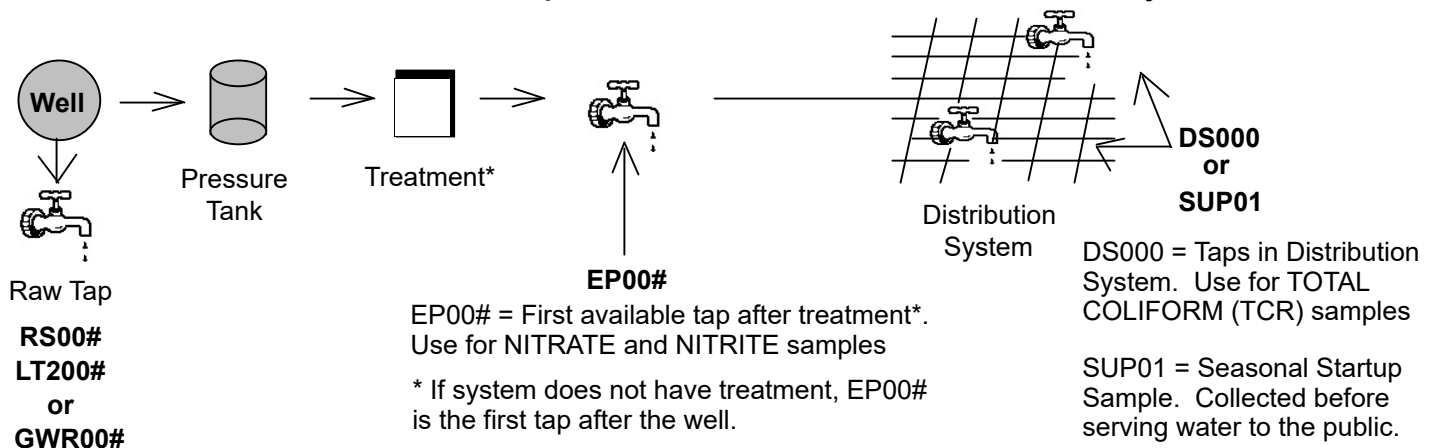

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1134412 FORTY-ONE PWS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153200 Facility Name: FORTY-ONE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

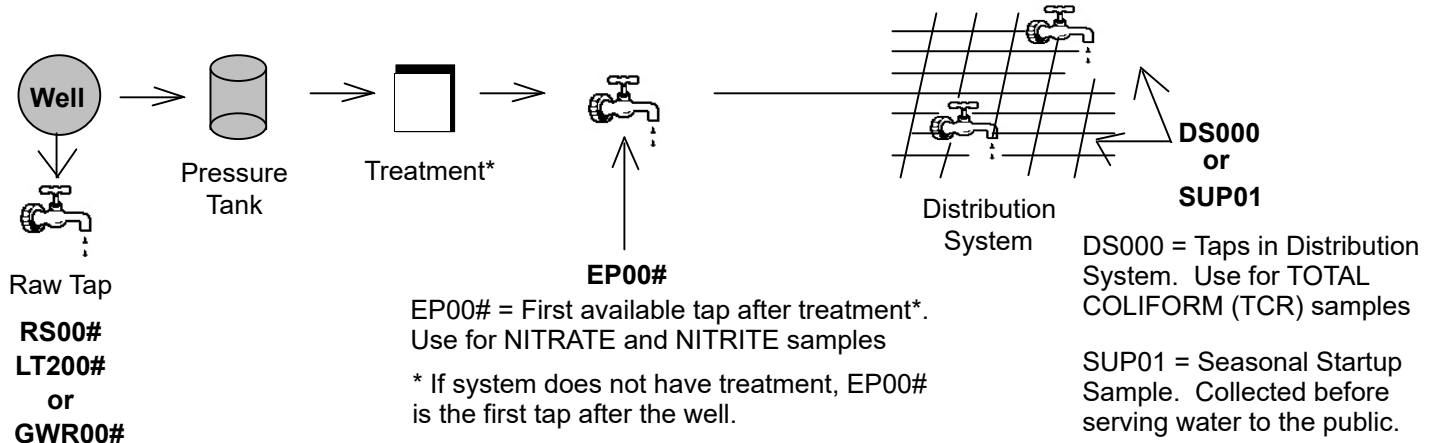

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1134912 TRIAD MIDDLE SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1153205	Facility Name: TRIAD MIDDLE SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<u>Sample for all the analytes listed below:</u>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<u>Sample for all the analytes listed below:</u>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and 5/31/2026

OH1134912 TRIAD MIDDLE SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: TRIAD MIDDLE SCHOOL DISTRIBUTION
	SMP ID: DS000	

Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026	and 3/31/2026
	1 Sample(s) Required between	4/1/2026	and 6/30/2026
	1 Sample(s) Required between	7/1/2026	and 9/30/2026
	1 Sample(s) Required between	10/1/2026	and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: TRIAD MIDDLE SCHOOL DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between	1/1/2026	and 6/30/2026
	20 Sample(s) Required between	7/1/2026	and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1135112 KINGDOM HALL JEHOVAH WITNESSES OF URBANA

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: KINGDOM HALL JEHOVAH WIT DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

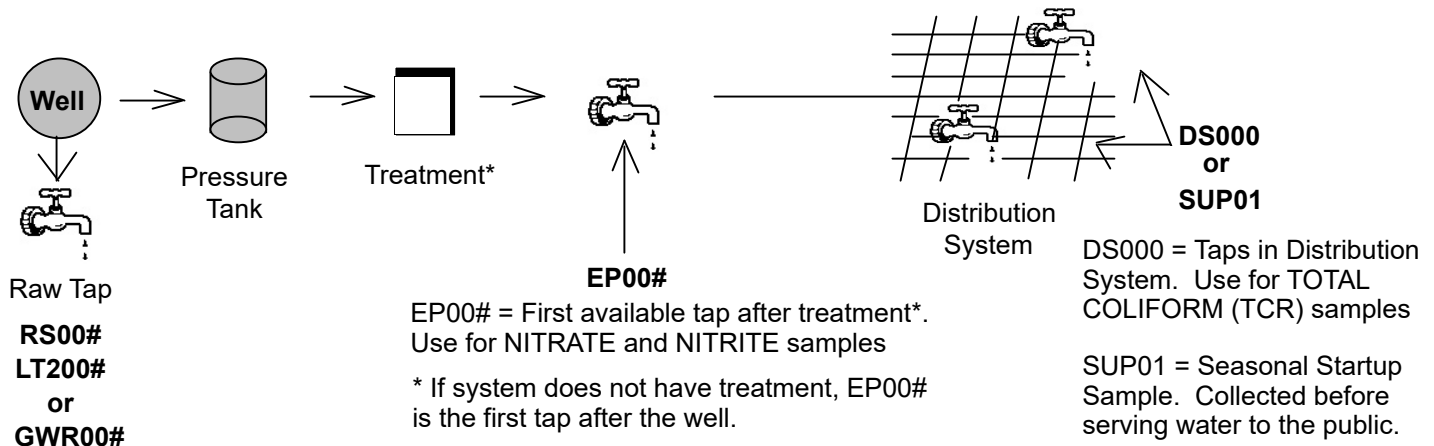

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1135112 KINGDOM HALL JEHOVAH WITNESSES OF URBANA

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153206 Facility Name: **KINGDOM HALL JEHOVAH WITNESSES**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

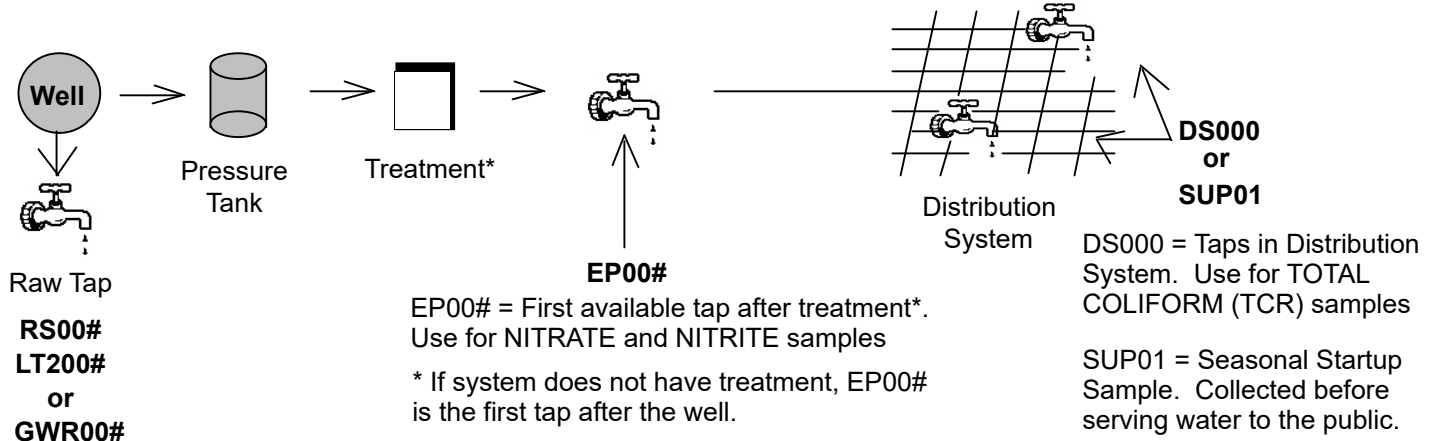

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1135312 SAINT PARIS CHURCH OF NAZARENE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: ST PARIS CH OF NAZARENE DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

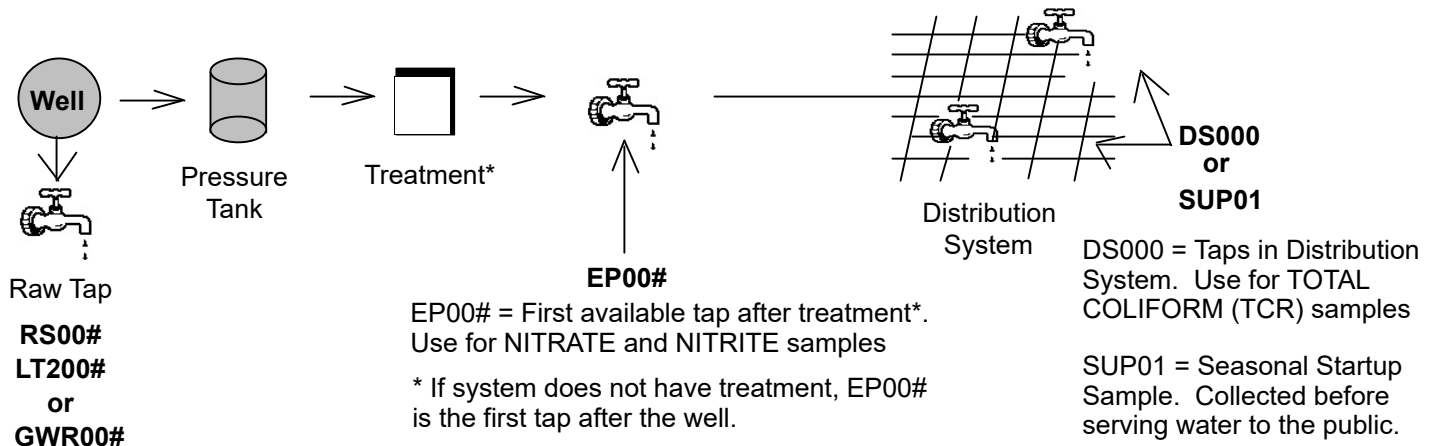

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1135312 SAINT PARIS CHURCH OF NAZARENE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1153207 Facility Name: SAINT PARIS CH OF NAZARENE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

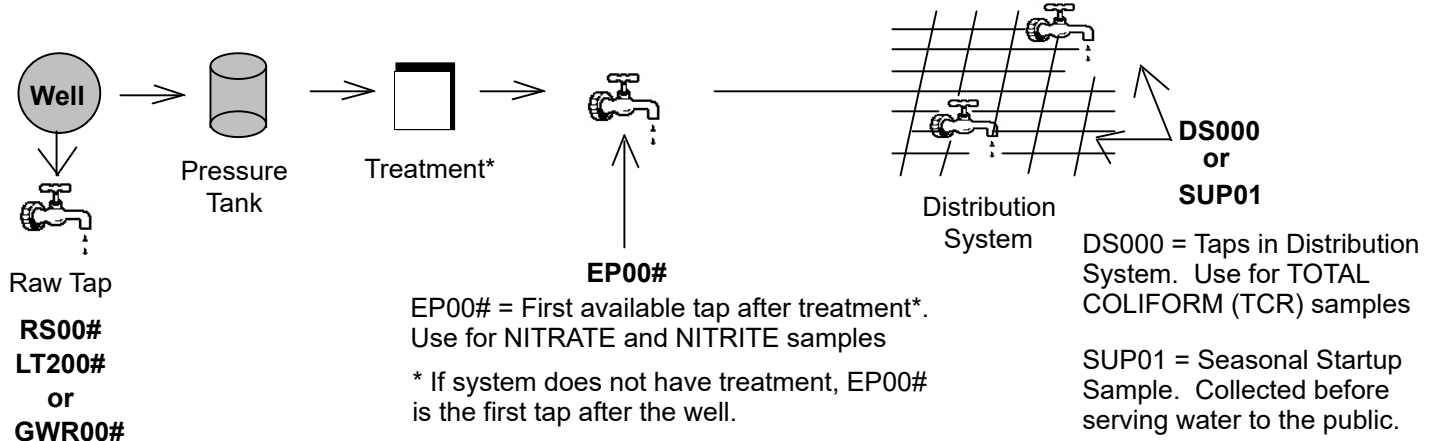

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1135712 VICTORY CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1153210	Facility Name: GRACE BAPTIST ACADEMY
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1135712 VICTORY CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GRACE BAPTIST ACADEMY DISTRIBUTION
	SMP ID: DS000	

Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026	and 3/31/2026
	1 Sample(s) Required between	4/1/2026	and 6/30/2026
	1 Sample(s) Required between	7/1/2026	and 9/30/2026
	1 Sample(s) Required between	10/1/2026	and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: GRACE BAPTIST ACADEMY DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026	and 9/30/2026
-------------------------------	------------------------------	----------	---------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1136112 WESLEY CHAPEL BAPTIST CHURCH PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: WESLEY CHAPEL BAPTIST CHURCH DISTRIBUTIO
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

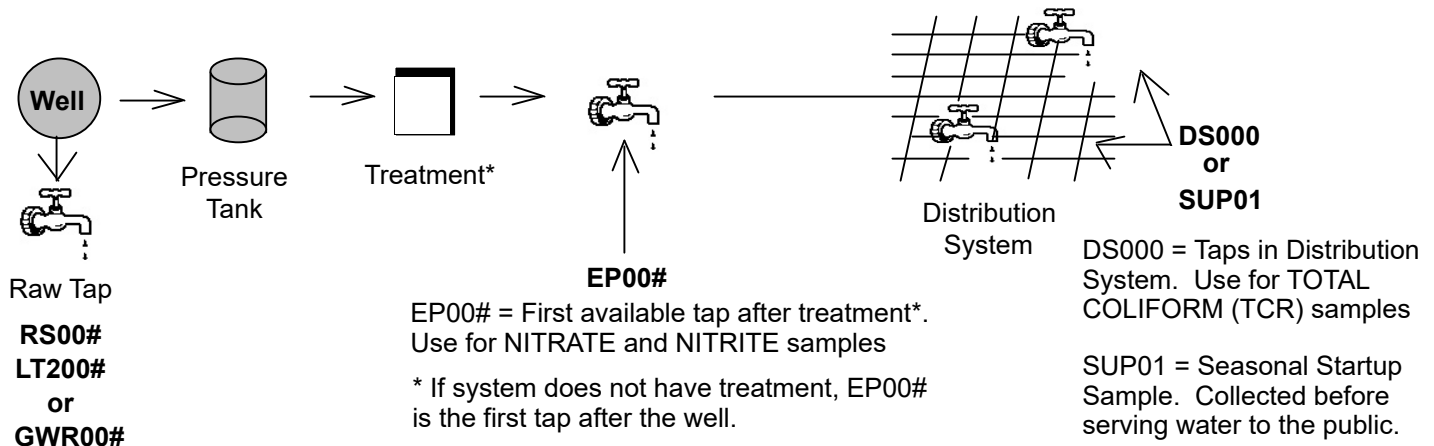

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136112 WESLEY CHAPEL BAPTIST CHURCH PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1161168 Facility Name: WESLEY CHAPEL BAPTIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

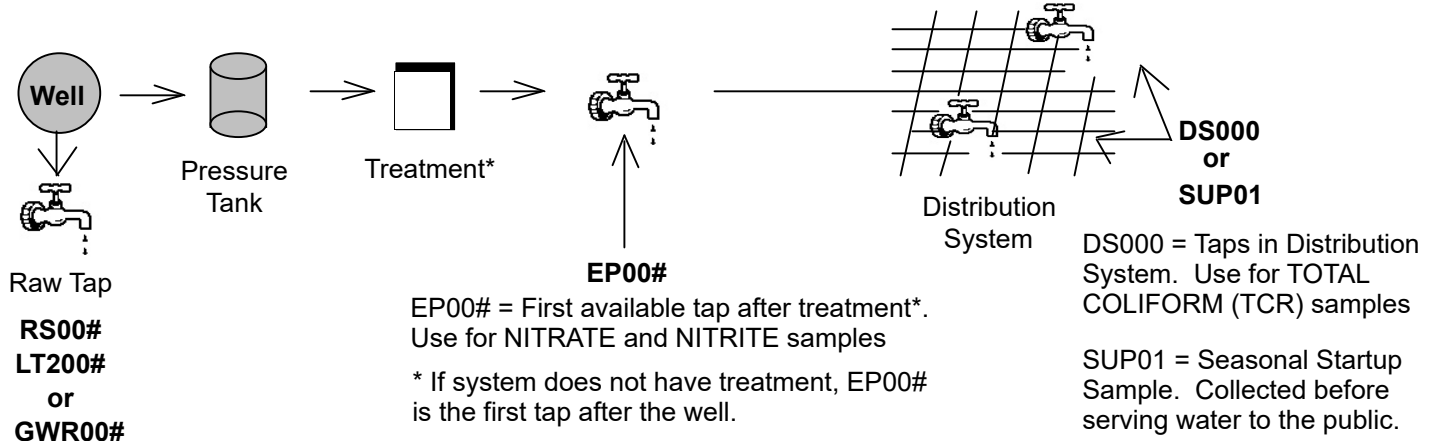

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136212 TRIAD HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1161278	Facility Name: TRIAD HIGH SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals
Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and	3/31/2026
	1 Sample(s) Required between	4/1/2026 and	6/30/2026
	1 Sample(s) Required between	7/1/2026 and	9/30/2026
	1 Sample(s) Required between	10/1/2026 and	12/31/2026

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024
 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1136212 TRIAD HIGH SCHOOL

 System Type: Nontransient Noncommunity Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: TRIAD HIGH SCHOOL-NEW DISTRIBUTION
	SMP ID: DS000	

Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: TRIAD HIGH SCHOOL-NEW DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026 and 9/30/2026
-------------------------------	------------------------------	------------------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1136412 LITTLE STRENGTH CHRISTIAN

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1161349	Facility Name: LITTLE STRENGTH CHRISTIAN
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
Chemicals
Monitoring Requirements

INORGANICS	1 Sample(s) Required between	1/1/2026 and	5/31/2026
------------	------------------------------	--------------	-----------

Sample for all the analytes listed below:
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------	------------------------------	--------------	-----------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and	5/31/2026
---	------------------------------	--------------	-----------

Sample for all the analytes listed below:
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and	5/31/2026
----------------------------------	------------------------------	--------------	-----------

OH1136412 LITTLE STRENGTH CHRISTIAN

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LITTLE STRENGTH CHRISTIAN
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: LITTLE STRENGTH CHRISTIAN
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH1136512 GOSHEN AERIE EAGLES 3974 PWS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: GOSHEN AERIE EAGLES 3974 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

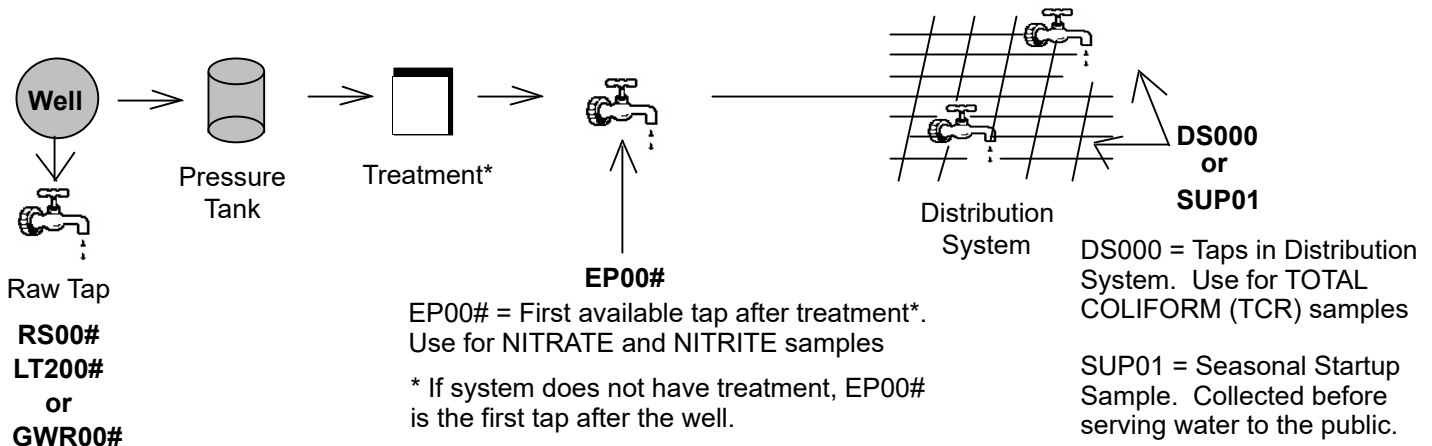

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136512 GOSHEN AERIE EAGLES 3974 PWS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1161692 Facility Name: GOSHEN AERIE EAGLES 3974

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

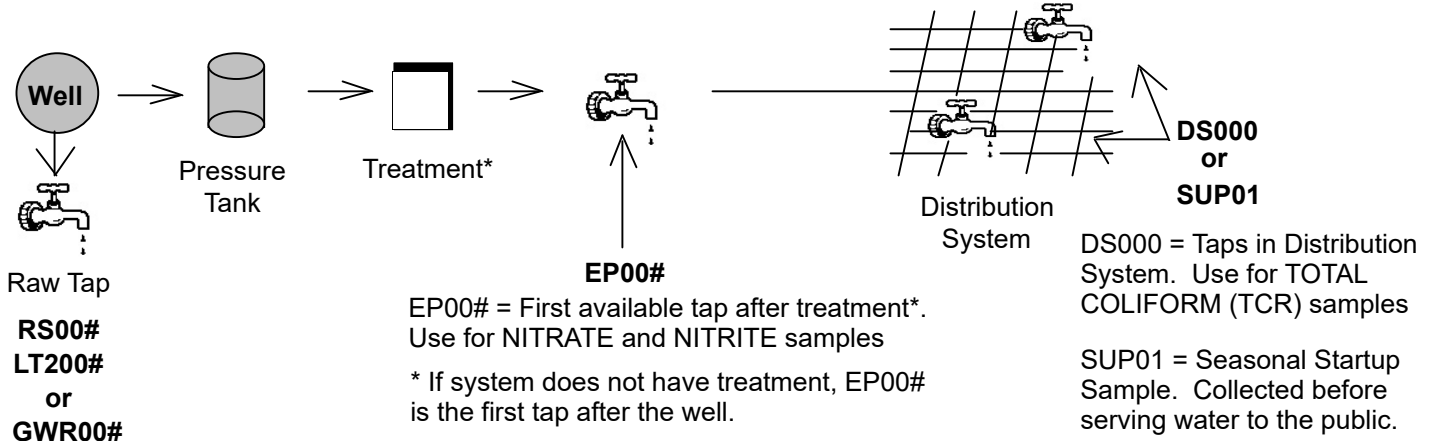

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136612 LIGHTHOUSE TABERNACLE CH-CHAMPAIGN PWS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LIGHTHOUSE TABERNACLE CHURCH DISTRIBUTIO
	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

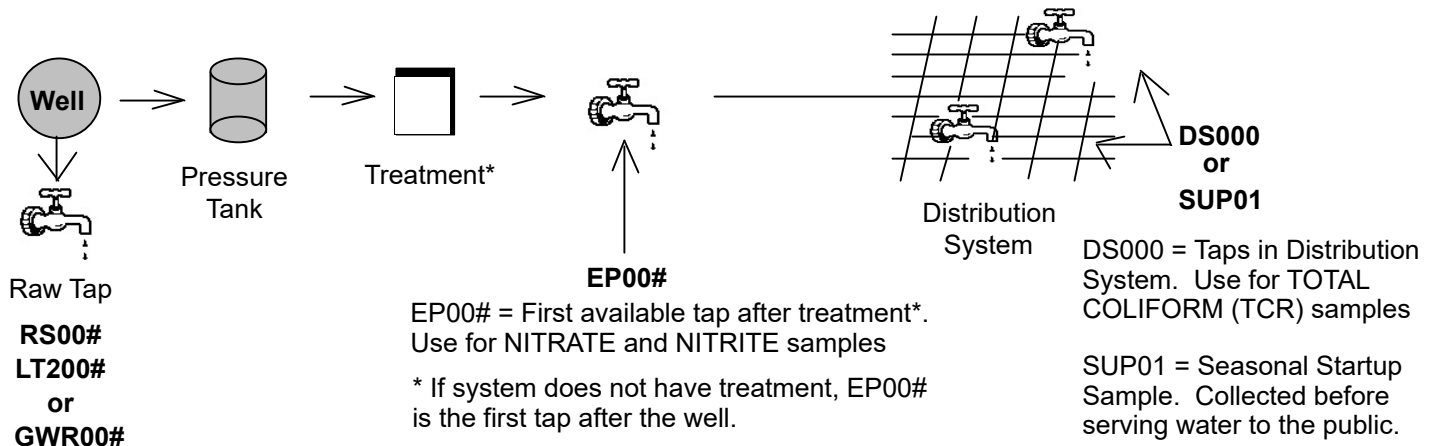

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136612 LIGHTHOUSE TABERNACLE CH-CHAMPAIGN PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1162104 Facility Name: LIGHTHOUSE TABERNACLE CHURCH-CHAMPAIGN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

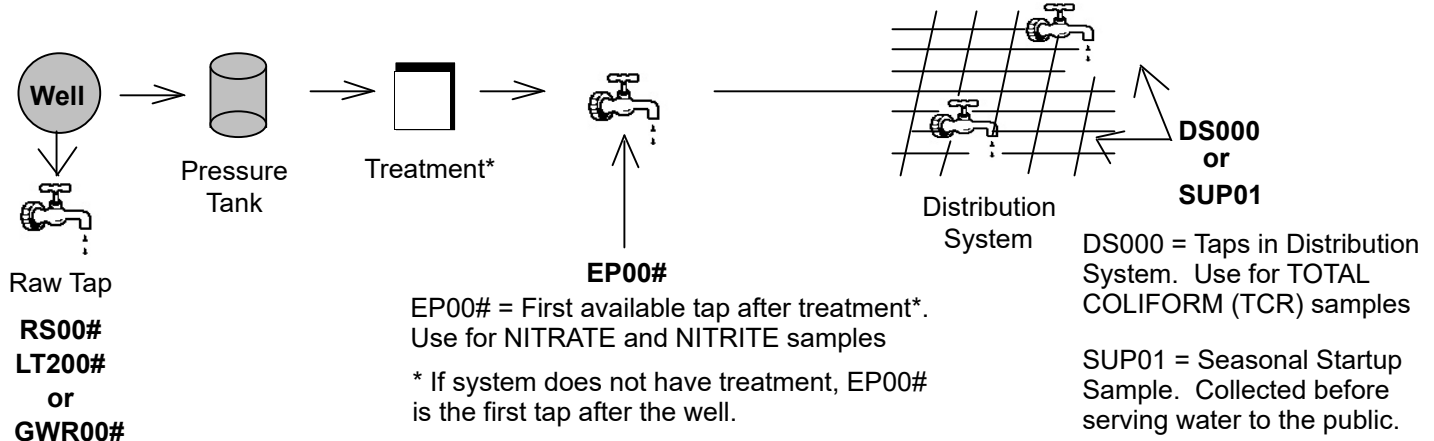

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136712 CEDAR BOG NATURE PRESERVE EDUC CENTER

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CEDAR BOG NATURE PRESERVE EDUC CTR DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

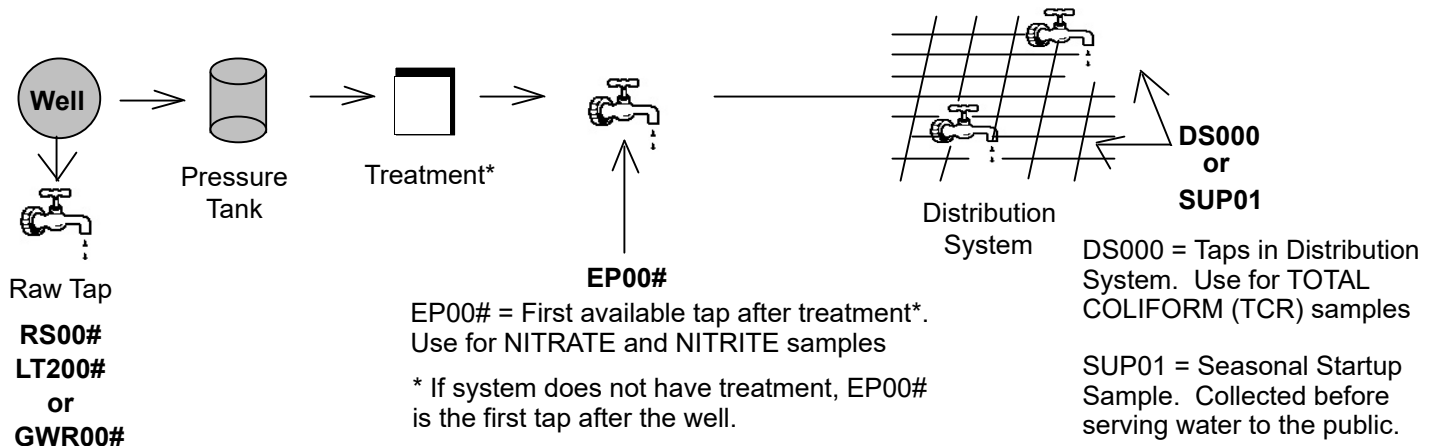

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1136712 CEDAR BOG NATURE PRESERVE EDUC CENTER

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1162146 Facility Name: CEDAR BOG NATURE PRESERVE EDUCATION CTR
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

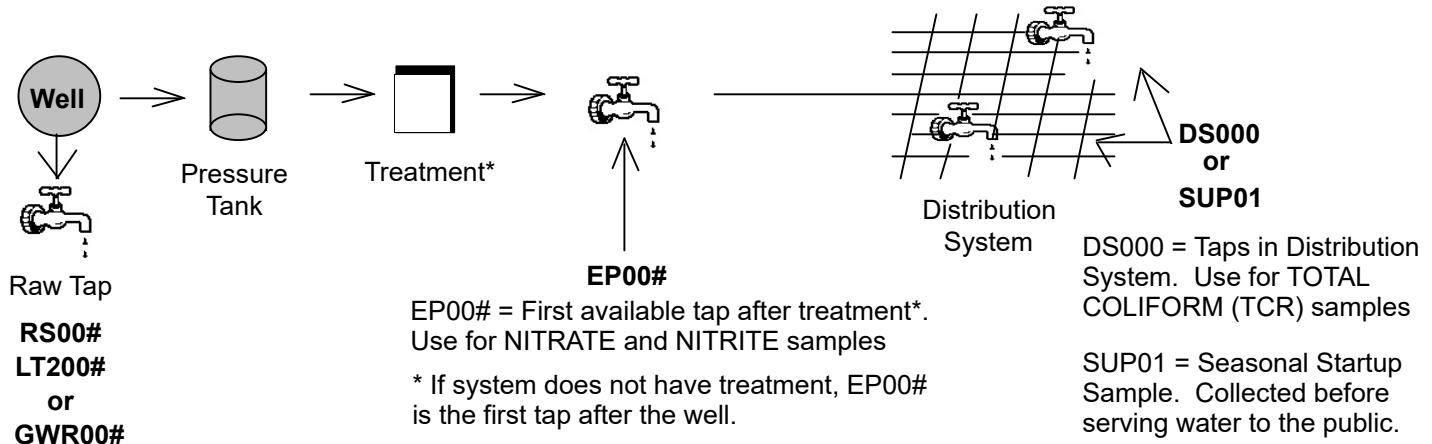

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137012 KISER LAKE MARATHON

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KISER LAKE MARATHON DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

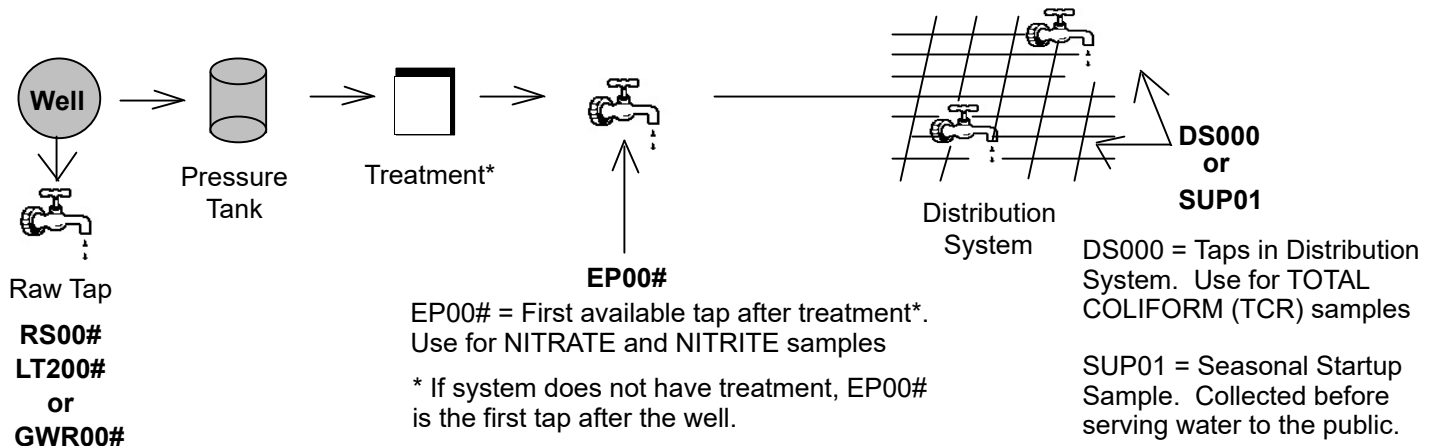

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137012 KISER LAKE MARATHON

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1162507 Facility Name: **KISER LAKE MARATHON**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

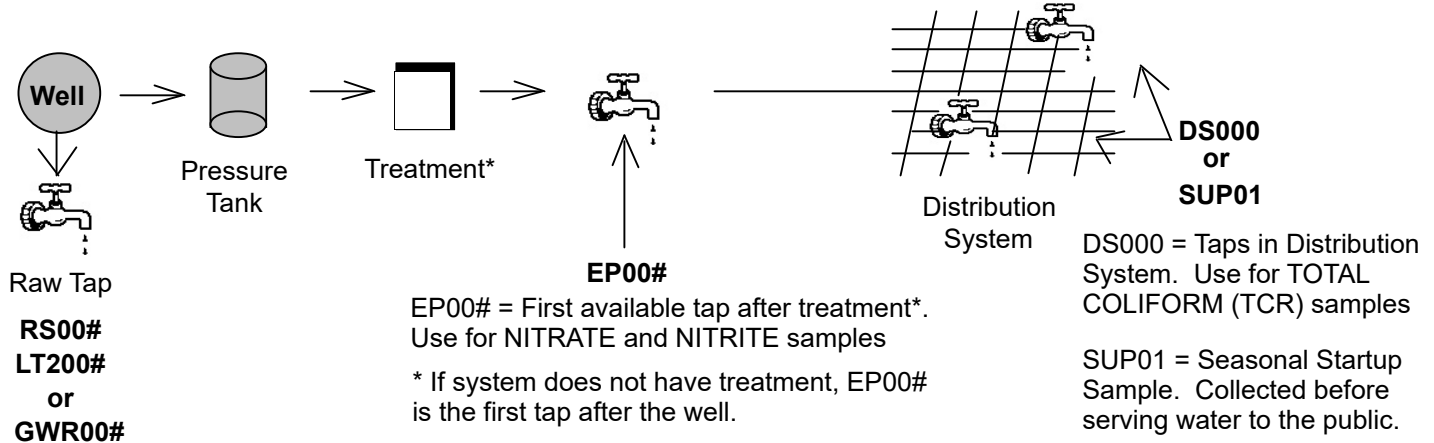

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137113 PARKER TRUTEC WEST PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1162509	Facility Name: PARKER TRUTEC WEST
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026

OH1137113 PARKER TRUTEC WEST PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000**
Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026	and	3/31/2026
	1 Sample(s) Required between	4/1/2026	and	6/30/2026
	1 Sample(s) Required between	7/1/2026	and	9/30/2026
	1 Sample(s) Required between	10/1/2026	and	12/31/2026

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**
Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026	and	9/30/2026
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1137114 DOLLAR GENERAL #18442 - ST. PARIS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

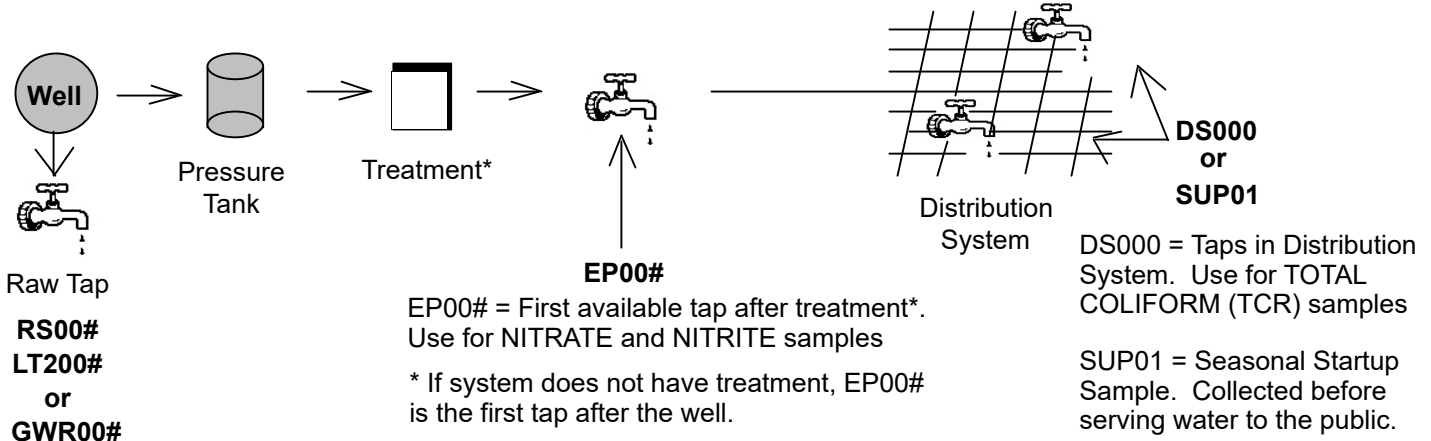

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137114 DOLLAR GENERAL #18442 - ST. PARIS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1162510 Facility Name: DOLLAR GENERAL - ST. PARIS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

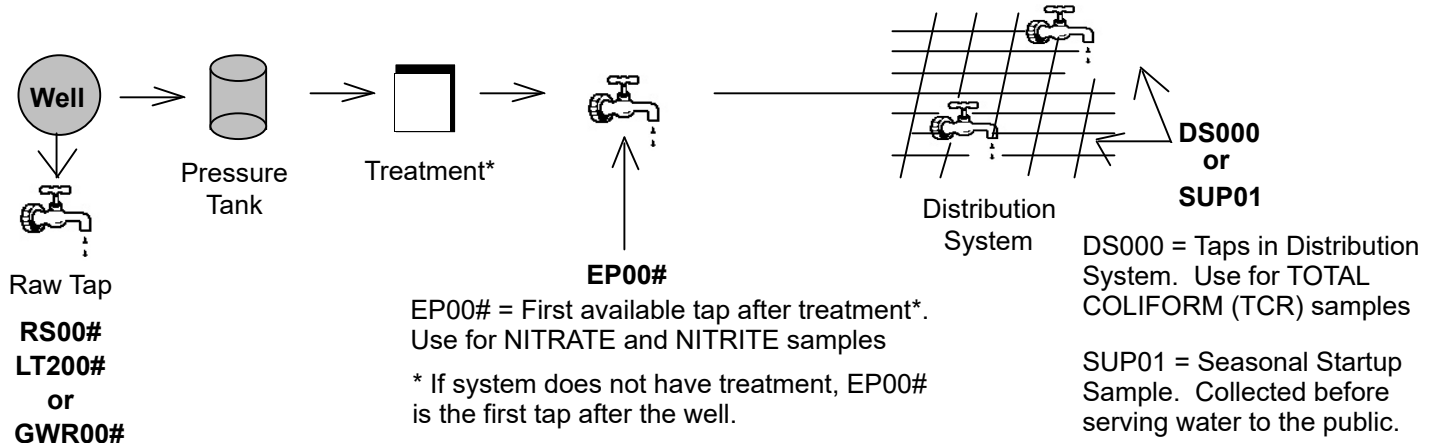

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137115 DRAGONFLY VINEYARD AND WINE CELLAR PWS

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DISTRIBUTION
Location SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

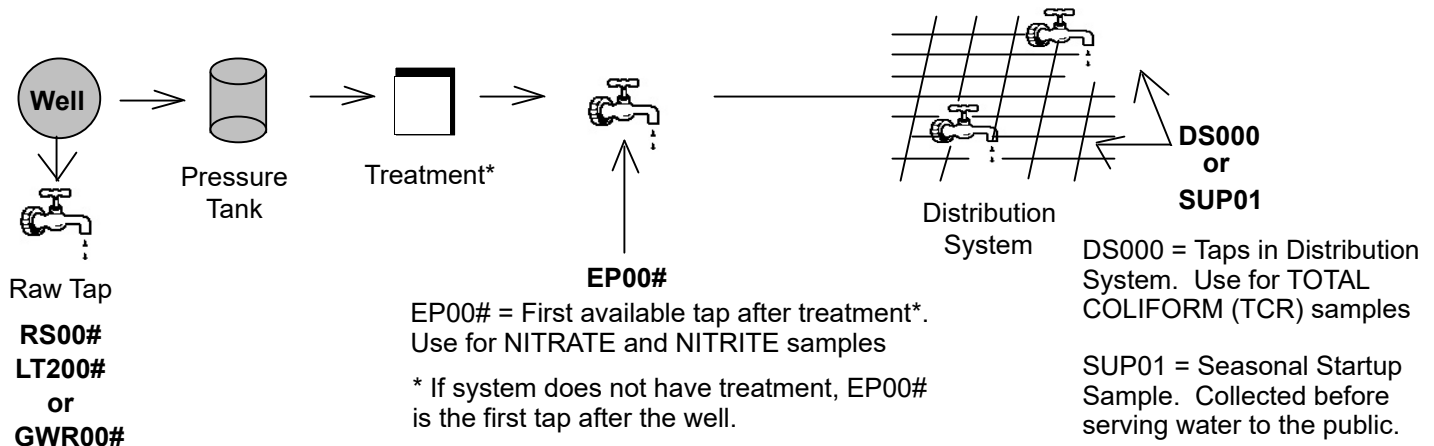

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137115 DRAGONFLY VINEYARD AND WINE CELLAR PWS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1162511 Facility Name: **DRAGONFLY VINEYARD AND WINE CELLAR PLANT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

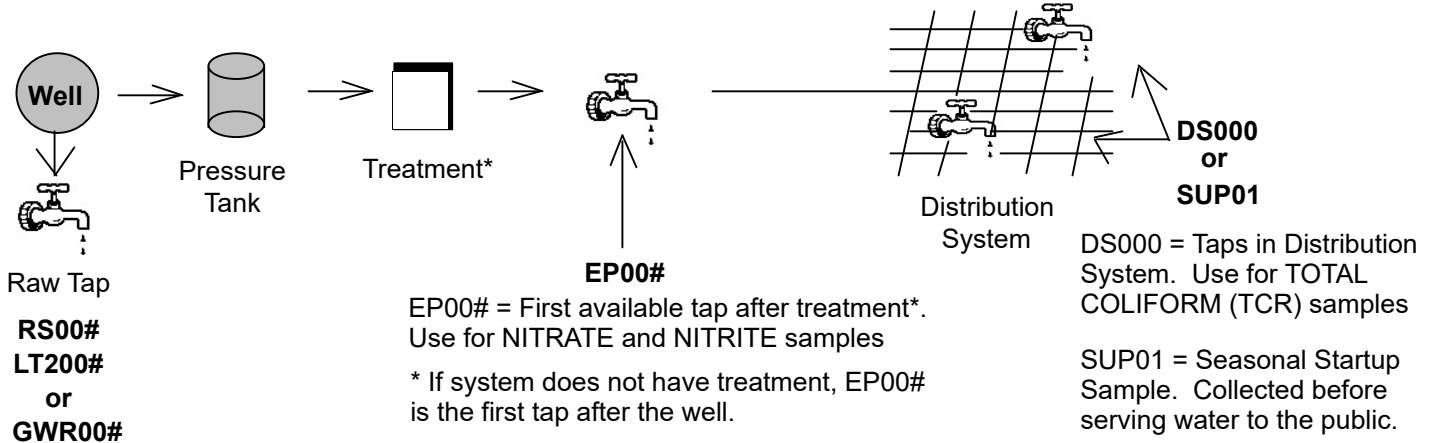

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137116 B, PIZZA PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: DS1 Facility Name: B, PIZZA DISTRIBUTION
Location SMP ID: DS000 Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

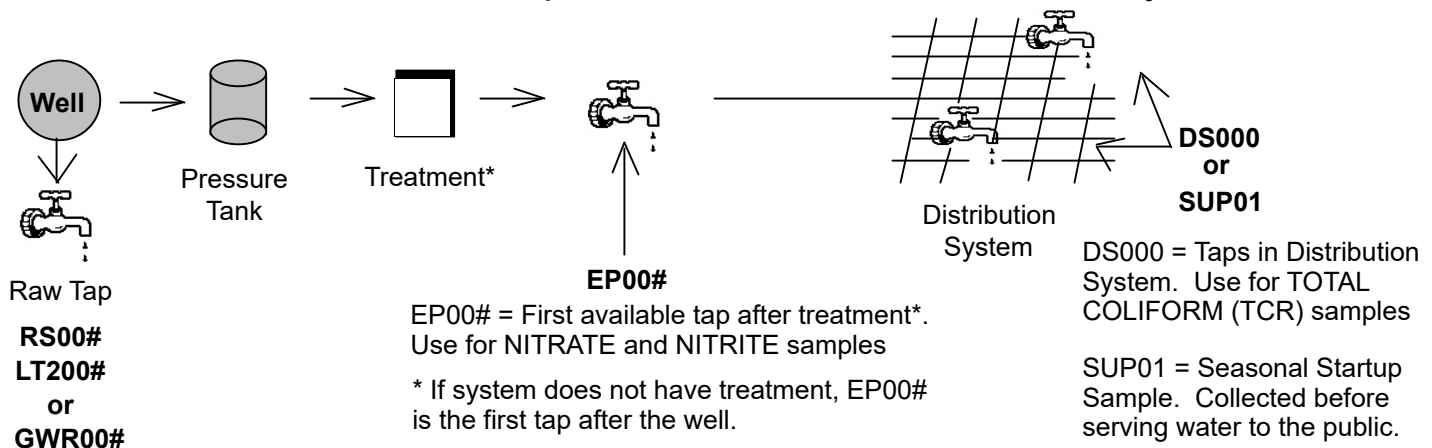

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137116 B, PIZZA PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1162512 Facility Name: **B, PIZZA PLANT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
-----------	-------------------------

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

Where to Collect Samples For a Small Public Water System

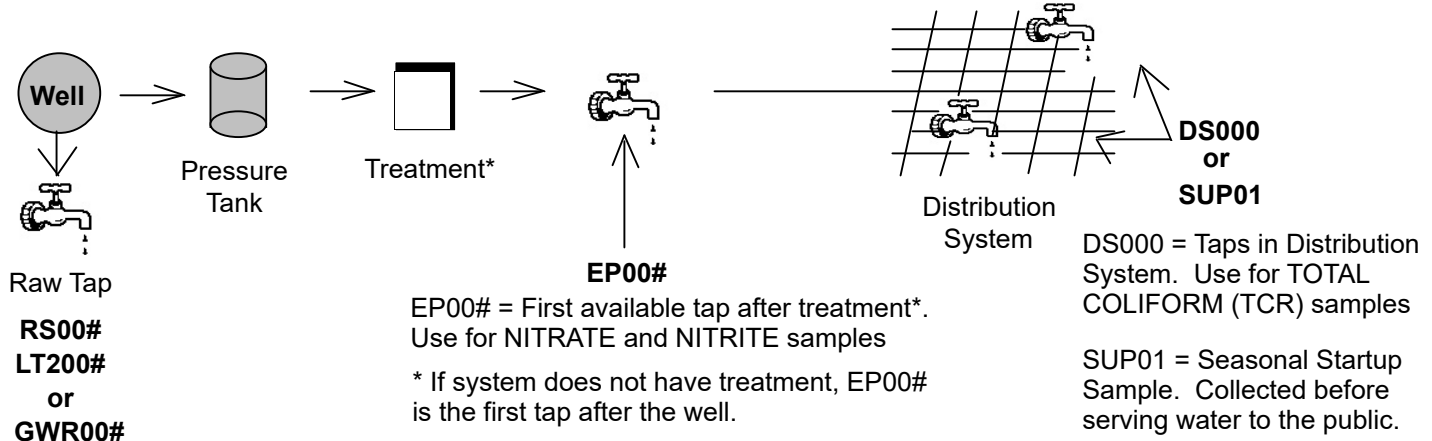

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137117 OLD SOULS FARM

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1162513	Facility Name: OLD SOULS FARM PLANT
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

OH1137117 OLD SOULS FARM

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1162514	Facility Name: OLD SOULS PLANT 2
	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
Chemicals
Monitoring Requirements

INORGANICS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

 VOLATILE ORGANIC CHEMICALS (VOC)

1 Sample(s) Required between	1/1/2026 and	3/31/2026
1 Sample(s) Required between	4/1/2026 and	6/30/2026
1 Sample(s) Required between	7/1/2026 and	9/30/2026
1 Sample(s) Required between	10/1/2026 and	12/31/2026

OH1137117 OLD SOULS FARM

 System Type: Nontransient Noncommunity Source: Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
DISTRIBUTION MONITORING SCHEDULE
Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000**
Chemicals
Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	7/1/2026	and 9/30/2026
	1 Sample(s) Required between	10/1/2026	and 12/31/2026

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**
Chemicals
Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026	and 9/30/2026
-------------------------------	------------------------------	----------	---------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

OH1137118 ODNR KISER LAKE STATE PARK-11

 System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DISTRIBUTION
Location SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

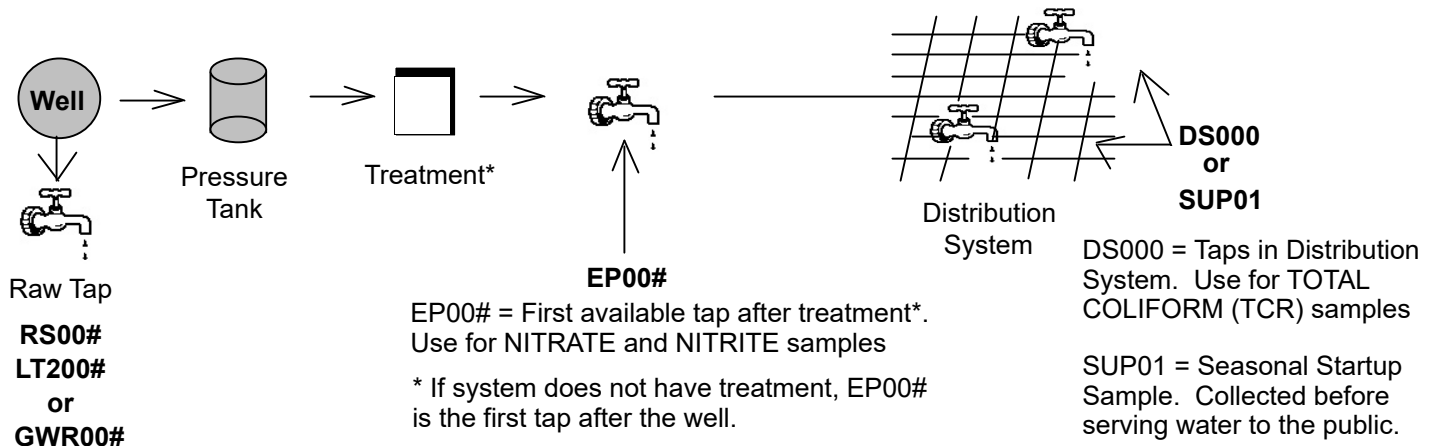

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137118 ODNR KISER LAKE STATE PARK-11

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System
THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378
ENTRY POINT MONITORING SCHEDULE
Sampling Facility ID: 1162515 Facility Name: ODNR KISER LAKE-11 PLANT
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

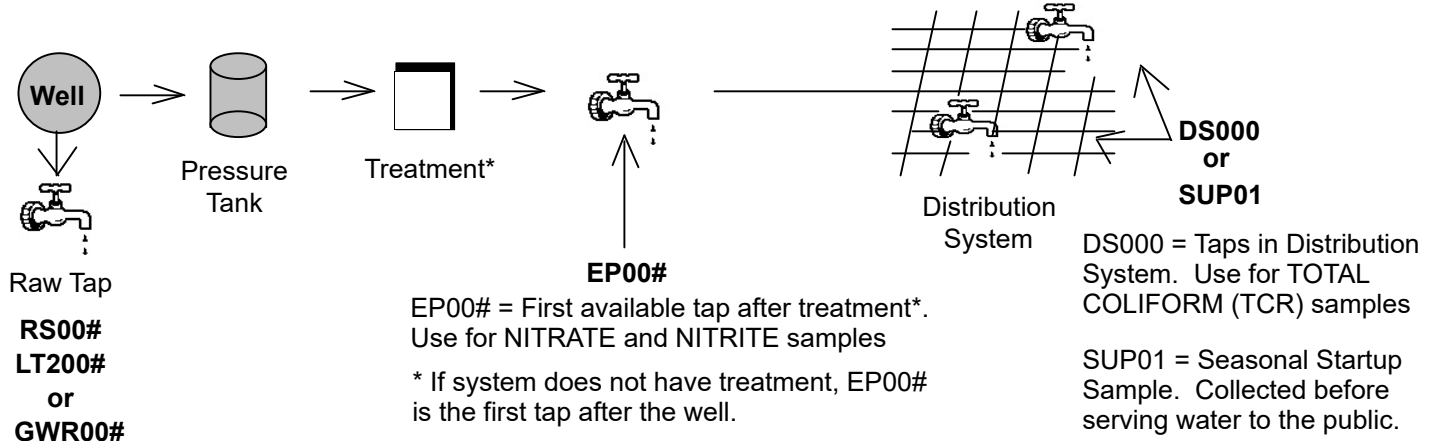

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!

OH1137119 THE LOGAN LODGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1162516	Facility Name: THE LOGAN LODGE PLANT
	SMP ID: EP001	Facility Source:

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
For water emergencies that occur after hours, please call 800-282-9378
**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2026 and 10/31/2026
RADIOLOGICALS	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

OH1137119 THE LOGAN LODGE

System Type: Community

 Source: Ground Water
 Ground Water Rule Minimal Treatment System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**
DISTRIBUTION MONITORING SCHEDULE
Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.
Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
 SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling Location Facility ID: **DS1** Facility Name: **DISTRIBUTION**
 SMP ID: **DS201** UNKNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:
TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950
A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.