

Subject: 2026 PWS Monitoring Schedules Now Available

Dear Public Water System (PWS) Owner:

The 2026 Contaminant Monitoring Schedules have been created and are now available online at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

The distribution requirements only need to be met by your overall system, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
 - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
 - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
 - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

Subscribe to Updates: Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

For Transient Non-Community (TNC) PWSs Only

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Southeast District Office at: 740-385-8501
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)



OH1600012 COSHOCTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653599	Facility Name: COSHOCTON WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1600012 COSHOCTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: COSHOCTON DISTRIBUTION	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: COSHOCTON DISTRIBUTION	Monitoring Requirements
	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	
Chemicals		Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		Not Required



OH1600012 COSHOCTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: COSHOCTON DISTRIBUTION

Location SMP ID: DS201 2742 CR 271

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: COSHOCTON DISTRIBUTION

Location SMP ID: DS202 1991 OTSEGO AVE.

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1600212 EDGEWOOD TERRACE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653600	Facility Name: HOLLYBERRYPARK
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1600212 EDGEWOOD TERRACE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: HOLLYBERRY PARK DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: HOLLYBERRY PARK DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1600212 EDGEWOOD TERRACE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HOLLYBERRY PARK DISTRIBUTION

Location SMP ID: DS201 LOT #52

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1600412 HOUSE OF JACOB

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653602	Facility Name: HOUSE OF JACOB WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 3/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1600412 HOUSE OF JACOB

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: HOUSE OF JACOB DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: HOUSE OF JACOB DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH1600412 HOUSE OF JACOB

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HOUSE OF JACOB DISTRIBUTION

Location SMP ID: DS201 25520 TOWNSHIP ROAD 39

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1600612 WARSAW PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653603	Facility Name: WARSAW
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>GROSS ALPHA - 4002 RADIUM-228 - 4030</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1600612 WARSAW PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: WARSAW DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: WARSAW DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		10 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1600612 WARSAW PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WARSAW DISTRIBUTION
Location	SMP ID: DS201 714 BEECH STREET	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: WARSAW DISTRIBUTION
Location	SMP ID: DS202 197 SPRING MOUNTAIN ROAD	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662407	Facility Name: ECHOING HILLS VILLAGE PLANT
Location	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>GROSS ALPHA - 4002 RADIUM-228 - 4030</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1600811 ECHOING HILLS VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ECHOING HILLS VILLAGE DISTRIBUTION

Location SMP ID: DS201 BUILDING F - 36272 CR 79

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653606	Facility Name: MILLERS ACRES HOME OWNER ASSN
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>GROSS ALPHA - 4002 RADIUM-228 - 4030</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH1601012 MILLERS ACRES HOME OWNER ASSOCIATION

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MILLERS ACRES HOME OWNER DISTRIBUTION

Location SMP ID: DS201 54438 TR 152

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653609	Facility Name: BOMAC
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>GROSS ALPHA - 4002 RADIUM-228 - 4030</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: BOMAC DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: BOMAC DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH1601312 BOMAC MOBILE HOME PARK

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BOMAC DISTRIBUTION

Location SMP ID: DS201 LOT 7

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: WALHONDING HILLS CAMP DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

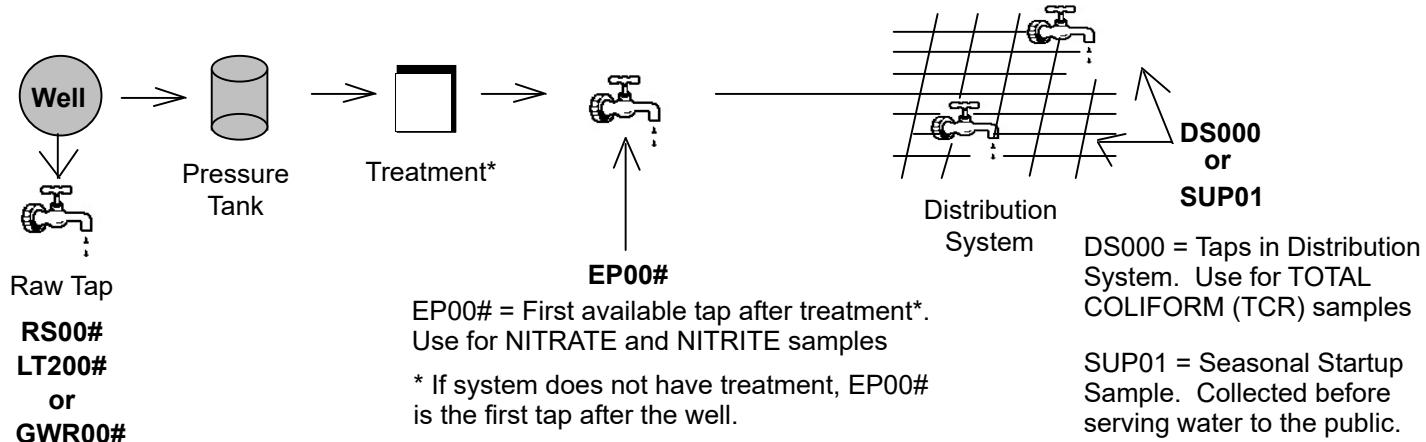

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WALHONDING HILLS CAMP DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/15/2026

Where to Collect Samples For a Small Public Water System

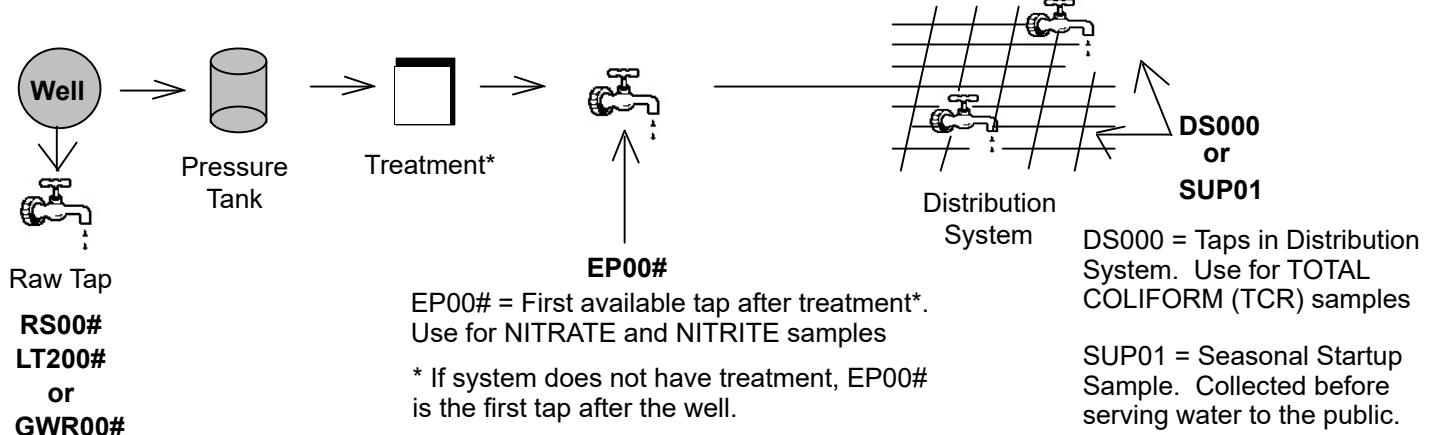

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1630112 WALHONDING HILLS CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653610 Facility Name: **WALHONDING HILLS CAMP INC**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

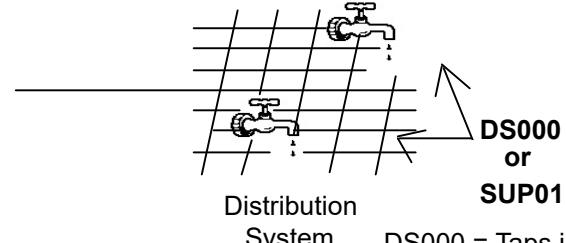

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-C DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

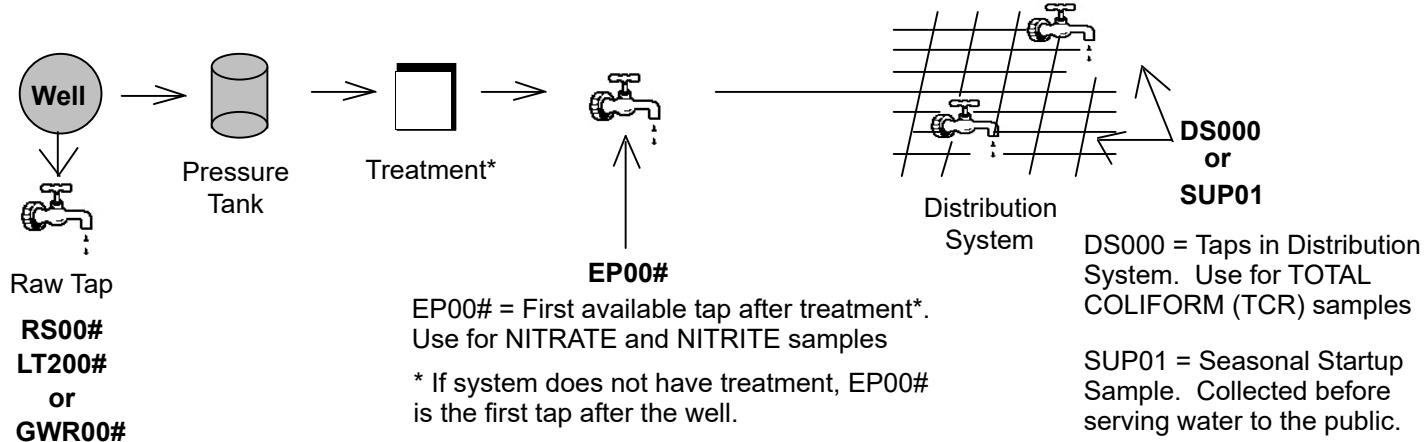

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: FOREST HILL LAKE, INC.-C DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026

Where to Collect Samples For a Small Public Water System

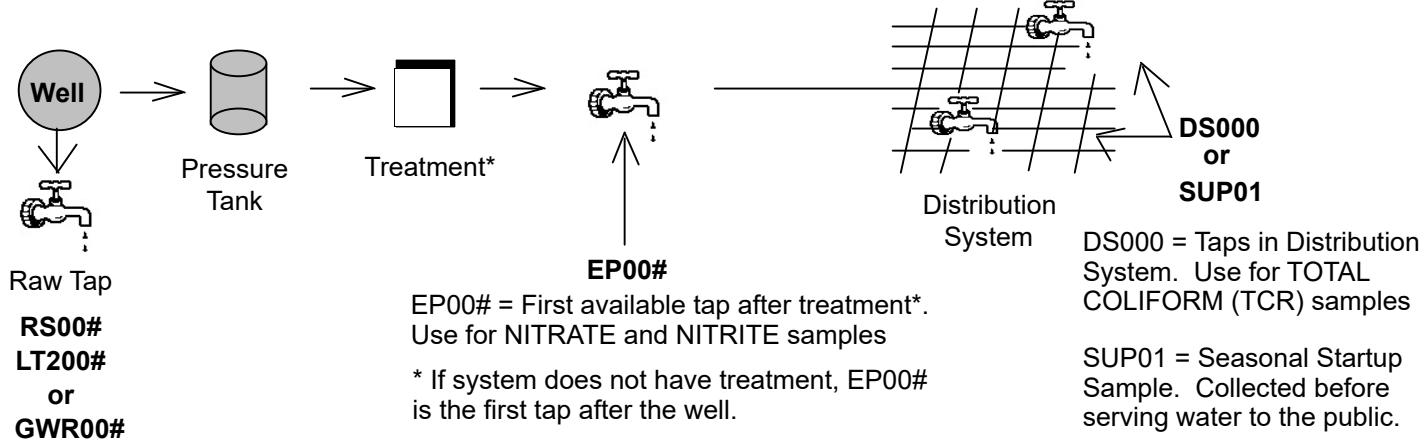

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1631112 FOREST HILL LAKE, INC.-CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653616 Facility Name: FOREST HILL LAKE INC CAMP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

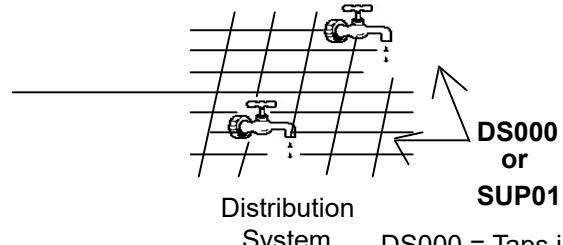

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: HICKORY FLAT GOLF COURSE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

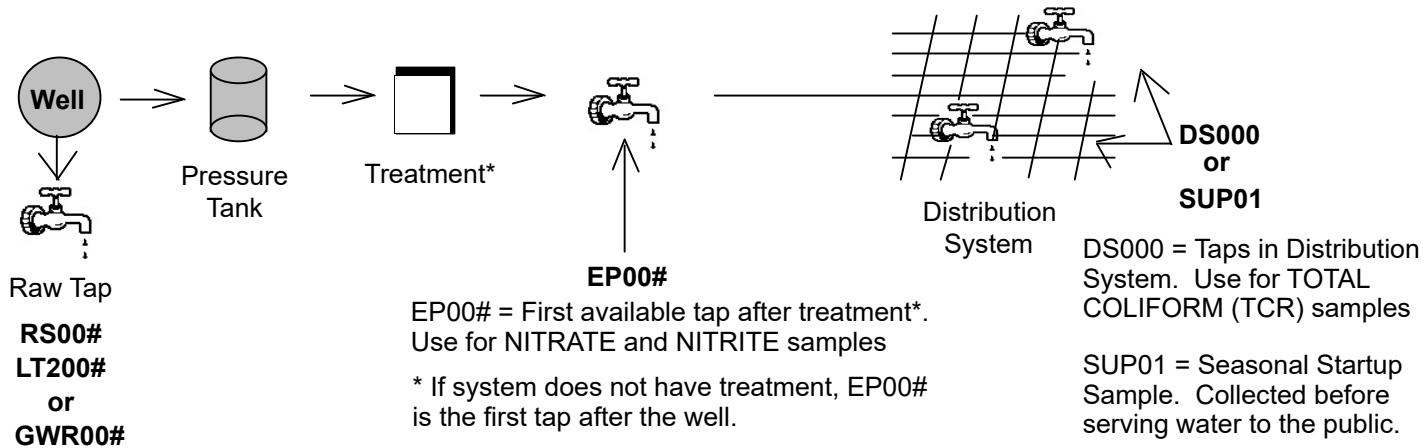

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1631612 HICKORY FLAT GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653619 Facility Name: **HICKORY FLAT GOLF COURSE**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

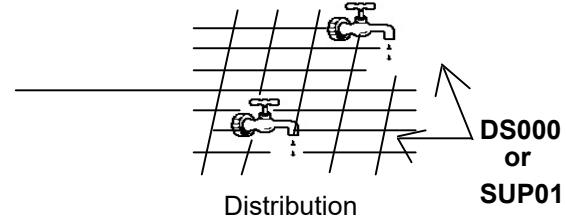

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632212 LAKE LILA

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: LAKE LILA (FRONT-WELL) DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

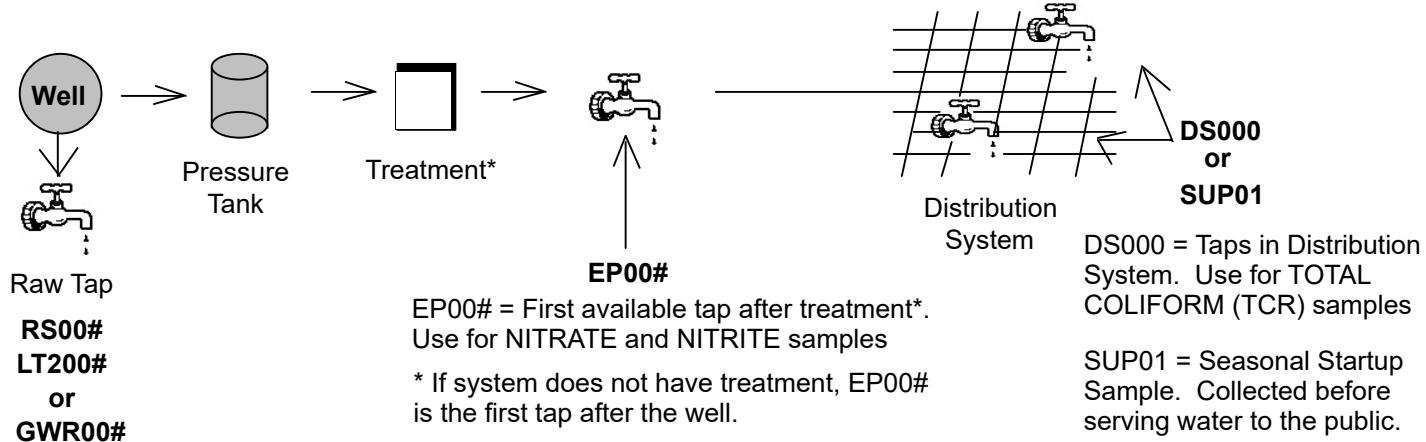

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632212 LAKE LILA

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID:	DS1	Facility Name:	LAKE LILA (FRONT-WELL) DISTRIBUTION	
Location	SMP ID:	DS000	Facility Source:	Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/20/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/15/2026

Where to Collect Samples For a Small Public Water System

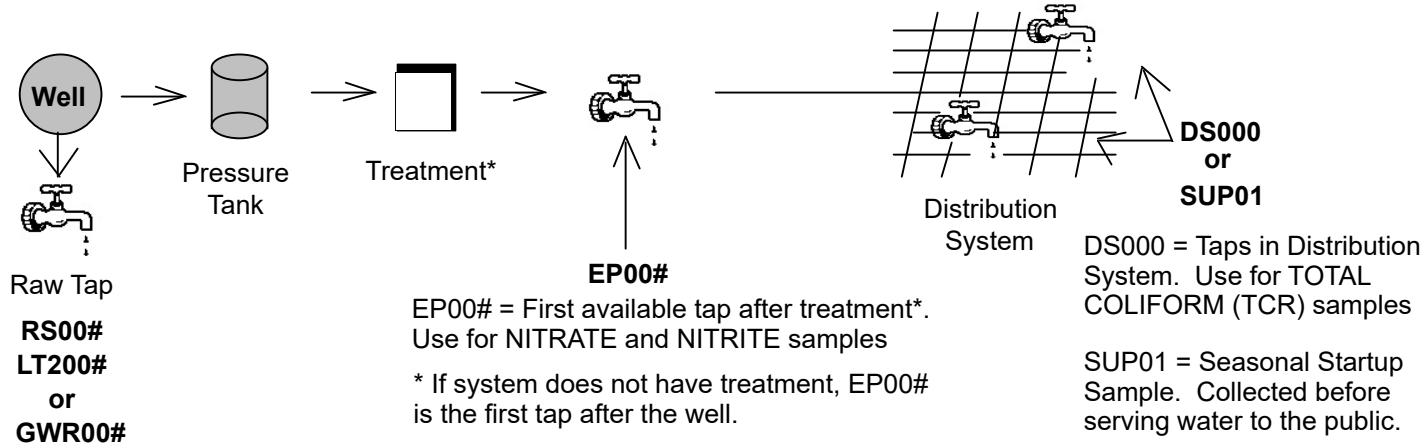

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632212 LAKE LILA

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653623 Facility Name: LAKE LILA FRONT WELL PLANT

Location SMP ID: EP001 Facility Source: Ground Water


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

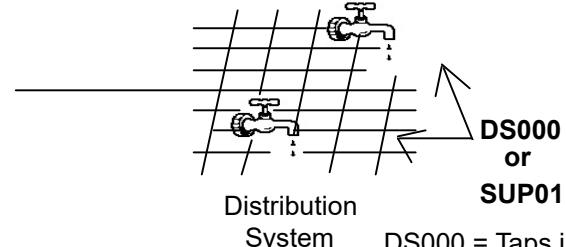

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632212 LAKE LILA

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653622 Facility Name: LAKE LILA BACK WELL PLANT

Location SMP ID: EP002 Facility Source:


Chemicals

Monitoring Requirements

NITRATE - 1040

1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

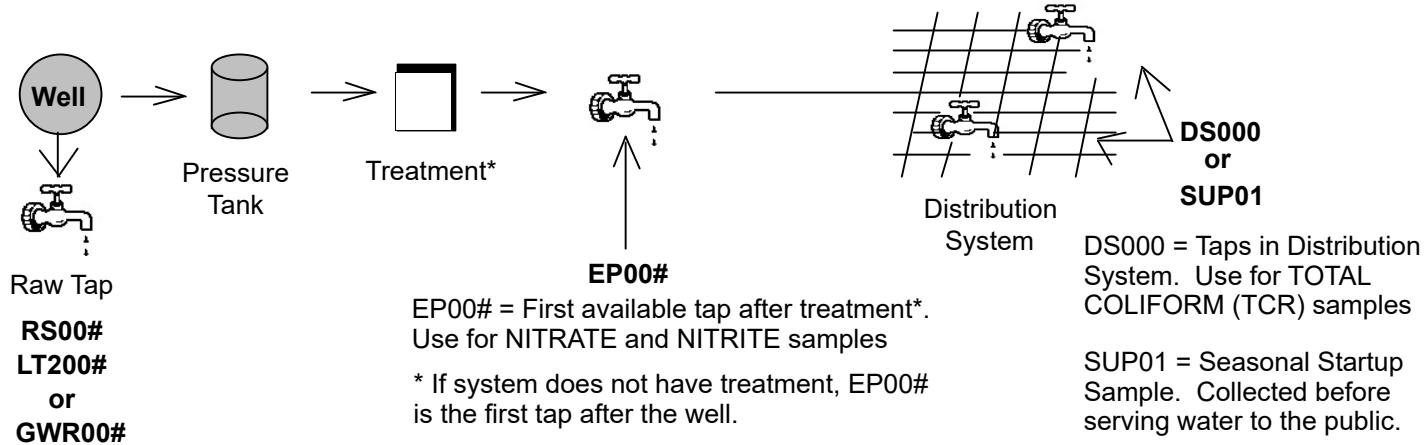

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632312 THE CORN CRIB

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

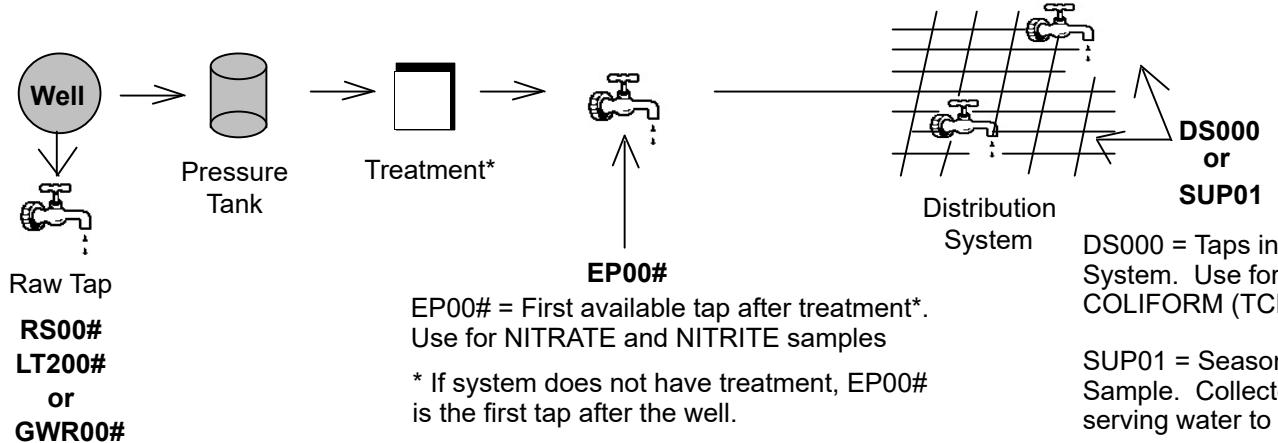

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632312 THE CORN CRIB

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653624 Facility Name: THE CORN CRIB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

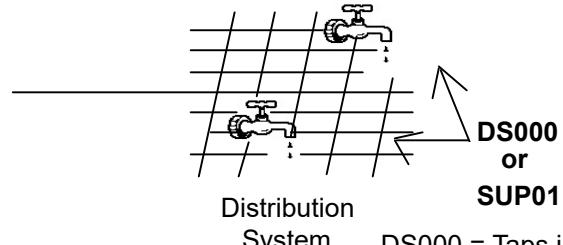

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: MUSKINGUM VALLEY SCOUT DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

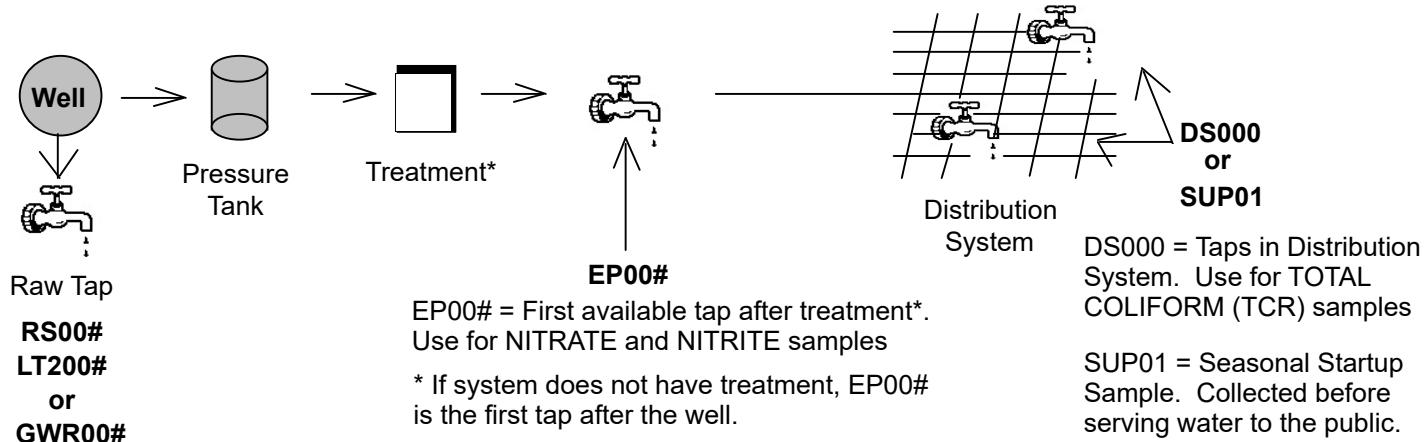

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID:	DS1	Facility Name:	MUSKINGUM VALLEY SCOUT DISTRIBUTION
Location	SMP ID: DS000	Facility Source:	Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

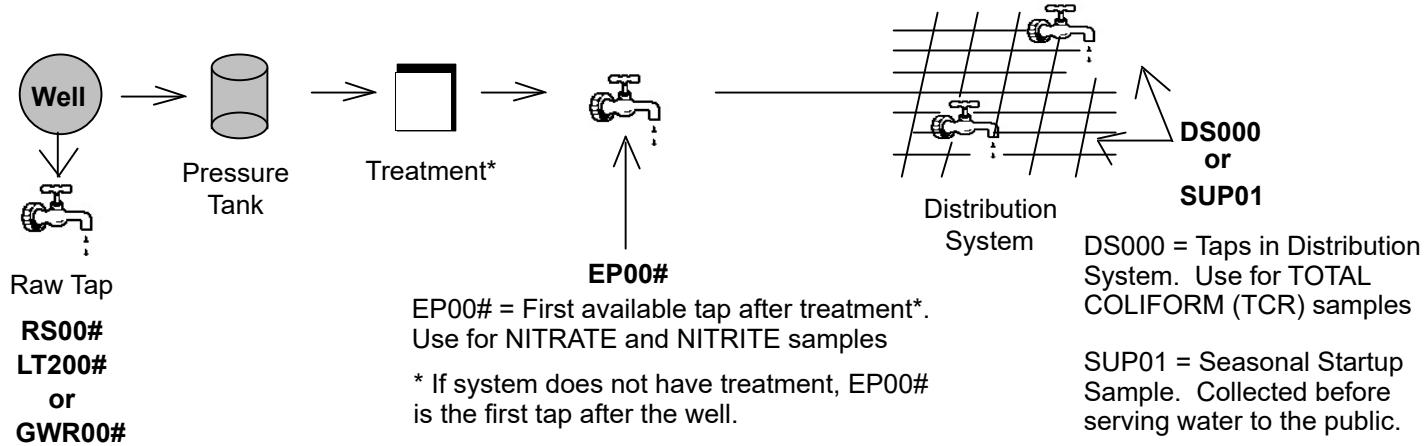

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632512 MUSKINGUM VALLEY SCOUT

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653625	Facility Name: MUSKINGUM VALLEY SCOUT RESERVATION
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

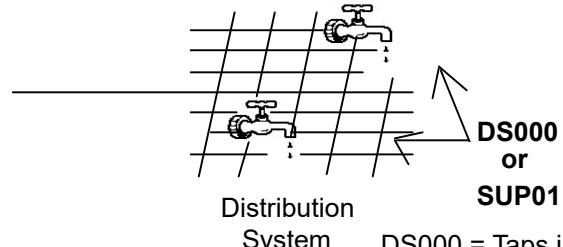

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WHISPERING FALLS, INC. DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

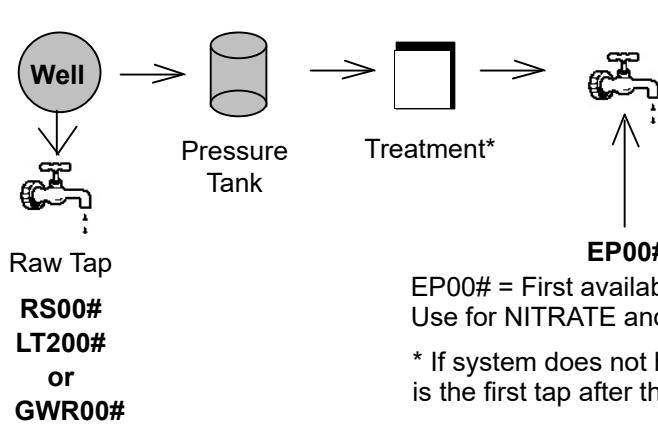

Raw Tap

RS00#

LT200#


or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

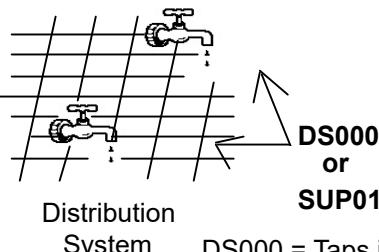

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632712 WHISPERING FALLS, INC.

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653627 Facility Name: **WHISPERING FALLS INC**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

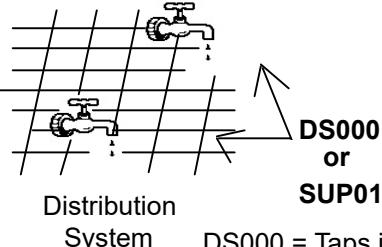

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RIVERGREEN GOLF CLUB DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------


TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

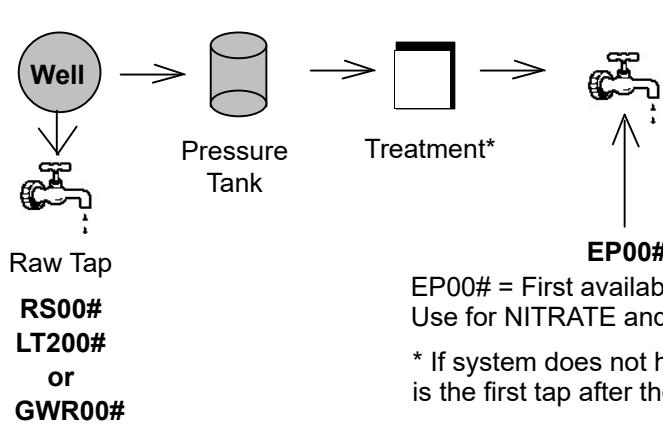

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

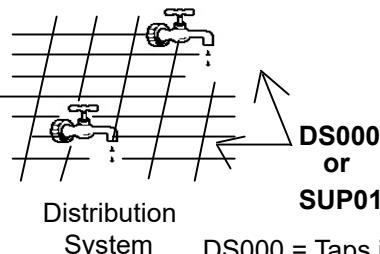

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1632912 RIVERGREEN GOLF PRO SHOP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653629 Facility Name: RIVERGREEN GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure

Treatment*

EP00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

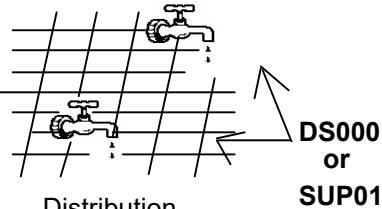

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378



DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RIVERGREEN GOLF COURSE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

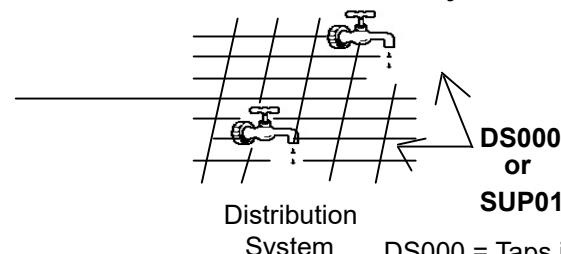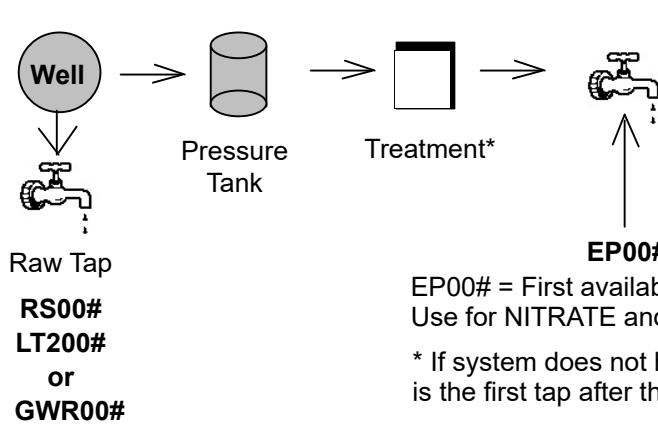

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1633012 RIVERGREEN GOLF COURSE CLUB HOUSE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653630 Facility Name: RIVERGREEN GOLF COURSE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System

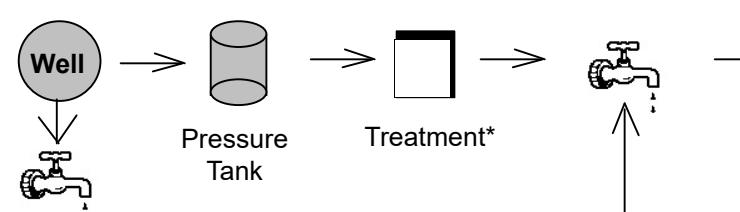

Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

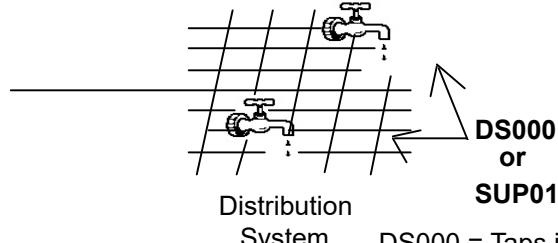

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653631	Facility Name: RIVERVIEW LOCAL SCH DIST
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2026 and 10/31/2026



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1633112 RIVERVIEW HIGH SCHOOL

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION
Location	SMP ID: DS201	HS KITCHEN SINK

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: RIVERVIEW HIGH SCHOOL DISTRIBUTION
Location	SMP ID: DS202	JRHS KITCHEN SINK

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1633912 CLEVELAND CLIFFS COSHOCTON WORKS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653633	Facility Name: CLEVELAND CLIFFS COSHOCTON WORKS
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1633912 CLEVELAND CLIFFS COSHOCTON WORKS

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS000	
Chemicals	Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs
Chemicals	Monitoring Requirements	
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS201	GRAY BUILD. 1 FL MENS RR
Chemicals	Monitoring Requirements	
DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: UNUSUAL SHOPPE & JUNCTIO DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

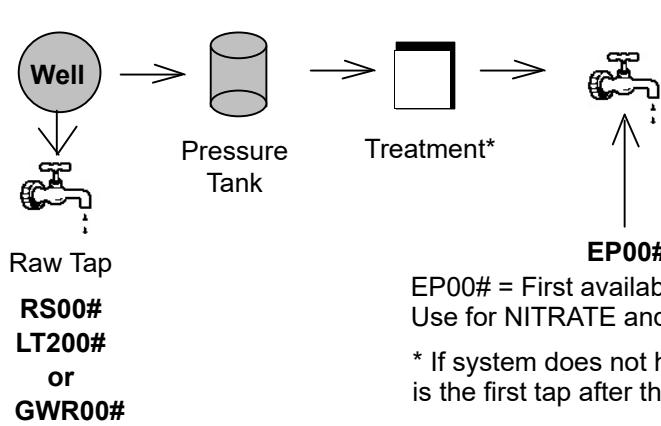

Raw Tap

RS00#

LT200#


or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

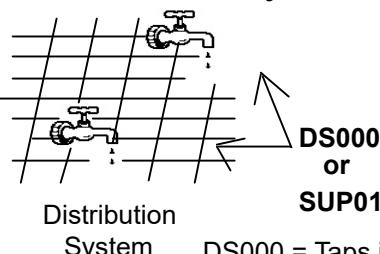

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1634012 UNUSUAL SHOPPE AND JUNCTION

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653634 Facility Name: UNUSUAL SHOPPE & JUNCTION
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

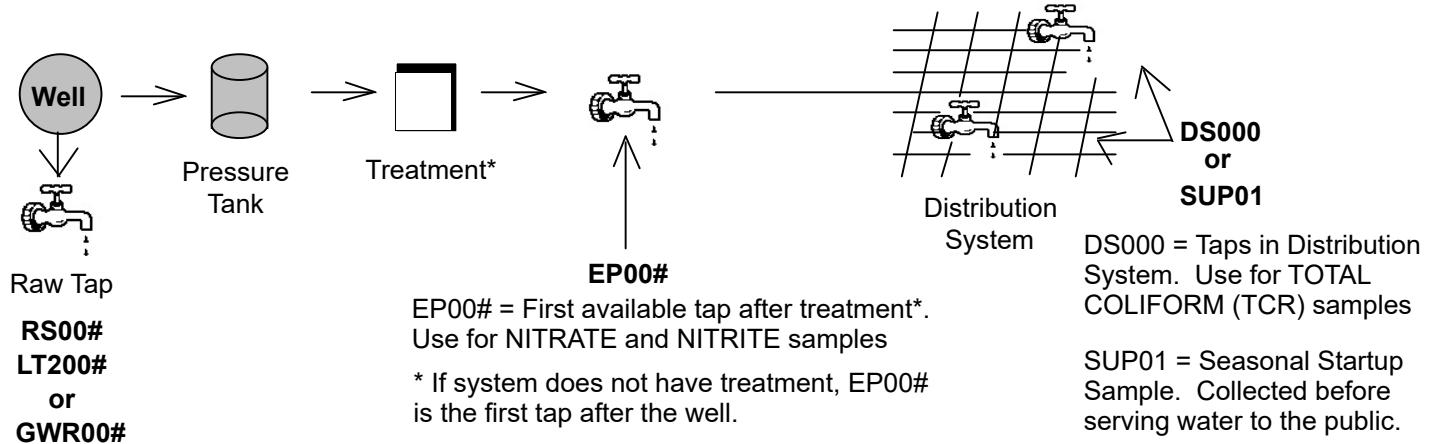

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: FRESNO BIBLE CHURCH DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

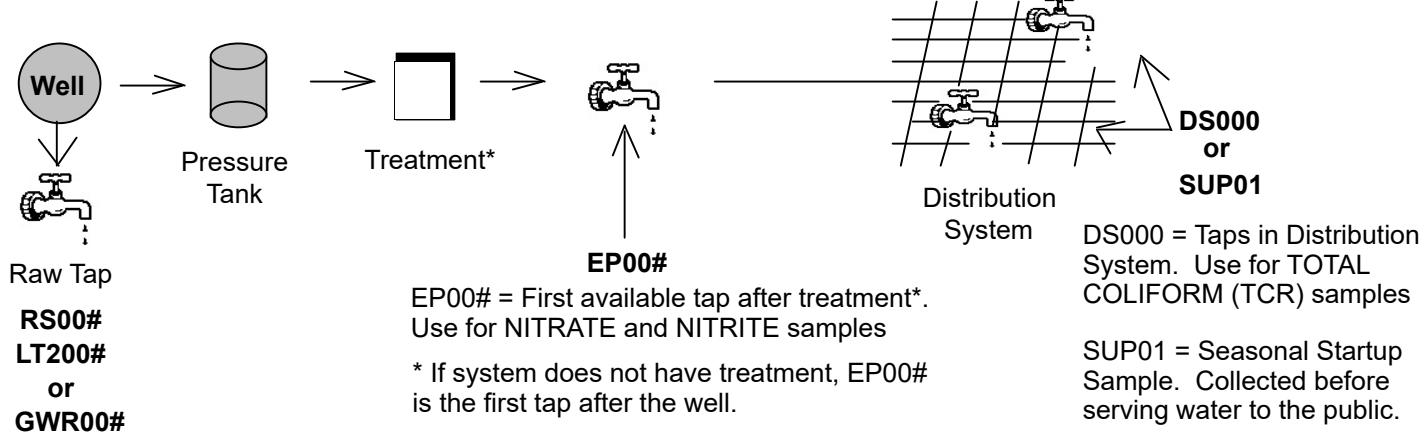

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1634612 FRESNO BIBLE CHURCH

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653637 Facility Name: FRESNO BIBLE CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

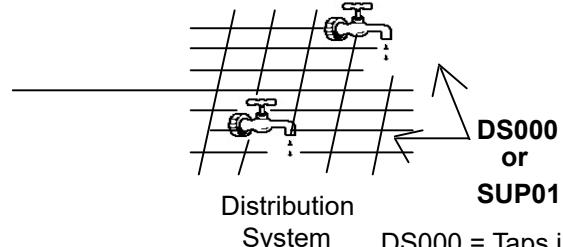

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KINGDOM HALL OF JEHOVAHS DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

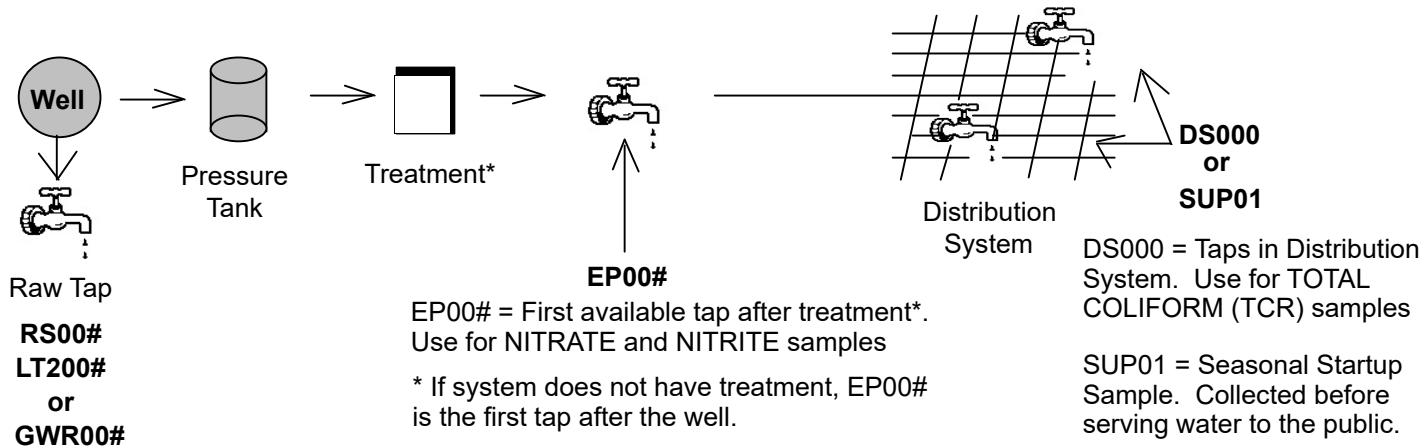

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1636512 KINGDOM HALL OF JEHOVAHS WITNESS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653648	Facility Name: KINGDOM HALL OF JEHOVAHS WITNE
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2026 and 5/31/2026
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System




Raw Tap

RS00#

LT200#


or

GWR00#

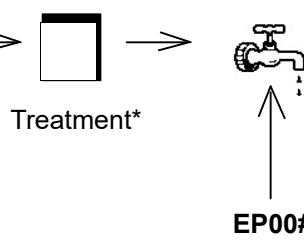

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

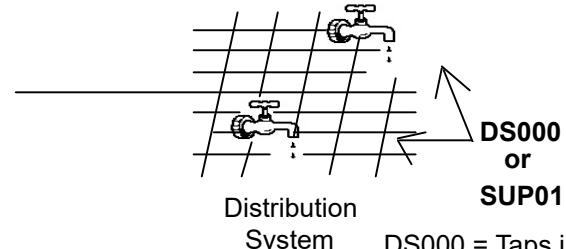

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: RIVER GREEN GOLFCOURSE S DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

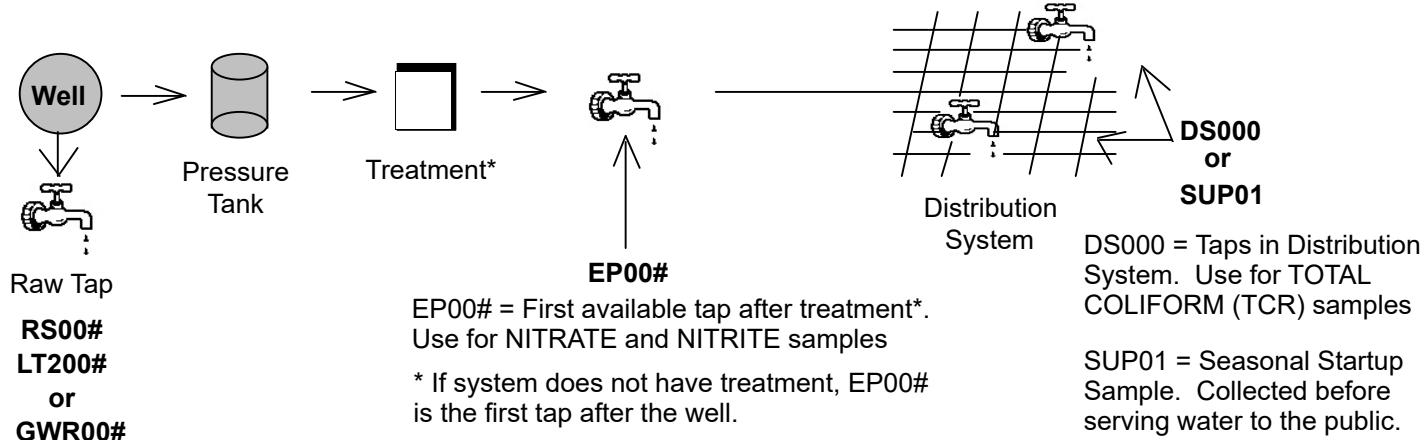

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RIVER GREEN GOLFCOURSE S DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

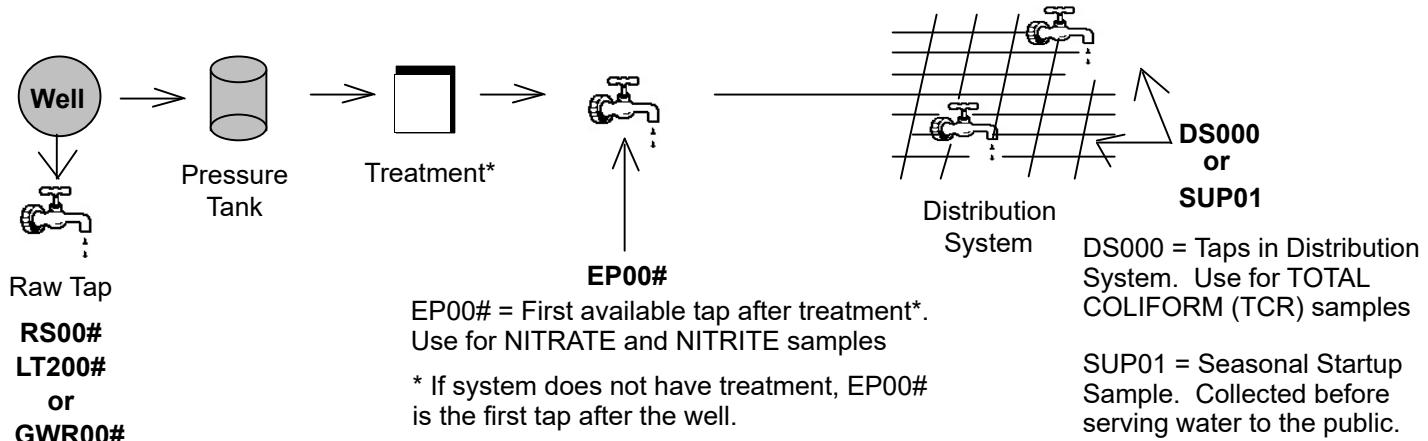

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637012 RIVER GREENS GOLFCOURSE SHELTER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1653652	Facility Name: RIVERGREENS GOLF COURSE SHELTER
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

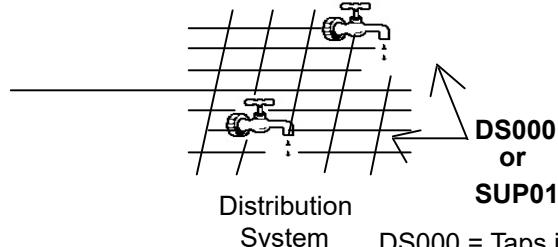

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GOSPEL HILL MINISTRY DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

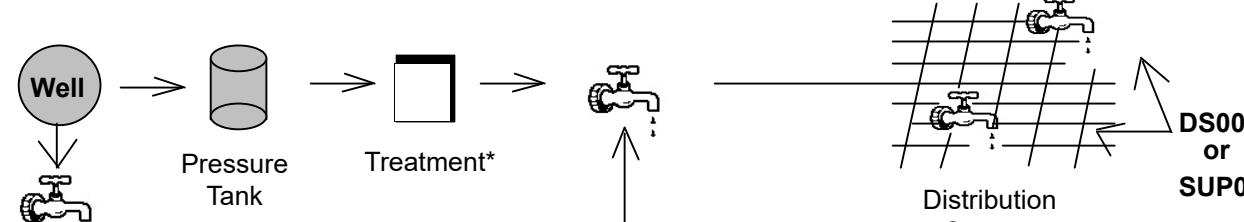

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637212 GOSPEL HILL MINISTRY

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1653654 Facility Name: **GOSPEL HILL MINISTRY**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

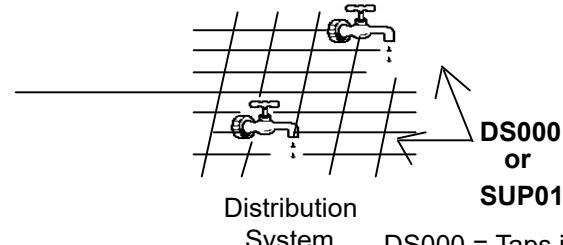

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1660815	Facility Name: SALEM AMISH FELLOWSHIP CHURCH
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1637412 SALEM AMISH FELLOWSHIP CHURCH SCHOOL PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SALEM AMISH FELLOWSHIP CHURCH DISTRIBUT
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling	Facility ID: DS1	Facility Name: SALEM AMISH FELLOWSHIP CHURCH DISTRIBUT
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 1/1/2026 and 6/30/2026
	5 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KEENE UNITED METHODIST CHURCH DISTRIBUTI
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

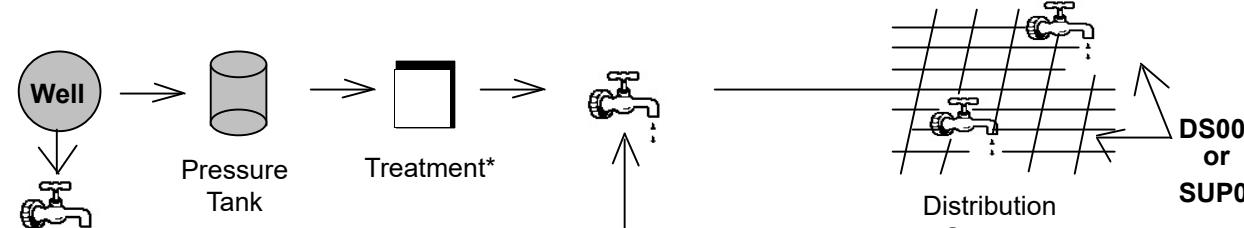

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637712 KEENE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1660945 Facility Name: KEENE UNITED METHODIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

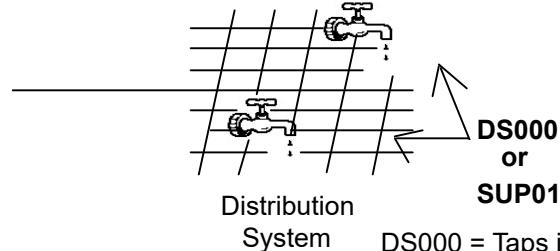

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: CONESVILLE UNITED METHODIST CHURCH DISTR
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

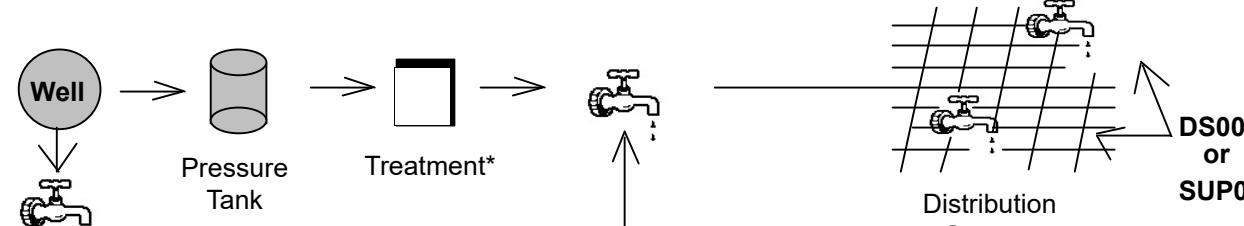

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1637912 CONESVILLE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1661401	Facility Name: CONESVILLE UNITED METHODIST CHURCH
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

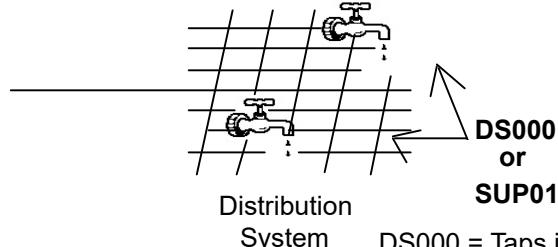

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PERRY CHAPEL BAPTIST CHURCH - NEW CHURCH
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026
		1 Sample(s) Required between 2/1/2026 and 2/28/2026
		1 Sample(s) Required between 3/1/2026 and 3/31/2026
		1 Sample(s) Required between 4/1/2026 and 4/30/2026
		1 Sample(s) Required between 5/1/2026 and 5/31/2026
		1 Sample(s) Required between 6/1/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 7/31/2026
		1 Sample(s) Required between 8/1/2026 and 8/31/2026
		1 Sample(s) Required between 9/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 10/31/2026
		1 Sample(s) Required between 11/1/2026 and 11/30/2026
		1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

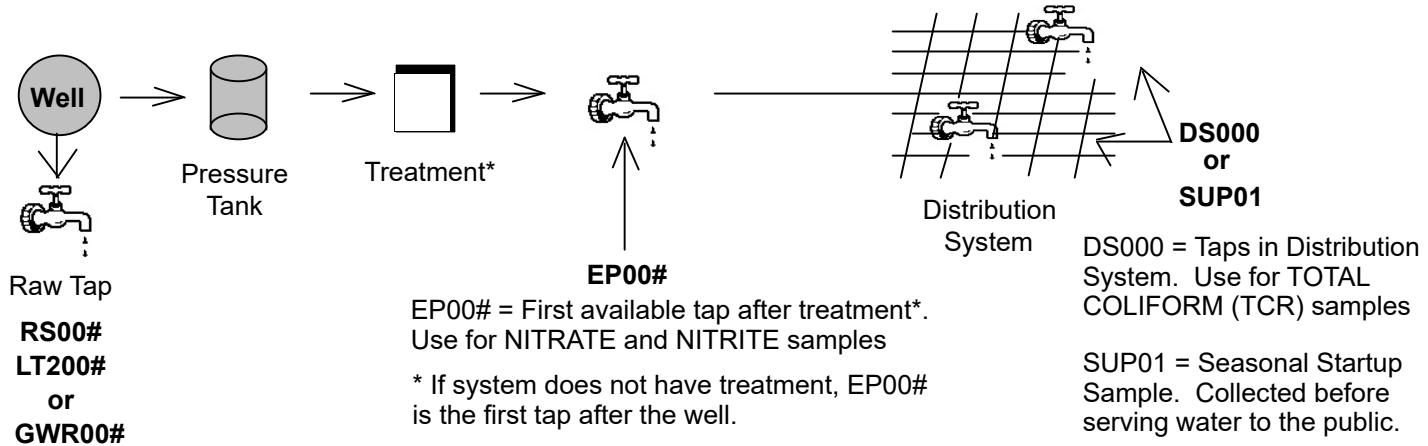

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638112 PERRY CHAPEL BAPTIST CHURCH-NEW

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1661549	Facility Name: PERRY CHAPEL BAPTIST CHURCH-NEW CHURCH
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

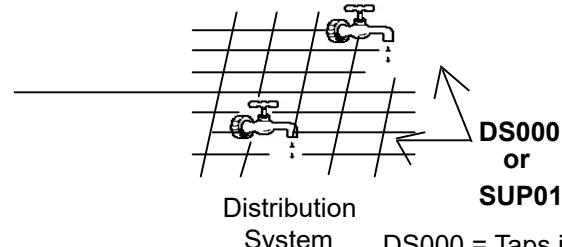

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RAVENS GLENN WINERY DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

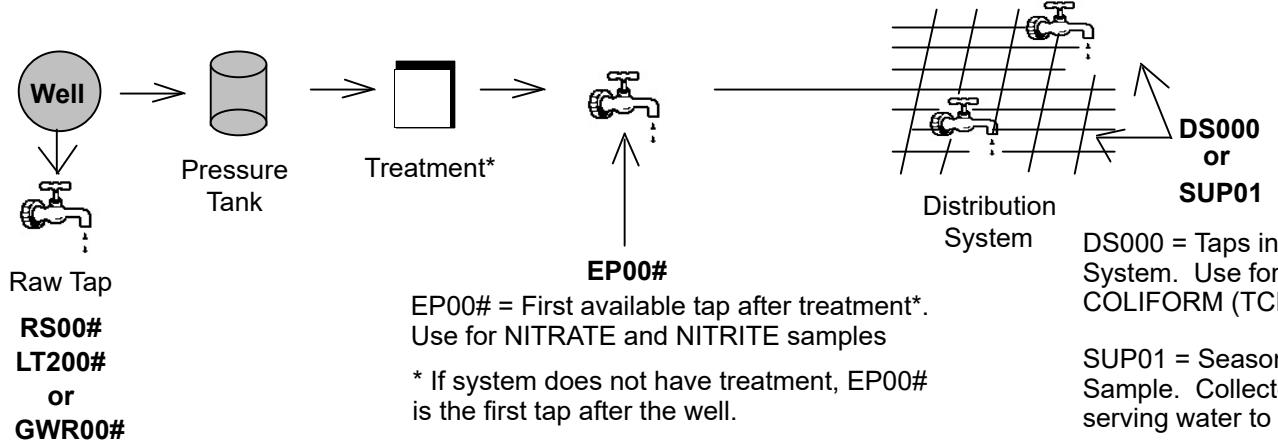

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638212 RAVENS GLENN WINERY PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1661607 Facility Name: RAVENS GLENN WINERY
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026


Where to Collect Samples For a Small Public Water System

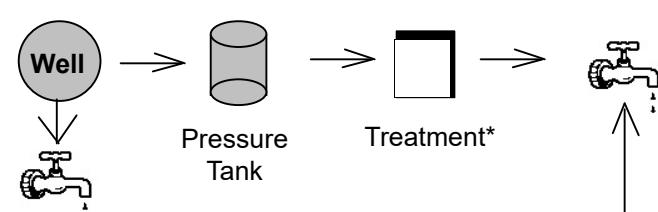

Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

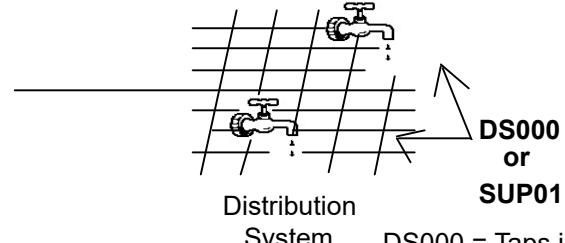

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PRAIRIE CHAPEL UMC DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

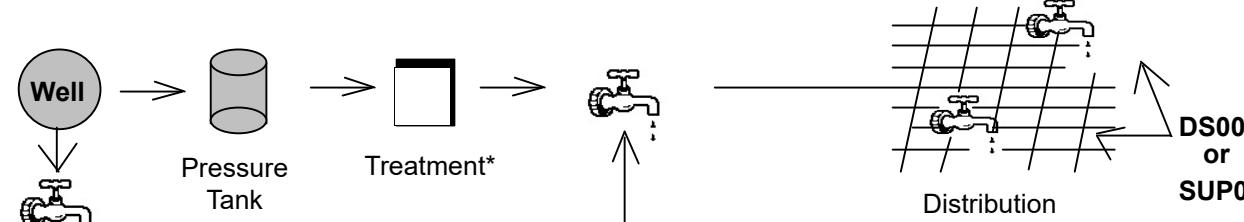

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638312 PRAIRIE CHAPEL UNITED METHODIST CHURCH P

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1661796	Facility Name: PRAIRIE CHAPEL UNITED METHODIST CHURCH
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2026 and 9/30/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

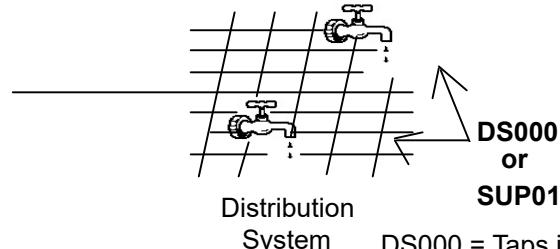

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662073	Facility Name: COSHOCTON ETHANOL LLC
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2026 and 10/31/2026



OH1638412 THREE RIVERS ENERGY LLC PWS

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: COSHOCTON ETHANOL LLC DISTRIBUTION
Location	SMP ID: DS201	POTABLE BUILDING TAP

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662186	Facility Name: SCHLABACH WOOD DESIGN
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2026 and 10/31/2026



OH1638612 SCHLABACH WOOD DESIGN PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SCHLABACH WOOD DESIGN DISTRIBUTION
Location	SMP ID: DS000	
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 3/31/2026
		1 Sample(s) Required between 4/1/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling	Facility ID: DS1	Facility Name: SCHLABACH WOOD DESIGN DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs
Chemicals		Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH1638914 FAMILY DOLLAR - NEWCASTLE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION


Location SMP ID: DS000 Facility Source:

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026
-----------------------------	--	--

Where to Collect Samples For a Small Public Water System

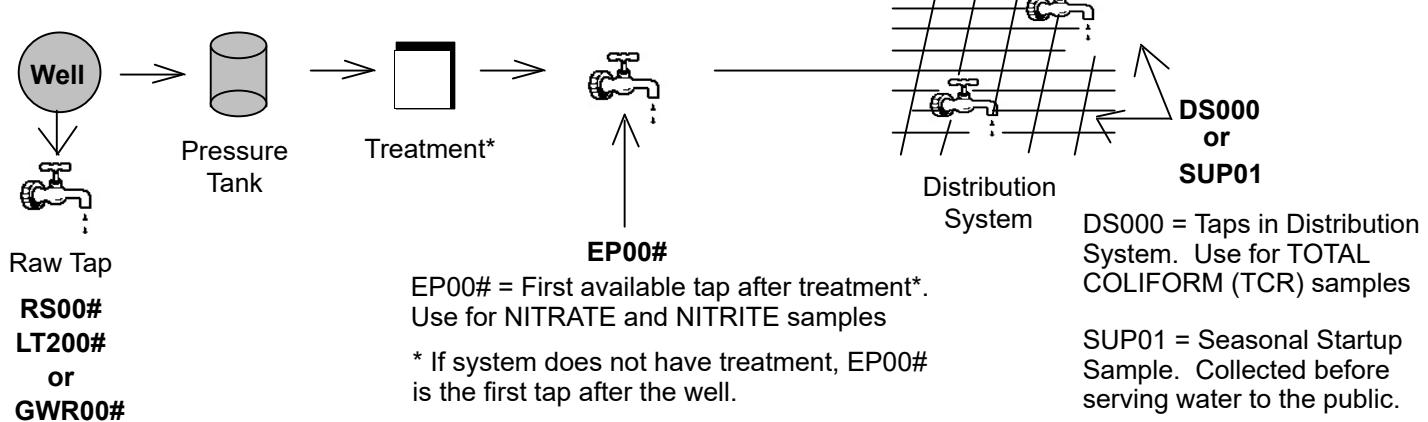

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638914 FAMILY DOLLAR - NEWCASTLE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1662409 Facility Name: FAMILY DOLLAR - NEWCASTLE PLANT

Location SMP ID: EP001 Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System




Raw Tap

RS00#

LT200#


or

GWR00#



EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

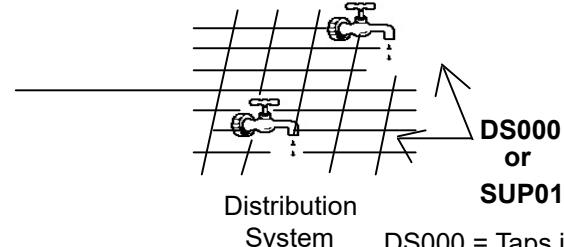

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638915 DOLLAR GENERAL - CONESVILLE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION


Location SMP ID: DS000 Facility Source:

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

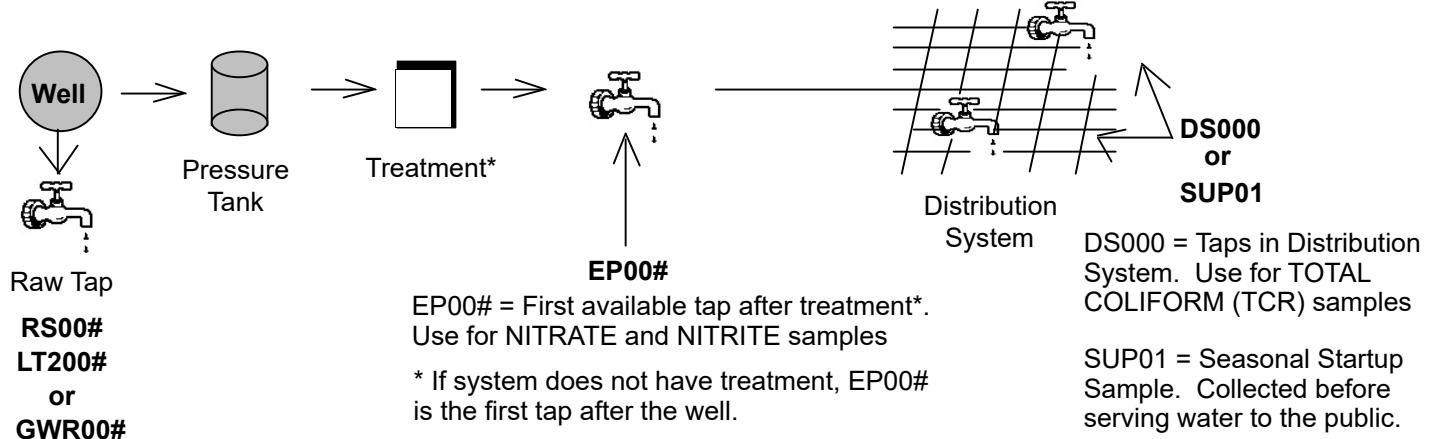

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638915 DOLLAR GENERAL - CONESVILLE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1662410 Facility Name: FAMILY DOLLAR CONESVILLE PLANT

Location SMP ID: EP001 Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

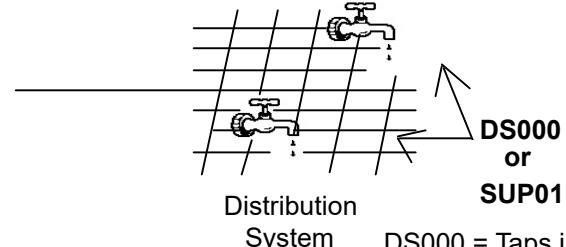

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638916 PEARL VALLEY CHEESE, INC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1662411	Facility Name: PEARL VALLEY CHEESE PLANT
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026



OH1638916 PEARL VALLEY CHEESE, INC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS000	
Chemicals	Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs
Chemicals	Monitoring Requirements	

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2026 and 9/30/2026
-------------------------------	------------------------------	------------------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS201	MENS RESTROOM OFFICE BUILDING
Chemicals	Monitoring Requirements	

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2026 and 9/30/2026 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH1638917 POPE HOUSE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 8/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**

Location SMP ID: **SUP01** Facility Source:


Chemicals

Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

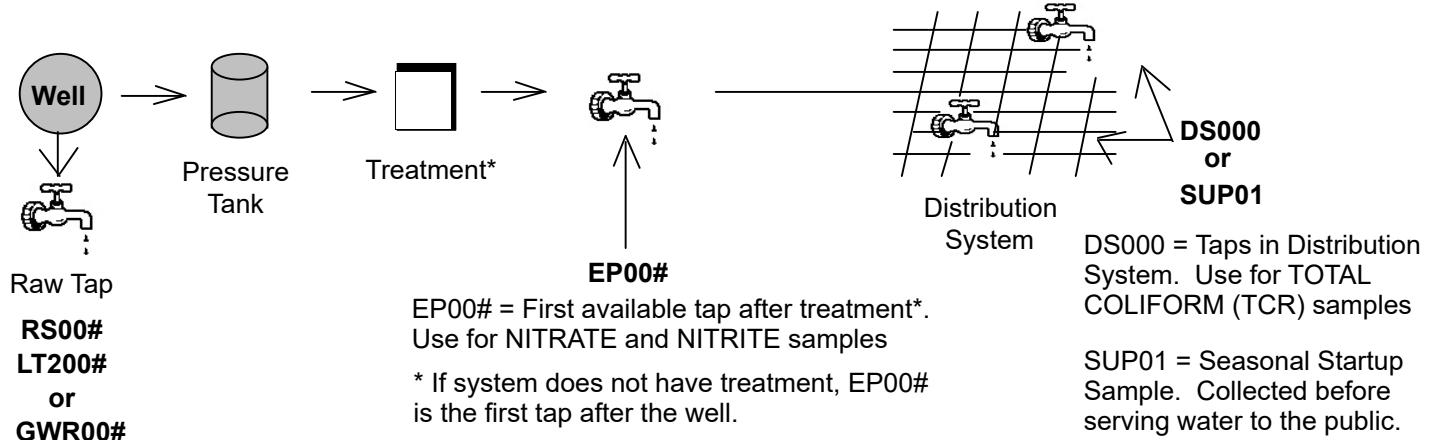

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638917 POPE HOUSE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 8/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION


Location SMP ID: DS000 Facility Source:

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

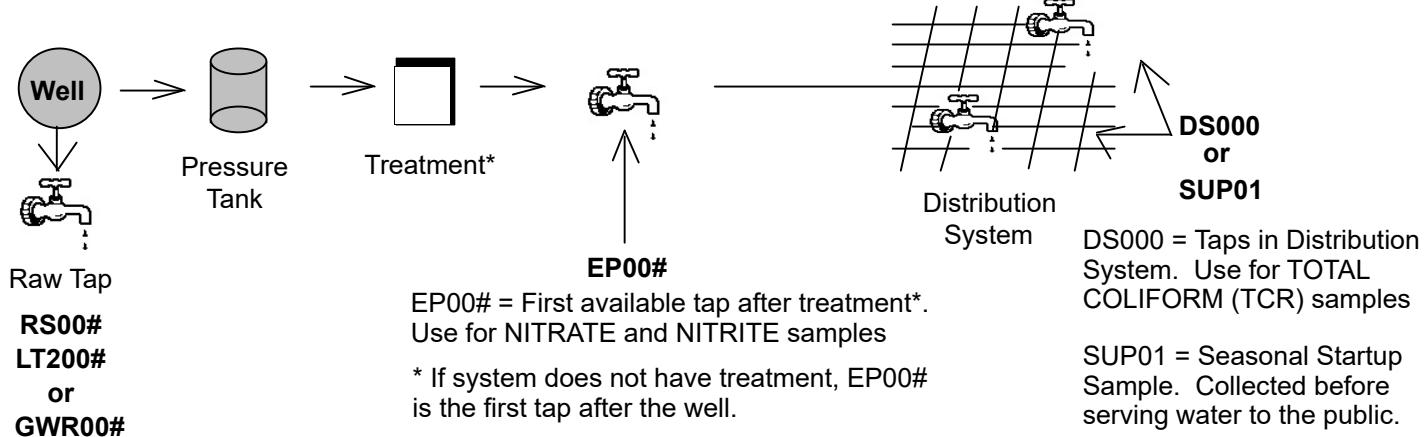

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH1638917 POPE HOUSE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 8/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1662412 Facility Name: **POPE HOUSE PLANT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2026 and 10/31/2026
NITRATE - 1040	1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

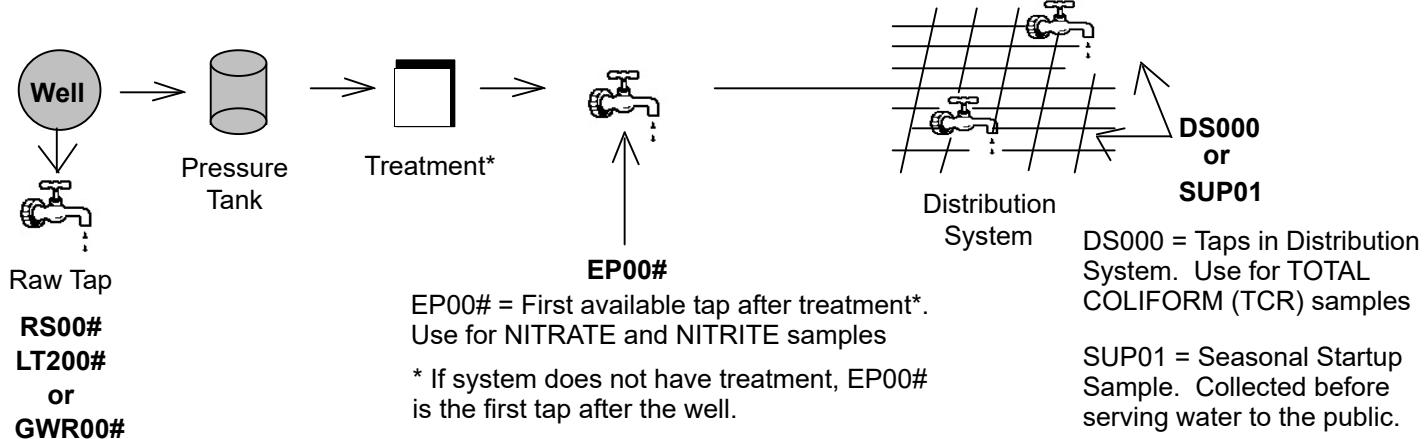

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!