



**Subject: 2026 PWS Monitoring Schedules Now Available**

Dear Public Water System (PWS) Owner:

**The 2026 Contaminant Monitoring Schedules have been created and are now available online at:** <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

**IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING**

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

**When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.**

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

**The distribution requirements only need to be met by your overall system**, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
  - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
  - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
  - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

**Subscribe to Updates:** Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

**For Transient Non-Community (TNC) PWSs Only**

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Northwest District Office at: 419-352-8461  
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#) .

Harmful Algal Blooms – [Haley McLean](#)

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1762226</b>	Facility Name: <b>BUCYRUS CITY</b>
	SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
**For water emergencies that occur after hours, please call 800-282-9378**
**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**Chemicals**
**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

 NITRATE - 1040  
 1 Sample(s) Required between 1/1/2026 and 1/31/2026  
 1 Sample(s) Required between 2/1/2026 and 2/28/2026  
 1 Sample(s) Required between 3/1/2026 and 3/31/2026  
 1 Sample(s) Required between 4/1/2026 and 4/30/2026  
 1 Sample(s) Required between 5/1/2026 and 5/31/2026  
 1 Sample(s) Required between 6/1/2026 and 6/30/2026  
 1 Sample(s) Required between 7/1/2026 and 7/31/2026  
 1 Sample(s) Required between 8/1/2026 and 8/31/2026  
 1 Sample(s) Required between 9/1/2026 and 9/30/2026  
 1 Sample(s) Required between 10/1/2026 and 10/31/2026  
 1 Sample(s) Required between 11/1/2026 and 11/30/2026  
 1 Sample(s) Required between 12/1/2026 and 12/31/2026

RADIOLOGICALS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2026 and 6/30/2026

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2026 and 5/31/2026

 TOTAL ORGANIC CARBON (TOC)  
 1 Paired Sample Set Required between 1/1/2026 and 1/31/2026  
 1 Paired Sample Set Required between 2/1/2026 and 2/28/2026  
 1 Paired Sample Set Required between 3/1/2026 and 3/31/2026  
 1 Paired Sample Set Required between 4/1/2026 and 4/30/2026  
 1 Paired Sample Set Required between 5/1/2026 and 5/31/2026  
 1 Paired Sample Set Required between 6/1/2026 and 6/30/2026  
 1 Paired Sample Set Required between 7/1/2026 and 7/31/2026  
 1 Paired Sample Set Required between 8/1/2026 and 8/31/2026  
 1 Paired Sample Set Required between 9/1/2026 and 9/30/2026  
 1 Paired Sample Set Required between 10/1/2026 and 10/31/2026  
 1 Paired Sample Set Required between 11/1/2026 and 11/30/2026

---

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1762226</b>	Facility Name: <b>BUCYRUS CITY</b>
	SMP ID: <b>EP002</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals**

**Monitoring Requirements**

---

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 12/1/2026 and 12/31/2026

***A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.***

---

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>1762226</b>	Facility Name: <b>BUCYRUS CITY</b>
<b>Location</b>	SMP ID: <b>EP002/LT200</b> ; Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals****Monitoring Requirements**

---

TOTAL MICROCYSTINS

See Instructions Below

*Please refer to the HAB website for any questions on sampling or monitoring requirements:*

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

*Current monitoring schedules can be found at:*

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>

---

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE**

---

<b>Sampling</b>	Facility ID: <b>1762226</b>	Facility Name: <b>BUCYRUS CITY</b>
<b>Location</b>	SMP ID: <b>LT2002</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals****Monitoring Requirements**

---

CYANOBACTERIA SCREENING

See Instructions Below

*Please refer to the HAB website for any questions on sampling or monitoring requirements:*

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

*Current monitoring schedules can be found at:*

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS000</b>	

**Chemicals**
**Monitoring Requirements**

ASBESTOS - 1094

Not Required

TOTAL COLIFORM (TCR) - 3100

10 Sample(s) Required between	1/1/2026	and	1/31/2026
10 Sample(s) Required between	2/1/2026	and	2/28/2026
10 Sample(s) Required between	3/1/2026	and	3/31/2026
10 Sample(s) Required between	4/1/2026	and	4/30/2026
10 Sample(s) Required between	5/1/2026	and	5/31/2026
10 Sample(s) Required between	6/1/2026	and	6/30/2026
10 Sample(s) Required between	7/1/2026	and	7/31/2026
10 Sample(s) Required between	8/1/2026	and	8/31/2026
10 Sample(s) Required between	9/1/2026	and	9/30/2026
10 Sample(s) Required between	10/1/2026	and	10/31/2026
10 Sample(s) Required between	11/1/2026	and	11/30/2026
10 Sample(s) Required between	12/1/2026	and	12/31/2026

TOTAL CHLORINE - 1000

10 Sample(s) Required between	1/1/2026	and	1/31/2026
10 Sample(s) Required between	2/1/2026	and	2/28/2026
10 Sample(s) Required between	3/1/2026	and	3/31/2026
10 Sample(s) Required between	4/1/2026	and	4/30/2026
10 Sample(s) Required between	5/1/2026	and	5/31/2026
10 Sample(s) Required between	6/1/2026	and	6/30/2026
10 Sample(s) Required between	7/1/2026	and	7/31/2026
10 Sample(s) Required between	8/1/2026	and	8/31/2026
10 Sample(s) Required between	9/1/2026	and	9/30/2026
10 Sample(s) Required between	10/1/2026	and	10/31/2026
10 Sample(s) Required between	11/1/2026	and	11/30/2026
10 Sample(s) Required between	12/1/2026	and	12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

**Chemicals**
**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS201</b>	<b>200 CRYSTAL CRESENT</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2026	and	2/7/2026	at: DS201
	Dual Sample Required between	5/1/2026	and	5/7/2026	at: DS201
	Dual Sample Required between	8/1/2026	and	8/7/2026	at: DS201
	Dual Sample Required between	11/1/2026	and	11/7/2026	at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS202</b>	<b>1850 MARION RD CARTER LUMBER</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2026	and	2/7/2026	at: DS202
	Dual Sample Required between	5/1/2026	and	5/7/2026	at: DS202
	Dual Sample Required between	8/1/2026	and	8/7/2026	at: DS202
	Dual Sample Required between	11/1/2026	and	11/7/2026	at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS203</b>	<b>575 S SANDUSKY TACO BELL</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2026	and	2/7/2026	at: DS203
	Dual Sample Required between	5/1/2026	and	5/7/2026	at: DS203
	Dual Sample Required between	8/1/2026	and	8/7/2026	at: DS203
	Dual Sample Required between	11/1/2026	and	11/7/2026	at: DS203

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS204</b>	<b>1433 WHETSTONE ST</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2026	and	2/7/2026	at: DS204
	Dual Sample Required between	5/1/2026	and	5/7/2026	at: DS204
	Dual Sample Required between	8/1/2026	and	8/7/2026	at: DS204

---

**OH1700011 BUCYRUS CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>DS1</b>	Facility Name: <b>BUCYRUS CITY DISTRIBUTION SYSTEM</b>
<b>Location</b>	SMP ID: <b>DS204</b>	<b>1433 WHETSTONE ST</b>

**Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2026 and 11/7/2026 at: DS204

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

**OH1700112 CRESTLINE VILLAGE**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1753657</b>	Facility Name: <b>CRESTLINE VILLAGE</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
INORGANICS	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<u>Sample for all the analytes listed below:</u>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<u>Sample for all the analytes listed below:</u>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2026 and 10/31/2026

**OH1700112 CRESTLINE VILLAGE**

System Type: Community

 Source: Ground Water  
*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**DISTRIBUTION MONITORING SCHEDULE**
**Sampling Location** Facility ID: **DS1** Facility Name: **CRESTLINE VILLAGE DISTRIBUTION**  
 SMP ID: **DS000**

Chemicals	Monitoring Requirements
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*
**Sampling Location** Facility ID: **DS1** Facility Name: **CRESTLINE VILLAGE DISTRIBUTION**  
 SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

**OH1700112 CRESTLINE VILLAGE**

System Type: Community

Source: Ground Water  
*Ground Water Rule Substantial System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026****DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CRESTLINE VILLAGE DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>3000 W BUCYRUS STREET</b>

**Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>CRESTLINE VILLAGE DISTRIBUTION</b>
	SMP ID: <b>DS202</b>	<b>1000 WESTGATE DRIVE</b>

**Chemicals****Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950***A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1753658</b>	Facility Name: <b>GALION CITY</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
**For water emergencies that occur after hours, please call 800-282-9378**
**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**Chemicals**
**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

 NITRATE - 1040  
 1 Sample(s) Required between 1/1/2026 and 1/31/2026  
 1 Sample(s) Required between 2/1/2026 and 2/28/2026  
 1 Sample(s) Required between 3/1/2026 and 3/31/2026  
 1 Sample(s) Required between 4/1/2026 and 4/30/2026  
 1 Sample(s) Required between 5/1/2026 and 5/31/2026  
 1 Sample(s) Required between 6/1/2026 and 6/30/2026  
 1 Sample(s) Required between 7/1/2026 and 7/31/2026  
 1 Sample(s) Required between 8/1/2026 and 8/31/2026  
 1 Sample(s) Required between 9/1/2026 and 9/30/2026  
 1 Sample(s) Required between 10/1/2026 and 10/31/2026  
 1 Sample(s) Required between 11/1/2026 and 11/30/2026  
 1 Sample(s) Required between 12/1/2026 and 12/31/2026

RADIOLOGICALS 1 Sample(s) Required between 6/1/2026 and 10/31/2026

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2026 and 6/30/2026

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 4/1/2026 and 6/30/2026

 TOTAL ORGANIC CARBON (TOC)  
 1 Paired Sample Set Required between 1/1/2026 and 1/31/2026  
 1 Paired Sample Set Required between 2/1/2026 and 2/28/2026  
 1 Paired Sample Set Required between 3/1/2026 and 3/31/2026  
 1 Paired Sample Set Required between 4/1/2026 and 4/30/2026  
 1 Paired Sample Set Required between 5/1/2026 and 5/31/2026  
 1 Paired Sample Set Required between 6/1/2026 and 6/30/2026  
 1 Paired Sample Set Required between 7/1/2026 and 7/31/2026  
 1 Paired Sample Set Required between 8/1/2026 and 8/31/2026  
 1 Paired Sample Set Required between 9/1/2026 and 9/30/2026  
 1 Paired Sample Set Required between 10/1/2026 and 10/31/2026  
 1 Paired Sample Set Required between 11/1/2026 and 11/30/2026

---

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1753658</b>	Facility Name: <b>GALION CITY</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals****Monitoring Requirements**

---

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 12/1/2026 and 12/31/2026

***A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.***

---

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE****Sampling** Facility ID: **1753658** Facility Name: **GALION CITY****Location** SMP ID: **EP001/LT200** Facility Source: **Surface Water****THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals****Monitoring Requirements**

---

TOTAL MICROCYSTINS

See Instructions Below

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>**Current monitoring schedules can be found at:**<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>

---

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

---

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1753658</b>	Facility Name: <b>GALION CITY</b>
	SMP ID: <b>LT2001</b>	Facility Source: <b>Surface Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

---

**Chemicals****Monitoring Requirements**

---

CYANOBACTERIA SCREENING

See Instructions Below

**Please refer to the HAB website for any questions on sampling or monitoring requirements:**<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>**Current monitoring schedules can be found at:**<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**
**Monitoring Requirements**

ASBESTOS - 1094

Not Required

TOTAL COLIFORM (TCR) - 3100

10 Sample(s) Required between	1/1/2026	and	1/31/2026
10 Sample(s) Required between	2/1/2026	and	2/28/2026
10 Sample(s) Required between	3/1/2026	and	3/31/2026
10 Sample(s) Required between	4/1/2026	and	4/30/2026
10 Sample(s) Required between	5/1/2026	and	5/31/2026
10 Sample(s) Required between	6/1/2026	and	6/30/2026
10 Sample(s) Required between	7/1/2026	and	7/31/2026
10 Sample(s) Required between	8/1/2026	and	8/31/2026
10 Sample(s) Required between	9/1/2026	and	9/30/2026
10 Sample(s) Required between	10/1/2026	and	10/31/2026
10 Sample(s) Required between	11/1/2026	and	11/30/2026
10 Sample(s) Required between	12/1/2026	and	12/31/2026

TOTAL CHLORINE - 1000

10 Sample(s) Required between	1/1/2026	and	1/31/2026
10 Sample(s) Required between	2/1/2026	and	2/28/2026
10 Sample(s) Required between	3/1/2026	and	3/31/2026
10 Sample(s) Required between	4/1/2026	and	4/30/2026
10 Sample(s) Required between	5/1/2026	and	5/31/2026
10 Sample(s) Required between	6/1/2026	and	6/30/2026
10 Sample(s) Required between	7/1/2026	and	7/31/2026
10 Sample(s) Required between	8/1/2026	and	8/31/2026
10 Sample(s) Required between	9/1/2026	and	9/30/2026
10 Sample(s) Required between	10/1/2026	and	10/31/2026
10 Sample(s) Required between	11/1/2026	and	11/30/2026
10 Sample(s) Required between	12/1/2026	and	12/31/2026

**Samples should be collected at the same time and place as the Total Coliform samples.**

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

**Chemicals**
**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>7792 ST. RT. 309</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS202</b>	<b>199 SIXTH ST.</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS202
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS202
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS202
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS202

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS203</b>	<b>1222 ST. RT. 598</b>

**Chemicals**
**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS203
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS203
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS203

**OH1700211 GALION CITY**

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS203</b>	<b>1222 ST. RT. 598</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS203

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>GALION CITY DISTRIBUTION</b>
	SMP ID: <b>DS204</b>	<b>1351 FREESEWORKS (HYDRANT)</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS204

Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS204

Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS204

Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS204

*Sample for all the analytes listed below:*

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

**OH1700612 SPRING VALLEY MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>1753662</b>	Facility Name: <b>SPRING VALLEY MHC</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

<b>Chemicals</b>	<b>Monitoring Requirements</b>	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026
INORGANICS	1 Sample(s) Required between	6/1/2026 and 10/31/2026
<u>Sample for all the analytes listed below:</u>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2026 and 5/31/2026
<u>Sample for all the analytes listed below:</u>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2026 and 10/31/2026

**OH1700612 SPRING VALLEY MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*
**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.
**For water emergencies that occur after hours, please call 800-282-9378**
**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**
**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SPRING VALLEY MHC DISTRIBUTION SYSTEM</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>SPRING VALLEY MHC DISTRIBUTION SYSTEM</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

**Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.**

---

**OH1700612 SPRING VALLEY MOBILE HOME PARK**

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*

---

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2026**

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1** Facility Name: **SPRING VALLEY MHC DISTRIBUTION SYSTEM**

**Location** SMP ID: **DS201** **OUTSIDE TAP - 5913 SPRING VALLEY COURT**

---

**Chemicals**

**Monitoring Requirements**

---

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

**TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950**

*A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.*

**OH1730812 CRAWFORD COUNTY FISH AND GAME PWS**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 1/1 to 12/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: CRAWFORD CNTY CONSERVATI DISTRIBUTION**  
**Location SMP ID: DS000      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

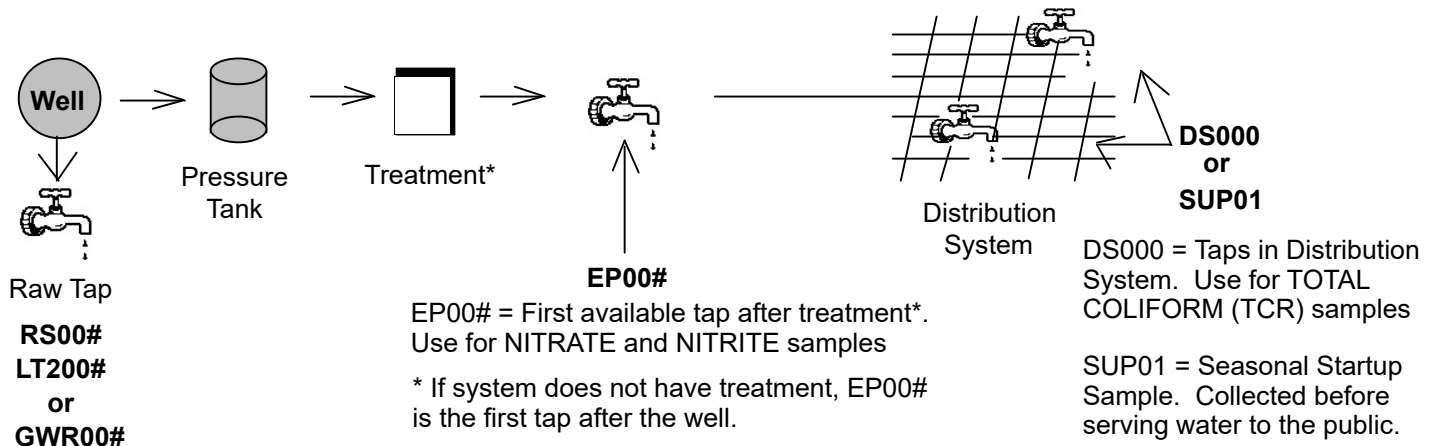

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1730812 CRAWFORD COUNTY FISH AND GAME PWS**

System Type: Transient Noncommunity Source: Ground Water  
*Ground Water Rule Minimal Treatment System*

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1753672	<b>Facility Name:</b> CRAWFORD COUNTY CONSERVATION LEAGUE
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

<b>Chemicals</b>	<b>Monitoring Requirements</b>
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System

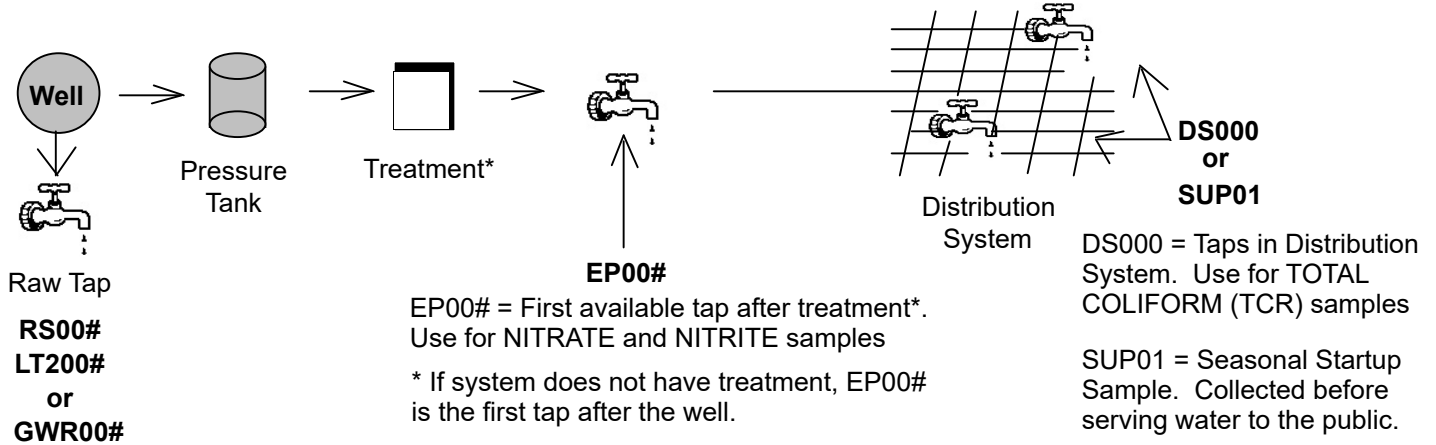

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1731012 FOXFIRE FAMILY FUN PARK**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 1/1 to 12/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1**      Facility Name: **FOXFIRE FAMILY FUN PARK DISTRIBUTION**  
**Location** SMP ID: **SUP01**      Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\**

**Where to Collect Samples For a Small Public Water System**

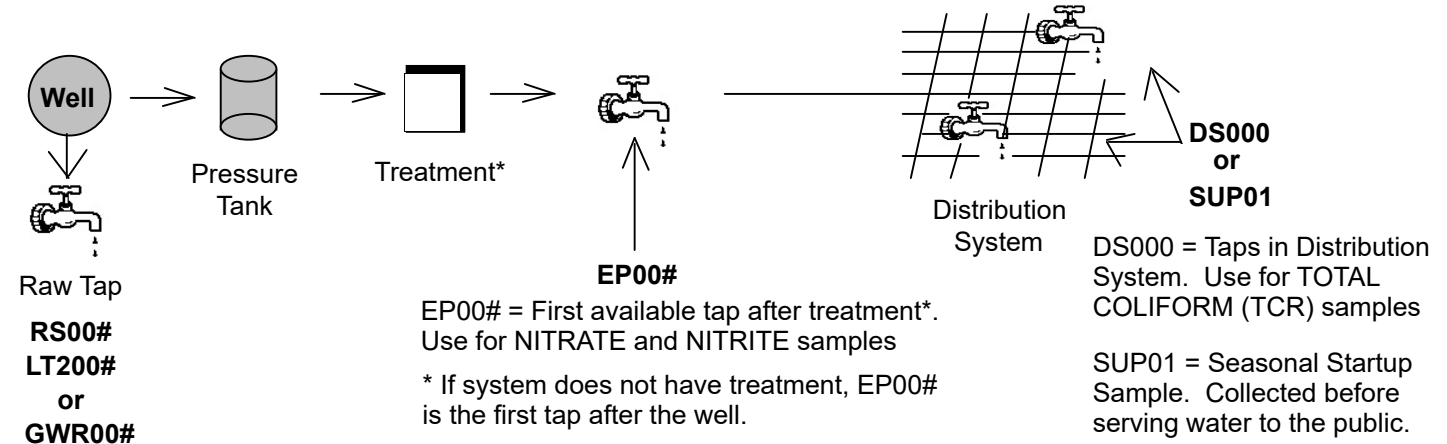

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1731012 FOXFIRE FAMILY FUN PARK**

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Minimal Treatment System*
**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**
**DISTRIBUTION MONITORING SCHEDULE**
**Sampling Facility ID: DS1 Facility Name: FOXFIRE FAMILY FUN PARK DISTRIBUTION**
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

## Where to Collect Samples For a Small Public Water System

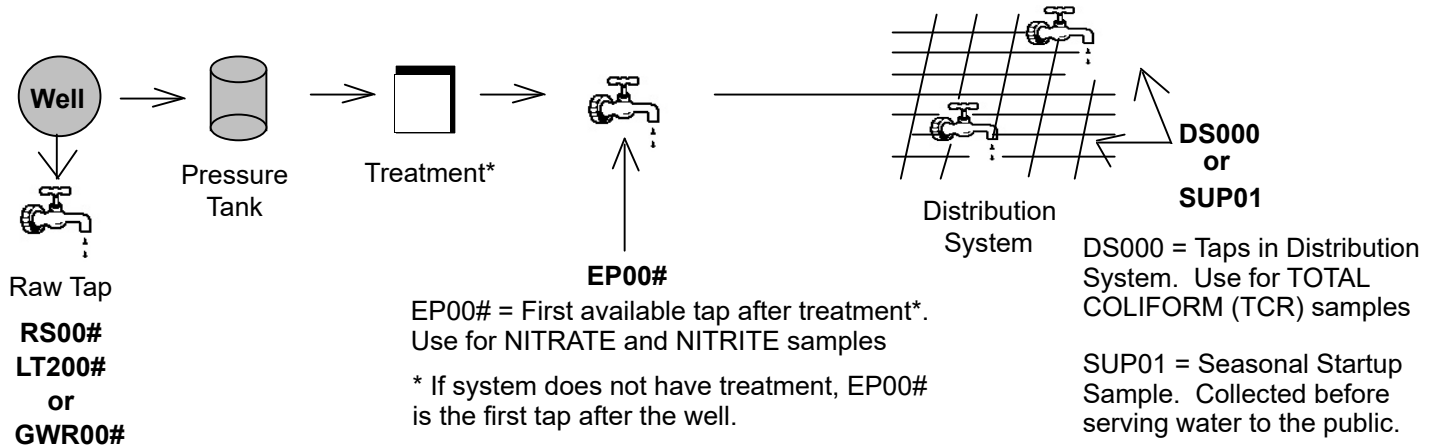

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1731012 FOXFIRE FAMILY FUN PARK**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 1/1 to 12/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: 1753673	Facility Name: <b>FOXFIRE FAMILY FUN PARK</b>
<b>Location</b>	SMP ID: EP001	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System

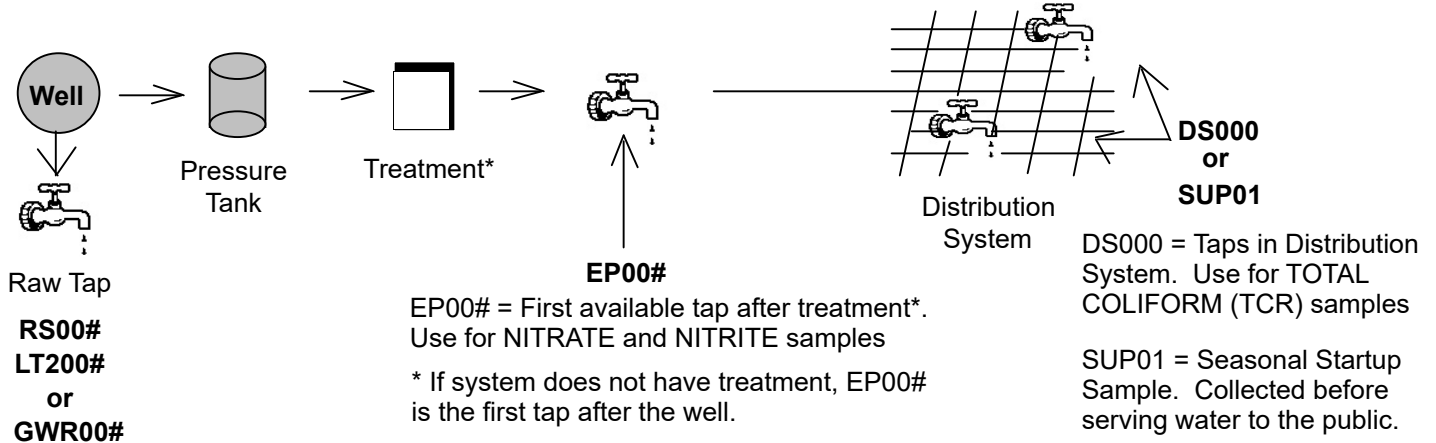

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1733612 ST PAUL LUTHERAN CH - NORTH ROBINSON**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 1/1 to 12/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: ST PAUL LUTHERAN CHURCH - NORTH ROBINSON**  
**Location SMP ID: DS000      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

**Where to Collect Samples For a Small Public Water System**

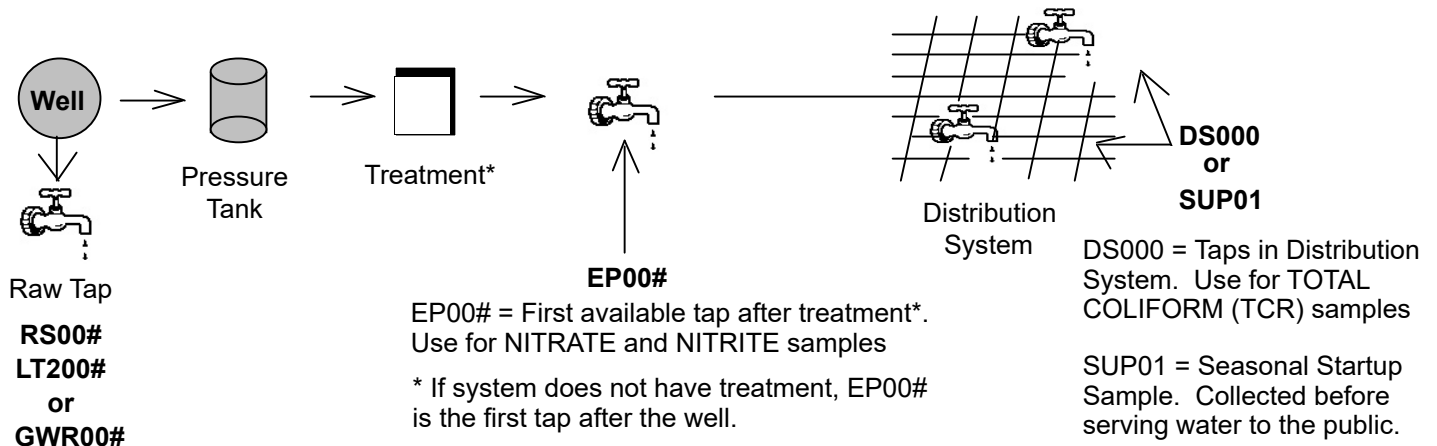

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1733612 ST PAUL LUTHERAN CH - NORTH ROBINSON**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 1/1 to 12/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.  
 Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>1753683</b>	Facility Name: <b>SAINT PAULS LUTHERAN CHURCH</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System

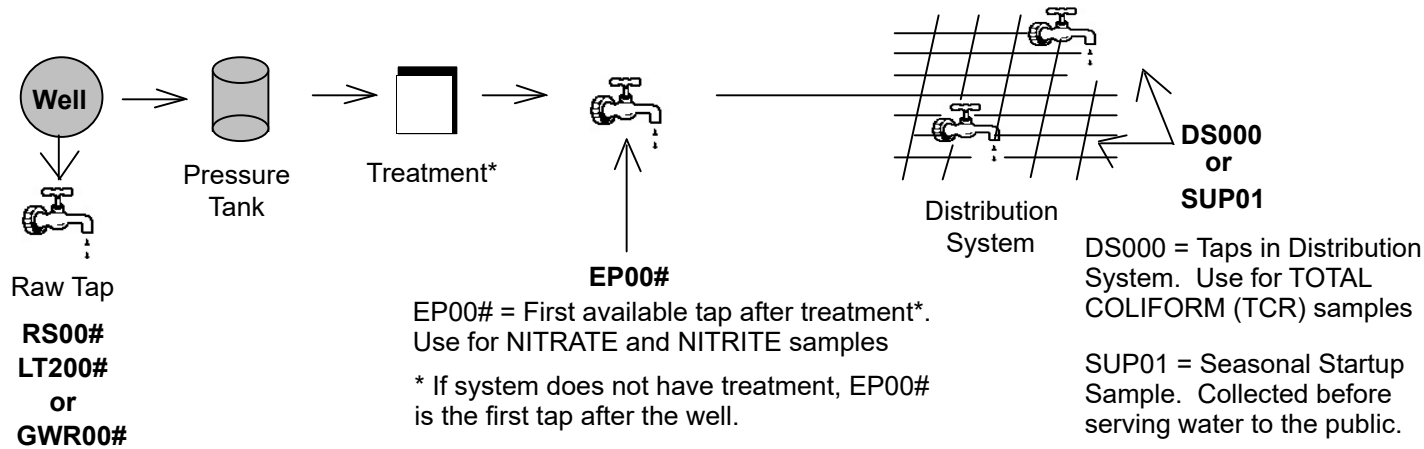

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1733912 SUNSET SPRINGS CAMPGROUND - S WELL**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 4/1 to 10/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling** Facility ID: **DS1**      Facility Name: **SUNSET SPRING-SOUTH WELL DISTRIBUTION**  
**Location** SMP ID: **SUP01**      Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\**

**Where to Collect Samples For a Small Public Water System**

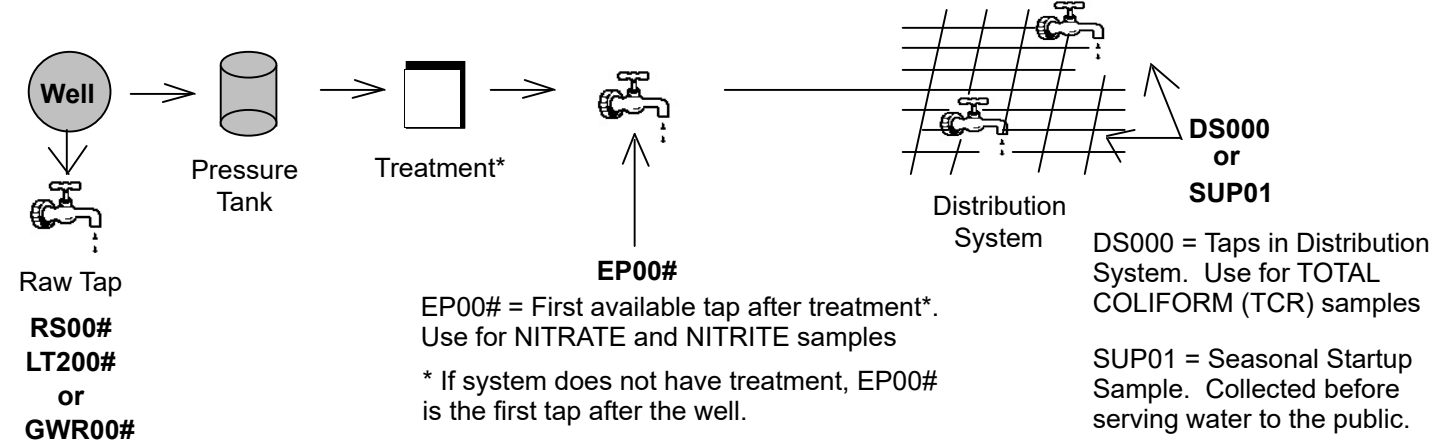

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1733912 SUNSET SPRINGS CAMPGROUND - S WELL**

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

*Ground Water Rule Minimal Treatment System*
**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**
**DISTRIBUTION MONITORING SCHEDULE**
**Sampling Facility ID: DS1 Facility Name: SUNSET SPRING-SOUTH WELL DISTRIBUTION**
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/25/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

## Where to Collect Samples For a Small Public Water System

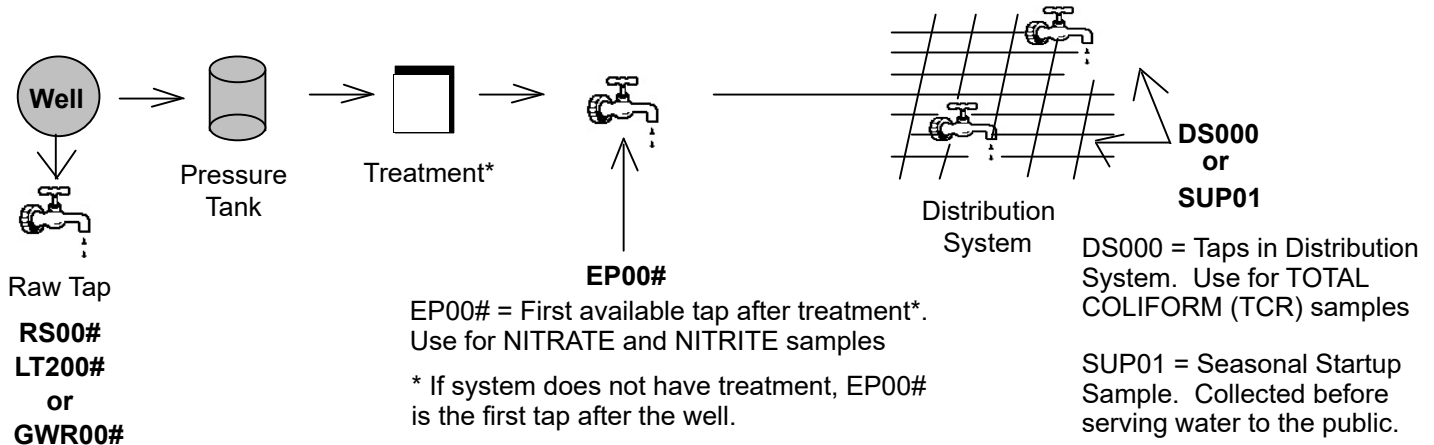

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1733912 SUNSET SPRINGS CAMPGROUND - S WELL**

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1753686	<b>Facility Name:</b> SUNSET SPRING SOUTH WELL
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

**Where to Collect Samples For a Small Public Water System**

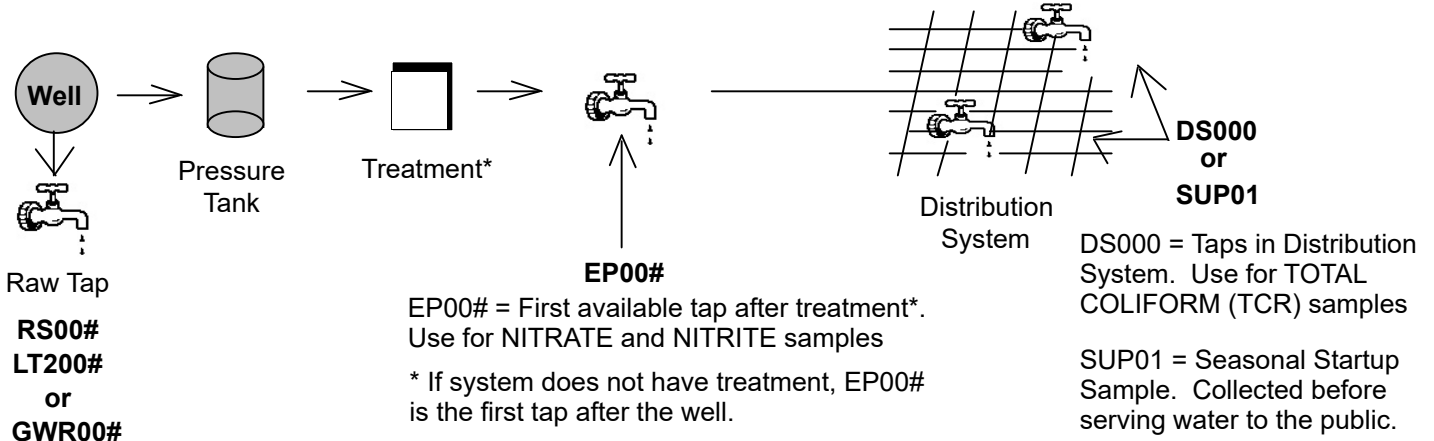

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1734712 VALLEY VIEW GOLF COURSE**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System*
**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**
**Sampling Facility ID: DS1 Facility Name: VALLEY VIEW GOLF COURSE DISTRIBUTION**
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

## Where to Collect Samples For a Small Public Water System

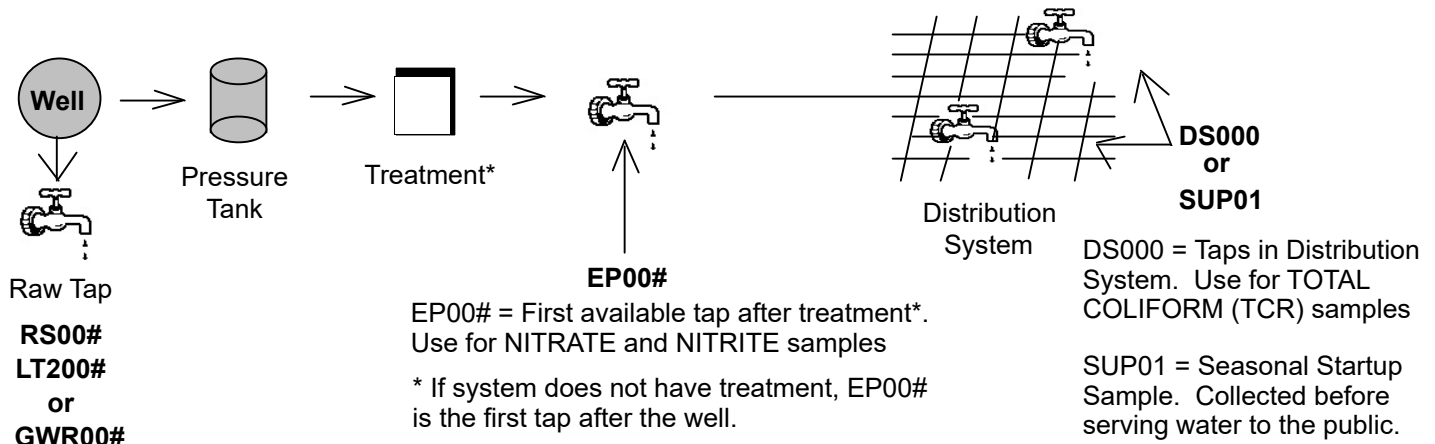

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1734712 VALLEY VIEW GOLF COURSE**

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>1753689</b>	Facility Name: <b>VALLEY VIEW GOLF COURSE</b>
<b>Location</b>	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>

<b>Chemicals</b>	<b>Monitoring Requirements</b>
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

### Where to Collect Samples For a Small Public Water System

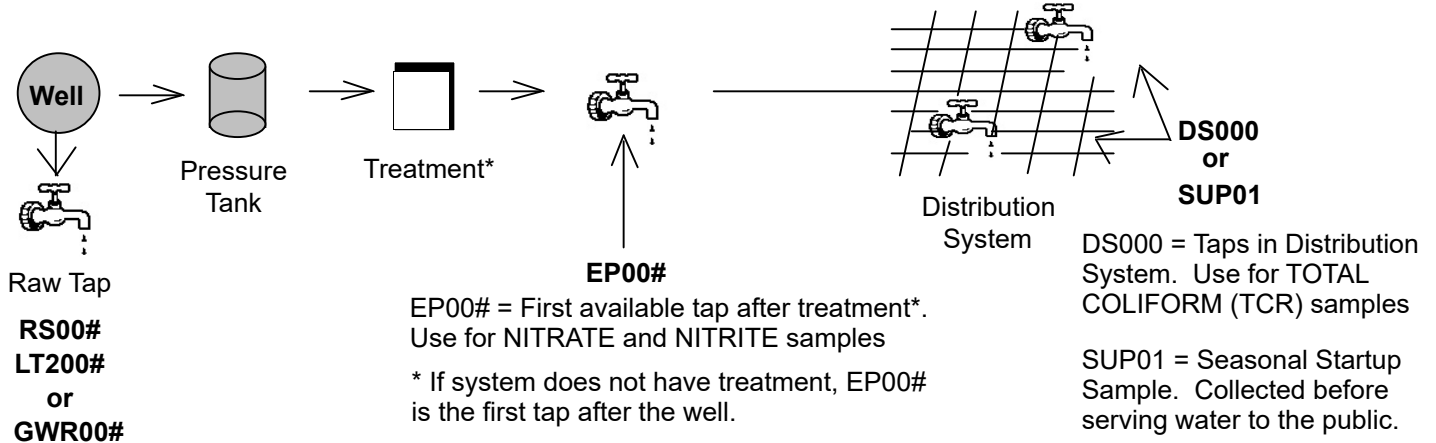

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1736912 SUNSET SPRINGS CAMPGROUND -N WELL**

System Type: Transient Noncommunity      Source: Ground Water      Operating Period: 4/1 to 10/31  
*Ground Water Rule Minimal Treatment System*

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**DISTRIBUTION MONITORING SCHEDULE**

**Sampling Facility ID: DS1      Facility Name: SUNSET SPRING-NORTH WELL DISTRIBUTION**  
**Location SMP ID: SUP01      Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\**

**Where to Collect Samples For a Small Public Water System**

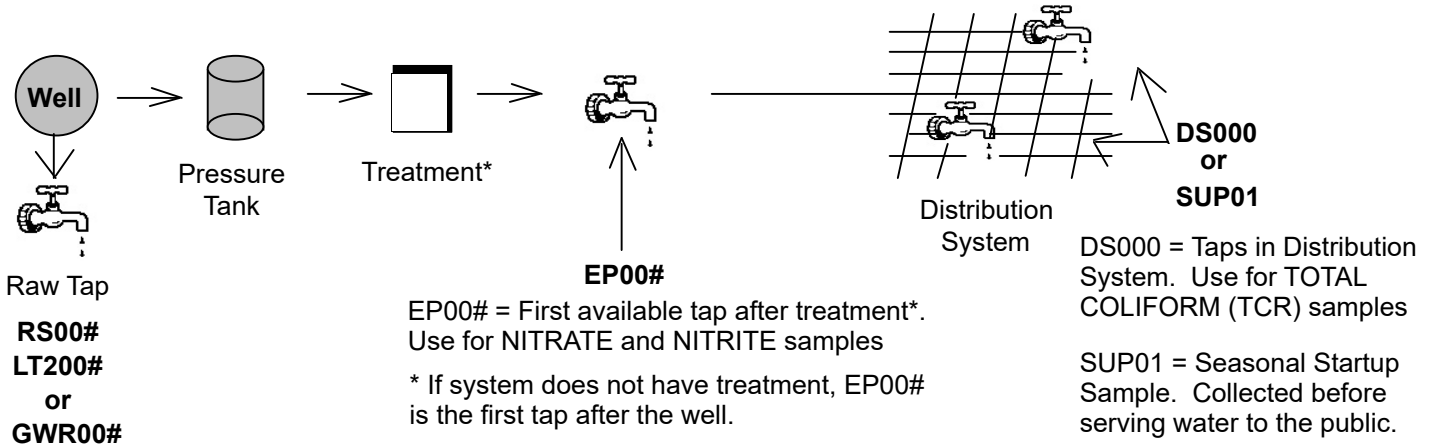

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1736912 SUNSET SPRINGS CAMPGROUND -N WELL**

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

*Ground Water Rule Minimal Treatment System*
**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**
**DISTRIBUTION MONITORING SCHEDULE**
**Sampling Facility ID: DS1 Facility Name: SUNSET SPRING-NORTH WELL DISTRIBUTION**
**Location SMP ID: DS000 Facility Source: Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/25/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

## Where to Collect Samples For a Small Public Water System

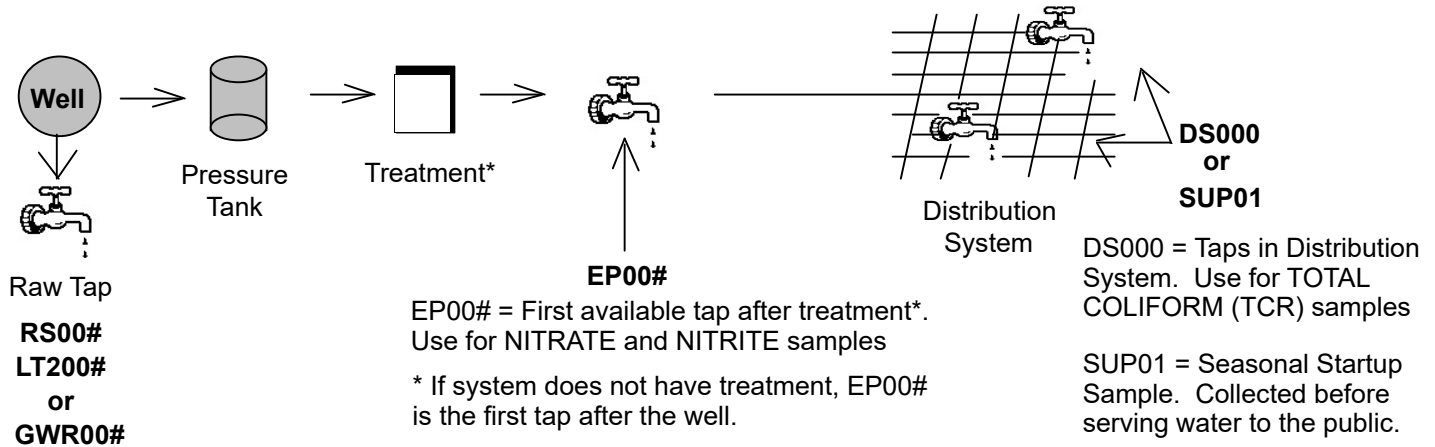

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**

**OH1736912 SUNSET SPRINGS CAMPGROUND -N WELL**

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 1753703	<b>Facility Name:</b> SUNSET SPRING NORTH WELL
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

**Where to Collect Samples For a Small Public Water System**

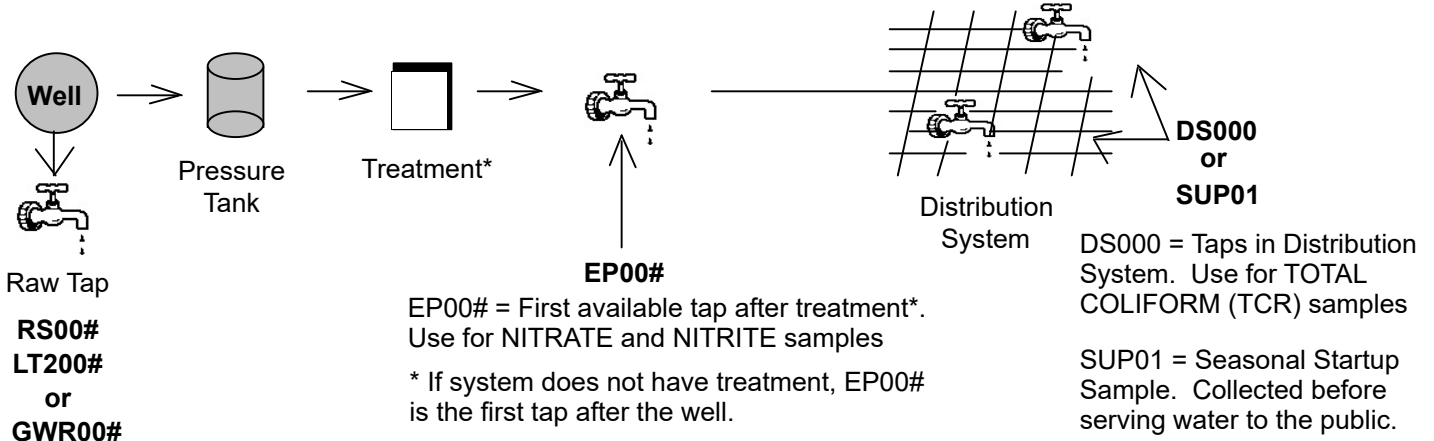

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:**

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

**Save a dime. Sample on time!**