

Subject: 2026 PWS Monitoring Schedules Now Available

Dear Public Water System (PWS) Owner:

The 2026 Contaminant Monitoring Schedules have been created and are now available online at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

The distribution requirements only need to be met by your overall system, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
 - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
 - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
 - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

Subscribe to Updates: Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

For Transient Non-Community (TNC) PWSs Only

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Southeast District Office at: 740-385-8501
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)



OH410003 ADENA VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ADENA, VILLAGE OF DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.



OH410003 ADENA VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: ADENA, VILLAGE OF DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: ADENA, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: ADENA, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4100412 BRILLIANT WATER AND SEWER

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155308	Facility Name: BRILLIANT WATER AND SEWER DIST
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4100412 BRILLIANT WATER AND SEWER

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: BRILLIANT WATER & SEWER DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: BRILLIANT WATER & SEWER DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2026 and 6/30/2026 20 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4100412 BRILLIANT WATER AND SEWER

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BRILLIANT WATER & SEWER DISTRIBUTION

Location SMP ID: DS201 1415 HILL STREET

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: BRILLIANT WATER & SEWER DISTRIBUTION

Location SMP ID: DS202 1050 THIRD STREET

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4100512 DILLONVALE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155309	Facility Name: DILLONVALE
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4100512 DILLONVALE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: DILLONVALE DISTRIBUTION	SMP ID: DS000
Chemicals	Monitoring Requirements	
ASBESTOS - 1094		Not Required
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: DILLONVALE DISTRIBUTION	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs
Chemicals	Monitoring Requirements	
LEAD - 1030 AND COPPER - 1022		Not Required



OH4100512 DILLONVALE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DILLONVALE DISTRIBUTION

Location SMP ID: DS201 135 SCHOOL STREET

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: DILLONVALE DISTRIBUTION

Location SMP ID: DS202 153 MAIN STREET

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4100803 JEFFERSON CO W AND S DISTRICT- A

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO. SAN. DIST. A DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2026 and 1/31/2026 3 Sample(s) Required between 2/1/2026 and 2/28/2026 3 Sample(s) Required between 3/1/2026 and 3/31/2026 3 Sample(s) Required between 4/1/2026 and 4/30/2026 3 Sample(s) Required between 5/1/2026 and 5/31/2026 3 Sample(s) Required between 6/1/2026 and 6/30/2026 3 Sample(s) Required between 7/1/2026 and 7/31/2026 3 Sample(s) Required between 8/1/2026 and 8/31/2026 3 Sample(s) Required between 9/1/2026 and 9/30/2026 3 Sample(s) Required between 10/1/2026 and 10/31/2026 3 Sample(s) Required between 11/1/2026 and 11/30/2026 3 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2026 and 1/31/2026 3 Sample(s) Required between 2/1/2026 and 2/28/2026 3 Sample(s) Required between 3/1/2026 and 3/31/2026 3 Sample(s) Required between 4/1/2026 and 4/30/2026 3 Sample(s) Required between 5/1/2026 and 5/31/2026 3 Sample(s) Required between 6/1/2026 and 6/30/2026 3 Sample(s) Required between 7/1/2026 and 7/31/2026 3 Sample(s) Required between 8/1/2026 and 8/31/2026 3 Sample(s) Required between 9/1/2026 and 9/30/2026 3 Sample(s) Required between 10/1/2026 and 10/31/2026 3 Sample(s) Required between 11/1/2026 and 11/30/2026 3 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO. SAN. DIST. A DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 1/1/2026 and 6/30/2026
-------------------------------	---



OH4100803 JEFFERSON CO W AND S DISTRICT- A

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO. SAN. DIST. A DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	40 Sample(s) Required between 7/1/2026 and 12/31/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO. SAN. DIST. A DISTRIBUTION
Location	SMP ID: DS201	514 STATE ROUTE 151

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO. SAN. DIST. A DISTRIBUTION
Location	SMP ID: DS202	8260 STATE ROUTE 151

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4100903 JEFFERSON CO.SAN.DIST.-G PWS

System Type: Community

Source: Purchased Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** **** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-G DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-G DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-G DISTRIBUTION
	SMP ID: DS201	12320 SR 150 RAYLAND OH

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4100903 JEFFERSON CO.SAN.DIST.-G PWS

System Type: Community

Source: Purchased Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-G DISTRIBUTION
Location	SMP ID: DS202	6021 CR 15 RAYLAND OH

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101003 JEFFERSON CO W&S DISTRICT- J

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-J DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-J DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-J DISTRIBUTION
	SMP ID: DS201	61 COUNTY ROAD 28

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS201
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS201
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS201
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101003 JEFFERSON CO W&S DISTRICT- J

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-J DISTRIBUTION
Location	SMP ID: DS202	607 WILLIAMS BLVD

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2026 and 2/14/2026 at: DS202
	Dual Sample Required between 5/8/2026 and 5/14/2026 at: DS202
	Dual Sample Required between 8/8/2026 and 8/14/2026 at: DS202
	Dual Sample Required between 11/8/2026 and 11/14/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101103 JEFFERSON CO W AND S DISTRICT - M

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2026 and 1/31/2026
	15 Sample(s) Required between 2/1/2026 and 2/28/2026
	15 Sample(s) Required between 3/1/2026 and 3/31/2026
	15 Sample(s) Required between 4/1/2026 and 4/30/2026
	15 Sample(s) Required between 5/1/2026 and 5/31/2026
	15 Sample(s) Required between 6/1/2026 and 6/30/2026
	15 Sample(s) Required between 7/1/2026 and 7/31/2026
	15 Sample(s) Required between 8/1/2026 and 8/31/2026
	15 Sample(s) Required between 9/1/2026 and 9/30/2026
	15 Sample(s) Required between 10/1/2026 and 10/31/2026
	15 Sample(s) Required between 11/1/2026 and 11/30/2026
	15 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	15 Sample(s) Required between 1/1/2026 and 1/31/2026
	15 Sample(s) Required between 2/1/2026 and 2/28/2026
	15 Sample(s) Required between 3/1/2026 and 3/31/2026
	15 Sample(s) Required between 4/1/2026 and 4/30/2026
	15 Sample(s) Required between 5/1/2026 and 5/31/2026
	15 Sample(s) Required between 6/1/2026 and 6/30/2026
	15 Sample(s) Required between 7/1/2026 and 7/31/2026
	15 Sample(s) Required between 8/1/2026 and 8/31/2026
	15 Sample(s) Required between 9/1/2026 and 9/30/2026
	15 Sample(s) Required between 10/1/2026 and 10/31/2026
	15 Sample(s) Required between 11/1/2026 and 11/30/2026
	15 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.



OH4101103 JEFFERSON CO W AND S DISTRICT - M

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs
Chemicals		Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between	6/1/2026 and 9/30/2026
<i>Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems.</i>		
Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: DS201	PORT HOMER 1850 CR 68 TORONTO
Chemicals		Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2026 and 1/14/2026 at: DS201
	Dual Sample Required between	4/8/2026 and 4/14/2026 at: DS201
	Dual Sample Required between	7/8/2026 and 7/14/2026 at: DS201
	Dual Sample Required between	10/8/2026 and 10/14/2026 at: DS201
<i>Sample for all the analytes listed below:</i>		
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TTHM - 2950		
<i>A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.</i>		
Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: DS202	VFW 412 LIBERTY ST. AMSTERDAM
Chemicals		Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2026 and 1/14/2026 at: DS202
	Dual Sample Required between	4/8/2026 and 4/14/2026 at: DS202
	Dual Sample Required between	7/8/2026 and 7/14/2026 at: DS202
	Dual Sample Required between	10/8/2026 and 10/14/2026 at: DS202
<i>Sample for all the analytes listed below:</i>		
TOTAL HALOACETIC ACIDS (HAA5) - 2456 and TTHM - 2950		
<i>A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.</i>		
Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: DS203	SCHOOL HOUSE RD. IRONDALE
Chemicals		Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2026 and 1/14/2026 at: DS203
	Dual Sample Required between	4/8/2026 and 4/14/2026 at: DS203
	Dual Sample Required between	7/8/2026 and 7/14/2026 at: DS203



OH4101103 JEFFERSON CO W AND S DISTRICT - M

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: DS203	SCHOOL HOUSE RD. IRONDALE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS203

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: DS204	1592 SR 213 STEUBENVILLE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS204
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS204
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS204
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS204

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-M DISTRIBUTION
Location	SMP ID: MM001	5235 COUNTY ROAD 45 STEUBENVILLE, OH

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2026 and 1/14/2026 at: MM001
	1 Sample(s) Required between 4/8/2026 and 4/14/2026 at: MM001
	1 Sample(s) Required between 7/8/2026 and 7/14/2026 at: MM001
	1 Sample(s) Required between 10/8/2026 and 10/14/2026 at: MM001

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101203 JEFFERSON CO W&S DISTRICT- O

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** **** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-O DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-O DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4101203 JEFFERSON CO W&S DISTRICT- O

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO.SAN.DIST.-O DISTRIBUTION
Location	SMP ID: DS201	490 POWELLS LANE
Chemicals		Monitoring Requirements
DISINFECTION BYPRODUCTS		Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
		Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
		Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
		Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101612 MINGO JUNCTION PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155316	Facility Name: MINGO JUNCTION WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4101612 MINGO JUNCTION PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: MINGO JUNCTION DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		4 Sample(s) Required between 1/1/2026 and 1/31/2026 4 Sample(s) Required between 2/1/2026 and 2/28/2026 4 Sample(s) Required between 3/1/2026 and 3/31/2026 4 Sample(s) Required between 4/1/2026 and 4/30/2026 4 Sample(s) Required between 5/1/2026 and 5/31/2026 4 Sample(s) Required between 6/1/2026 and 6/30/2026 4 Sample(s) Required between 7/1/2026 and 7/31/2026 4 Sample(s) Required between 8/1/2026 and 8/31/2026 4 Sample(s) Required between 9/1/2026 and 9/30/2026 4 Sample(s) Required between 10/1/2026 and 10/31/2026 4 Sample(s) Required between 11/1/2026 and 11/30/2026 4 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		4 Sample(s) Required between 1/1/2026 and 1/31/2026 4 Sample(s) Required between 2/1/2026 and 2/28/2026 4 Sample(s) Required between 3/1/2026 and 3/31/2026 4 Sample(s) Required between 4/1/2026 and 4/30/2026 4 Sample(s) Required between 5/1/2026 and 5/31/2026 4 Sample(s) Required between 6/1/2026 and 6/30/2026 4 Sample(s) Required between 7/1/2026 and 7/31/2026 4 Sample(s) Required between 8/1/2026 and 8/31/2026 4 Sample(s) Required between 9/1/2026 and 9/30/2026 4 Sample(s) Required between 10/1/2026 and 10/31/2026 4 Sample(s) Required between 11/1/2026 and 11/30/2026 4 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: MINGO JUNCTION DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		20 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4101612 MINGO JUNCTION PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MINGO JUNCTION DISTRIBUTION

Location SMP ID: DS201 9 RED DONLEY PLAZA

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: MINGO JUNCTION DISTRIBUTION

Location SMP ID: DS202 2506 COMMERCIAL STREET

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101712 MOUNT PLEASANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155317	Facility Name: MOUNT PLEASANT
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4101712 MOUNT PLEASANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: MOUNT PLEASANT DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: MOUNT PLEASANT DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2026 and 6/30/2026 10 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4101712 MOUNT PLEASANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MOUNT PLEASANT DISTRIBUTION

Location SMP ID: DS201 154 UNION ST

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4101803 RAYLAND VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RAYLAND, VILLAGE OF DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: RAYLAND, VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4101803 RAYLAND VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: RAYLAND, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	142 WARREN ST. (DAIRY QUEEN)

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155322	Facility Name: STEUBENVILLE CITY
Location	SMP ID: EP001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2026 and 1/31/2026 1 Paired Sample Set Required between 2/1/2026 and 2/28/2026 1 Paired Sample Set Required between 3/1/2026 and 3/31/2026 1 Paired Sample Set Required between 4/1/2026 and 4/30/2026 1 Paired Sample Set Required between 5/1/2026 and 5/31/2026 1 Paired Sample Set Required between 6/1/2026 and 6/30/2026 1 Paired Sample Set Required between 7/1/2026 and 7/31/2026 1 Paired Sample Set Required between 8/1/2026 and 8/31/2026 1 Paired Sample Set Required between 9/1/2026 and 9/30/2026 1 Paired Sample Set Required between 10/1/2026 and 10/31/2026 1 Paired Sample Set Required between 11/1/2026 and 11/30/2026



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155322	Facility Name: STEUBENVILLE CITY
Location	SMP ID: EP001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 12/1/2026 and 12/31/2026
----------------------------	---

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155322	Facility Name: STEUBENVILLE CITY
Location	SMP ID: EP001/LT200 Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

See Instructions Below

Please refer to the HAB website for any questions on sampling or monitoring requirements:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

Current monitoring schedules can be found at:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155322	Facility Name: STEUBENVILLE CITY
Location	SMP ID: LT2001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

CYANOBACTERIA SCREENING

See Instructions Below

Please refer to the HAB website for any questions on sampling or monitoring requirements:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

Current monitoring schedules can be found at:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION	SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100			15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000			15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022			30 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION
Location	SMP ID: DS201	4531 SUNSET BLVD.

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION
Location	SMP ID: DS202	4141 MALL DR.

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS202
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS202
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS202
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION
Location	SMP ID: DS203	575 LOVERS LANE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS203
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS203
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS203
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS203

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION
Location	SMP ID: DS204	1332 ADAMS STREET

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS204
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS204
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS204



OH4102411 STEUBENVILLE, CITY OF

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: STEUBENVILLE, CITY OF DISTRIBUTION
Location	SMP ID: DS204	1332 ADAMS STREET

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS204

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4102512 STRATTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155323	Facility Name: STRATTON
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
DIOXIN - 2063	Not Required
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4102512 STRATTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: STRATTON DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: STRATTON DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4102512 STRATTON PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STRATTON DISTRIBUTION

Location SMP ID: DS201 136 THIED STREET

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4102712 TILTONSVILLE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155324	Facility Name: TILTONSVILLE
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4102712 TILTONSVILLE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: TILTONSVILLE DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: TILTONSVILLE DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		20 Sample(s) Required between 1/1/2026 and 6/30/2026 20 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4102712 TILTONSVILLE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: TILTONSVILLE DISTRIBUTION
Location	SMP ID: DS201 612 WALDEN AVE	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: TILTONSVILLE DISTRIBUTION
Location	SMP ID: DS202 213 GRANDVIEW AVE	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155325	Facility Name: TORONTO
Location	SMP ID: EP001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2026 and 5/31/2026
<i>Sample for all the analytes listed below:</i>	
<i>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</i>	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>	
<i>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</i>	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2026 and 5/31/2026
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2026 and 1/31/2026 1 Paired Sample Set Required between 2/1/2026 and 2/28/2026 1 Paired Sample Set Required between 3/1/2026 and 3/31/2026 1 Paired Sample Set Required between 4/1/2026 and 4/30/2026 1 Paired Sample Set Required between 5/1/2026 and 5/31/2026 1 Paired Sample Set Required between 6/1/2026 and 6/30/2026 1 Paired Sample Set Required between 7/1/2026 and 7/31/2026 1 Paired Sample Set Required between 8/1/2026 and 8/31/2026 1 Paired Sample Set Required between 9/1/2026 and 9/30/2026 1 Paired Sample Set Required between 10/1/2026 and 10/31/2026 1 Paired Sample Set Required between 11/1/2026 and 11/30/2026



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155325	Facility Name: TORONTO
Location	SMP ID: EP001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 12/1/2026 and 12/31/2026
----------------------------	---

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155325	Facility Name: TORONTO
Location	SMP ID: EP001/LT200 Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

See Instructions Below

Please refer to the HAB website for any questions on sampling or monitoring requirements:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

Current monitoring schedules can be found at:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155325	Facility Name: TORONTO
Location	SMP ID: LT2001	Facility Source: Surface Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals

Monitoring Requirements

CYANOBACTERIA SCREENING

See Instructions Below

Please refer to the HAB website for any questions on sampling or monitoring requirements:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>

Current monitoring schedules can be found at:

<https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/seasonal-hab-monitoring-schedule>



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: TORONTO DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	6 Sample(s) Required between 1/1/2026 and 1/31/2026 6 Sample(s) Required between 2/1/2026 and 2/28/2026 6 Sample(s) Required between 3/1/2026 and 3/31/2026 6 Sample(s) Required between 4/1/2026 and 4/30/2026 6 Sample(s) Required between 5/1/2026 and 5/31/2026 6 Sample(s) Required between 6/1/2026 and 6/30/2026 6 Sample(s) Required between 7/1/2026 and 7/31/2026 6 Sample(s) Required between 8/1/2026 and 8/31/2026 6 Sample(s) Required between 9/1/2026 and 9/30/2026 6 Sample(s) Required between 10/1/2026 and 10/31/2026 6 Sample(s) Required between 11/1/2026 and 11/30/2026 6 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	6 Sample(s) Required between 1/1/2026 and 1/31/2026 6 Sample(s) Required between 2/1/2026 and 2/28/2026 6 Sample(s) Required between 3/1/2026 and 3/31/2026 6 Sample(s) Required between 4/1/2026 and 4/30/2026 6 Sample(s) Required between 5/1/2026 and 5/31/2026 6 Sample(s) Required between 6/1/2026 and 6/30/2026 6 Sample(s) Required between 7/1/2026 and 7/31/2026 6 Sample(s) Required between 8/1/2026 and 8/31/2026 6 Sample(s) Required between 9/1/2026 and 9/30/2026 6 Sample(s) Required between 10/1/2026 and 10/31/2026 6 Sample(s) Required between 11/1/2026 and 11/30/2026 6 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: TORONTO DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH4102811 TORONTO PWS

System Type: Community

Source: Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: TORONTO DISTRIBUTION

Location SMP ID: DS201 1307 DENNIS WAY

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: TORONTO DISTRIBUTION

Location SMP ID: DS202 523 NEBO DRIVE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4102903 WARREN WATER AUTHORITY

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WARREN WATER AUTHORITY DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: WARREN WATER AUTHORITY DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2026 and 6/30/2026
-------------------------------	--



OH4102903 WARREN WATER AUTHORITY

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WARREN WATER AUTHORITY DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 7/1/2026 and 12/31/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: WARREN WATER AUTHORITY DISTRIBUTION
Location	SMP ID: DS201	58581 ILEEN ST

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM – 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4103003 WINTERSVILLE VILLAGE PWS

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WINTERSVILLE, VILLAGE OF DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2026 and 1/31/2026
	4 Sample(s) Required between 2/1/2026 and 2/28/2026
	4 Sample(s) Required between 3/1/2026 and 3/31/2026
	4 Sample(s) Required between 4/1/2026 and 4/30/2026
	4 Sample(s) Required between 5/1/2026 and 5/31/2026
	4 Sample(s) Required between 6/1/2026 and 6/30/2026
	4 Sample(s) Required between 7/1/2026 and 7/31/2026
	4 Sample(s) Required between 8/1/2026 and 8/31/2026
	4 Sample(s) Required between 9/1/2026 and 9/30/2026
	4 Sample(s) Required between 10/1/2026 and 10/31/2026
	4 Sample(s) Required between 11/1/2026 and 11/30/2026
	4 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2026 and 1/31/2026
	4 Sample(s) Required between 2/1/2026 and 2/28/2026
	4 Sample(s) Required between 3/1/2026 and 3/31/2026
	4 Sample(s) Required between 4/1/2026 and 4/30/2026
	4 Sample(s) Required between 5/1/2026 and 5/31/2026
	4 Sample(s) Required between 6/1/2026 and 6/30/2026
	4 Sample(s) Required between 7/1/2026 and 7/31/2026
	4 Sample(s) Required between 8/1/2026 and 8/31/2026
	4 Sample(s) Required between 9/1/2026 and 9/30/2026
	4 Sample(s) Required between 10/1/2026 and 10/31/2026
	4 Sample(s) Required between 11/1/2026 and 11/30/2026
	4 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: WINTERSVILLE, VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



OH4103003 WINTERSVILLE VILLAGE PWS

System Type: Community

Source: Purchased Surface Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WINTERSVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	360 ORCHARD PLACE

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS201
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS201
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS201
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: WINTERSVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202	119 WOODLAND PARK

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2026 and 1/14/2026 at: DS202
	Dual Sample Required between 4/8/2026 and 4/14/2026 at: DS202
	Dual Sample Required between 7/8/2026 and 7/14/2026 at: DS202
	Dual Sample Required between 10/8/2026 and 10/14/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4103112 YORKVILLE VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** **** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: YORKVILLE, VILLAGE OF DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: YORKVILLE, VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4103112 YORKVILLE VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: YORKVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	1001 DEEP RUN

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: YORKVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202	139 MARKET

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4103212 DOLLAR GENERAL #12517 - AMSTERDAM

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DOLLAR GENERAL AMSTERDAM DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

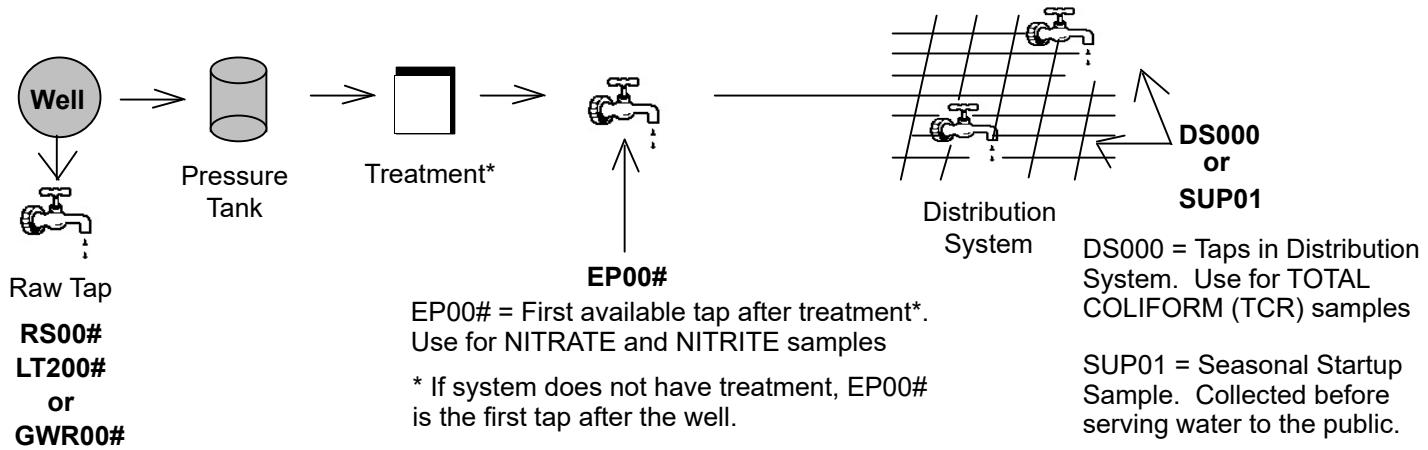

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4103212 DOLLAR GENERAL #12517 - AMSTERDAM

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4162437 Facility Name: DOLLAR GENERAL STORE AMSTERDAM
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

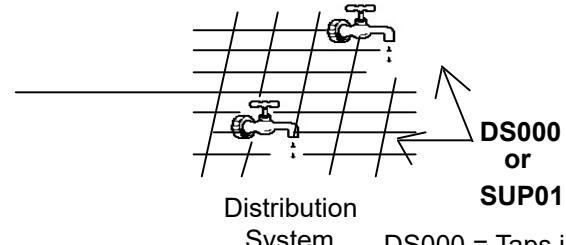

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130012 ODOT-REST AREA 11-2 PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODOT-REST AREA 11-2 DISTRIBUTION


Location SMP ID: DS000 Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

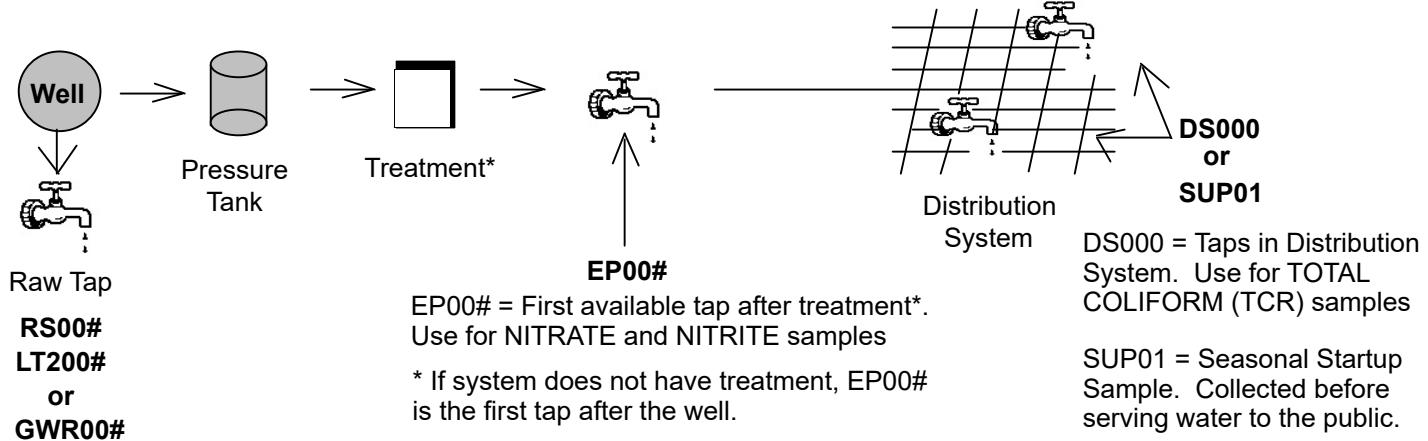

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130012 ODOT-REST AREA 11-2 PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155329 Facility Name: **ODOT REST AREA 11-2**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

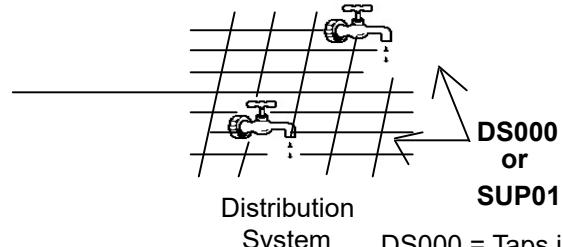

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130212 AUSTIN LAKE

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 5/1 to 9/30

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: AUSTIN LAKE DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

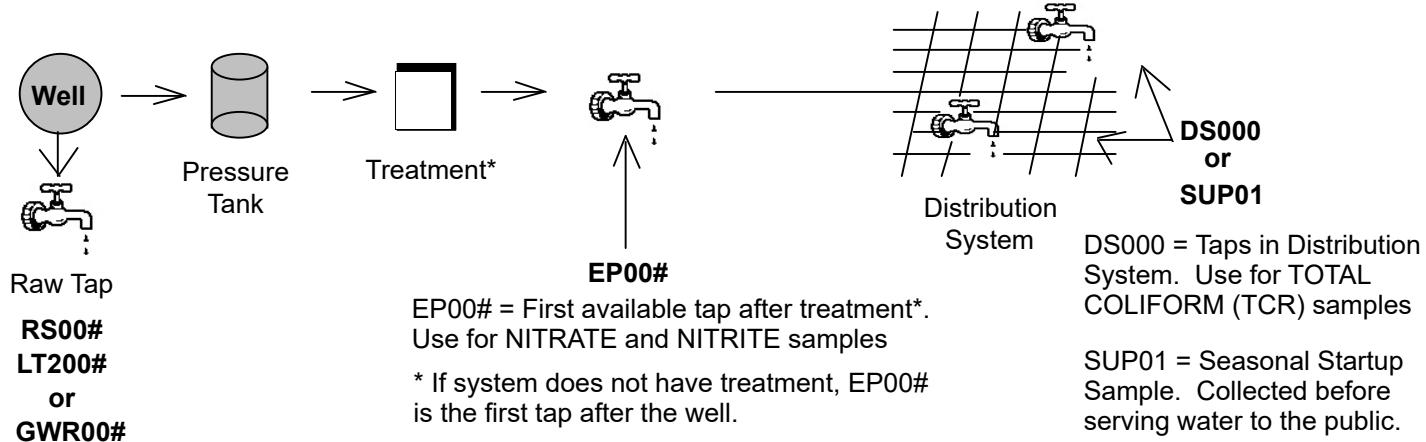

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130212 AUSTIN LAKE

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: AUSTIN LAKE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026

Where to Collect Samples For a Small Public Water System

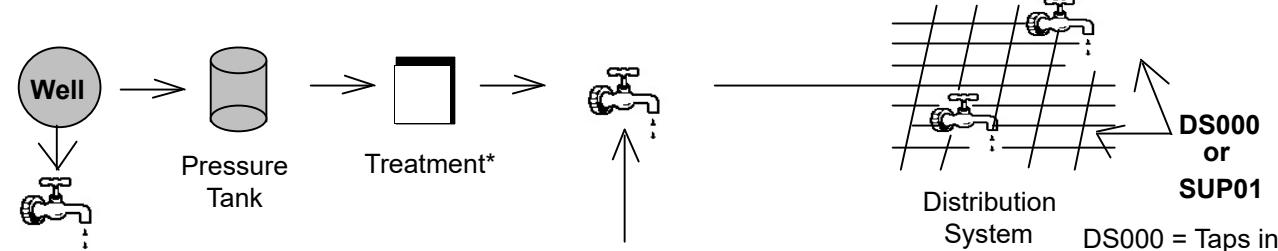

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130212 AUSTIN LAKE

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155331 Facility Name: **AUSTIN LAKE**

Location SMP ID: EP001 Facility Source: **Ground Water**


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#

LT200#

or

GWR00#


Pressure
Tank

Treatment*

EP00#

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

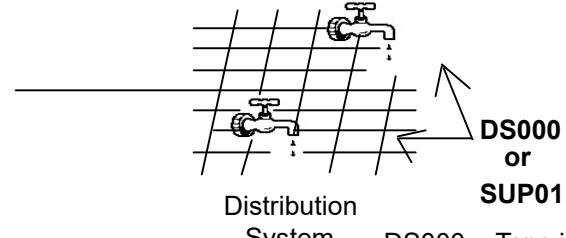

Distribution
System

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

SUP01 = Seasonal Startup
Sample. Collected before
serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4130812 CARDINAL OPERATING CO. 3

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155332	Facility Name: AMERICAN ELECTRIC POWER CARDINAL PLANT
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
DIOXIN - 2063	Not Required
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4130812 CARDINAL OPERATING CO. 3

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CARDINAL OPERATING CO. 3 DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: CARDINAL OPERATING CO. 3 DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2026 and 6/30/2026 10 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling Location	Facility ID: DS1	Facility Name: CARDINAL OPERATING CO. 3 DISTRIBUTION
	SMP ID: DS201	CHEM LAB

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4130912 CARDINAL OPERATING COMPANY 1/ 2 PWS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155333	Facility Name: CARDINAL OPERATING CO 1 & 2
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
DIOXIN - 2063	Not Required
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4130912 CARDINAL OPERATING COMPANY 1/2 PWS

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: CARDINAL OPERATING CO1&2 DISTRIBUTION
Location	SMP ID: DS000
Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: CARDINAL OPERATING CO1&2 DISTRIBUTION
Location	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs
Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2026 and 6/30/2026 10 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling Location	Facility ID: DS1 Facility Name: CARDINAL OPERATING CO1&2 DISTRIBUTION
Location	SMP ID: DS201 WOMENS LOCKER ROOM
Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4131212 CHRISTIAN CHURCH OF UNIONPORT

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: CHRISTIAN CH. OF UNIONPO DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

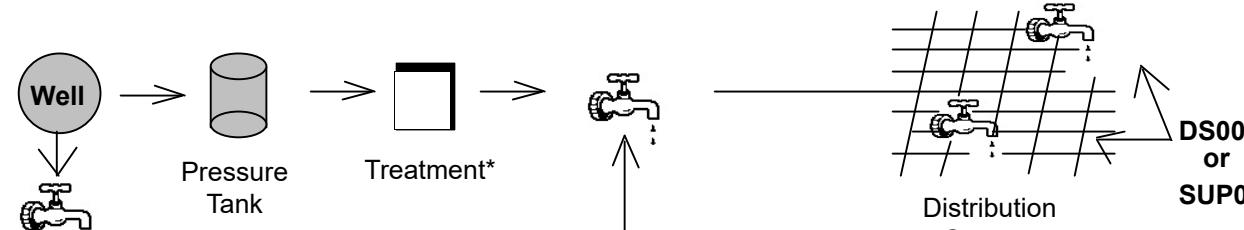

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Distribution
System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4131212 CHRISTIAN CHURCH OF UNIONPORT

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155335 Facility Name: CHRISTIAN CHURCH OF UNIONPORT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

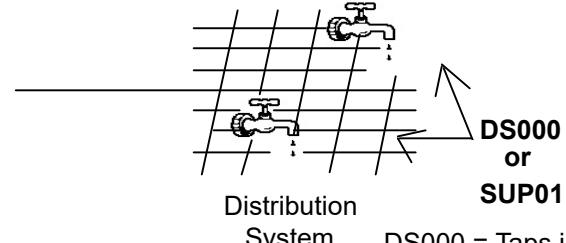

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4132412 KOLMONT COMMUNITY CHURCH

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KOLMONT COMMUNITY CHURCH DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

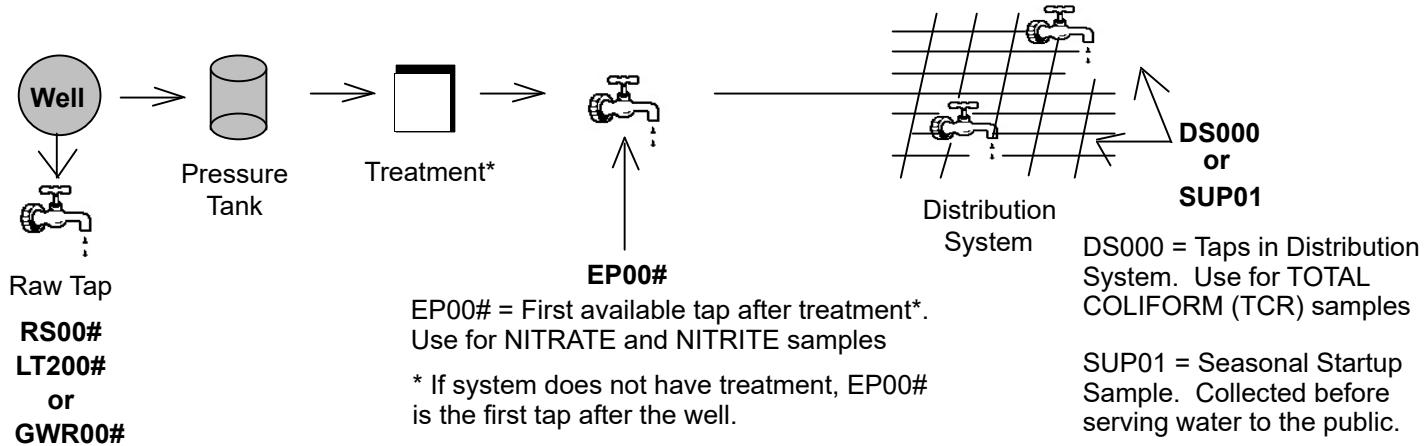

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4132412 KOLMONT COMMUNITY CHURCH

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155337 Facility Name: **KOLMONT COMMUNITY CHURCH**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

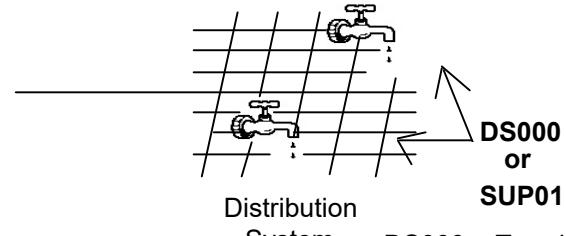

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4134312 BEC-WOOD GOLF COURSE

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: BEC-WOOD GOLF COURSE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

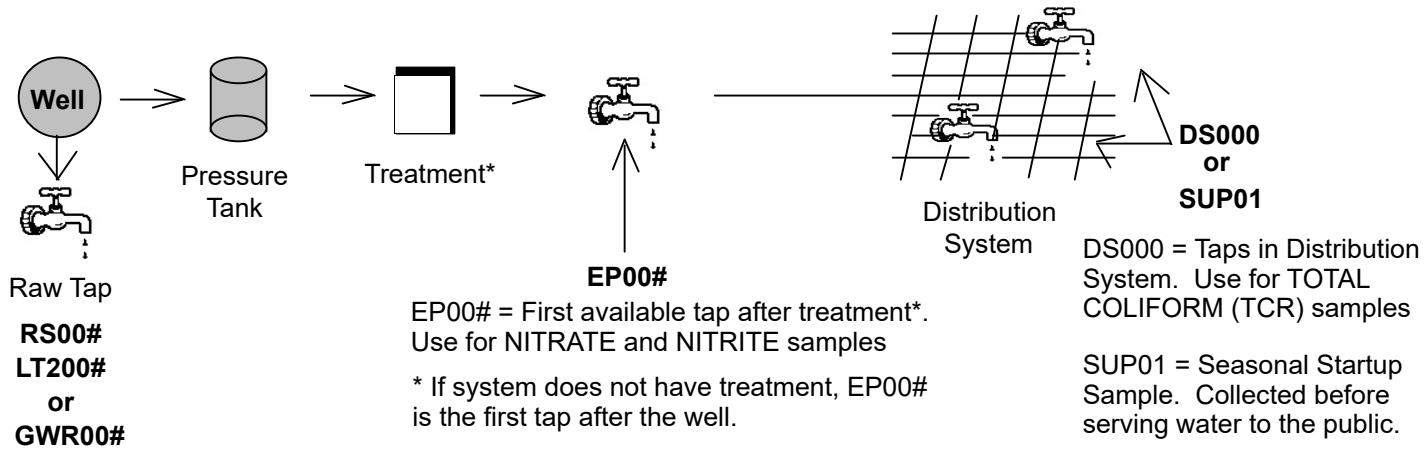

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4134312 BEC-WOOD GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE


Sampling Facility ID: 4155346 Facility Name: BEC-WOOD GOLF COURSE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
----------------	---

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

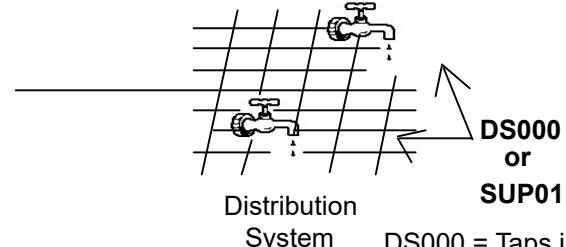

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4135212 ODNR-JEFFERSON LAKE ST PK-SC

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODNR-JEFF LK ST PK-SC DISTRIBUTION

Location SMP ID: SUP01 Facility Source: Ground Water


Chemicals

Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

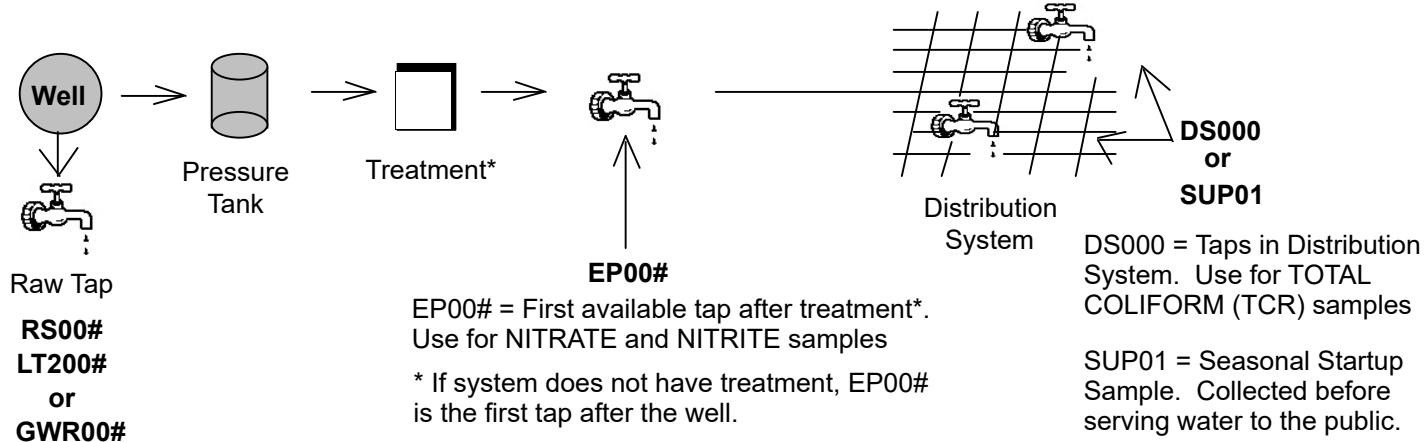

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4135212 ODNR-JEFFERSON LAKE ST PK-SC

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: ODNR-JEFF LK ST PK-SC DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

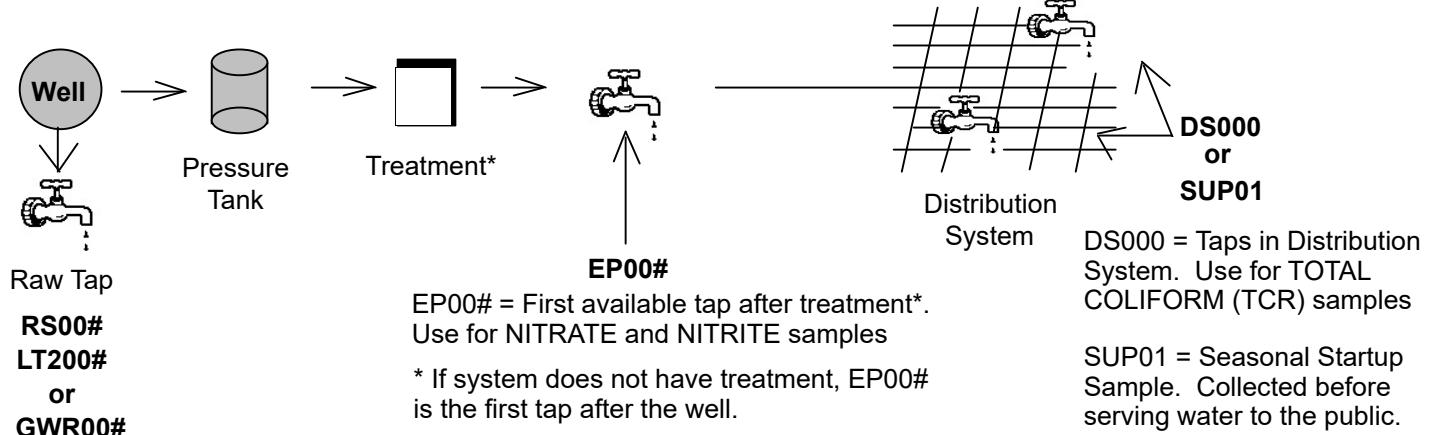

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4135212 ODNR-JEFFERSON LAKE ST PK-SC

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155349 Facility Name: **ODNR JEFF LK ST PK SC**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

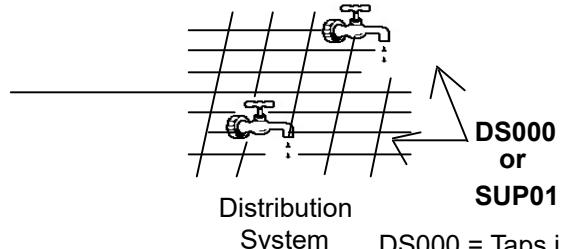

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4136412 ETEM REMEDIATION ONE, LLC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155353	Facility Name: FIRST ENERGY GENERATION CORP - SAMMIS SO
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
DIOXIN - 2063	Not Required
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4136412 ETEM REMEDIATION ONE, LLC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SAMMIS SOUTH DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling	Facility ID: DS1	Facility Name: SAMMIS SOUTH DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4136612 JEFFERSON CO SPORTSMAN CLUB BAR

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO SPORTSMAN BAR DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

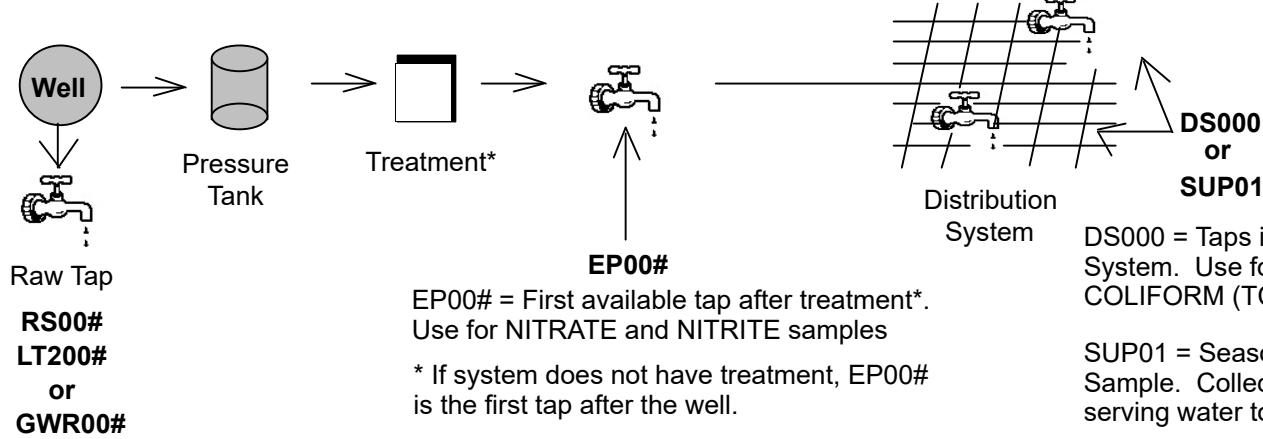

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4136612 JEFFERSON CO SPORTSMAN CLUB BAR

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155356 Facility Name: JEFFERSON CO SPORTSMAN CLUB BAR

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

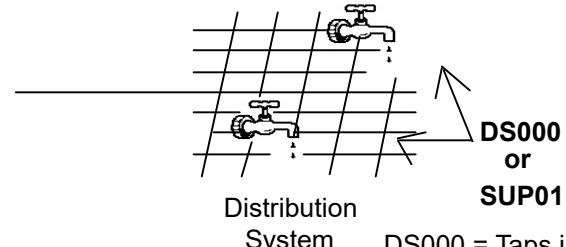

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4136712 JEFFERSON CO SPORTSMAN CLUB CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO SPORTSMAN CAMP DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water
Chemicals	Monitoring Requirements	
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public	

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

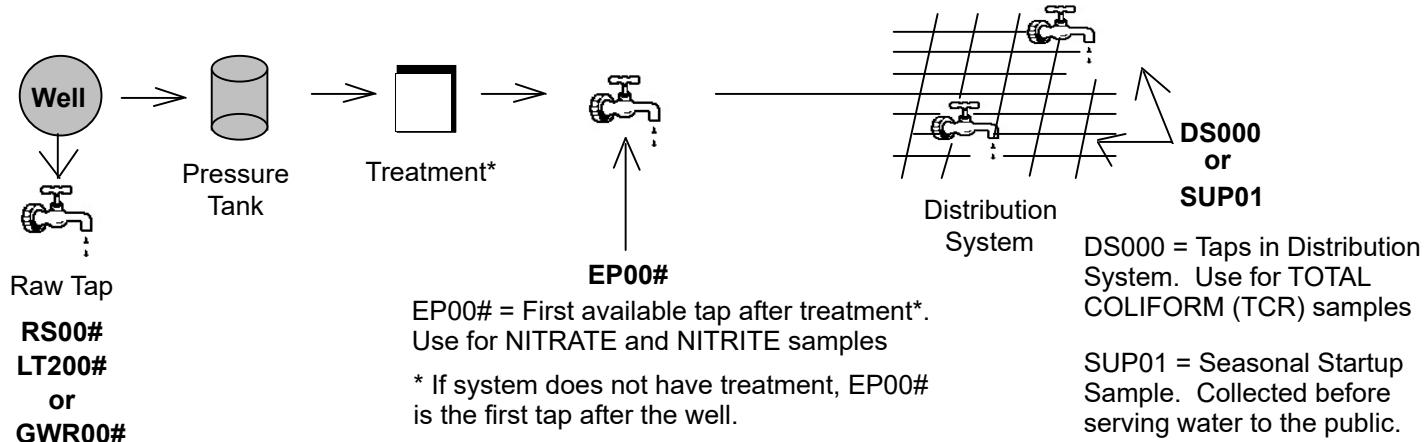

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4136712 JEFFERSON CO SPORTSMAN CLUB CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JEFFERSON CO SPORTSMAN CAMP DISTRIBUTION	
Location	SMP ID: DS000	Facility Source: Ground Water	
Chemicals		Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 5/15/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026	

Where to Collect Samples For a Small Public Water System

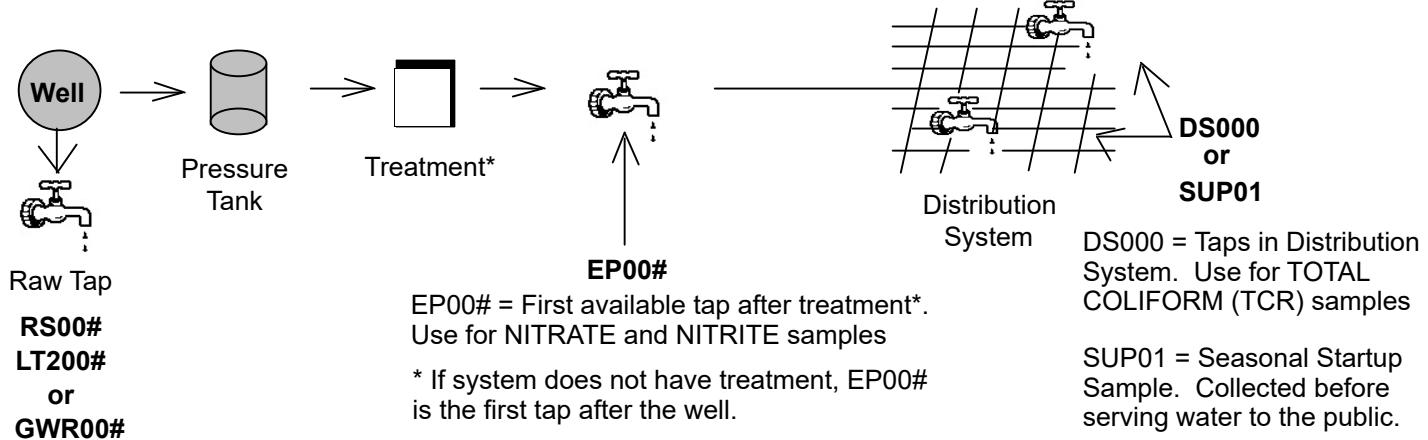

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4136712 JEFFERSON CO SPORTSMAN CLUB CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155357 Facility Name: JEFFERSON CO SPORTSMAN CLUB CAMP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

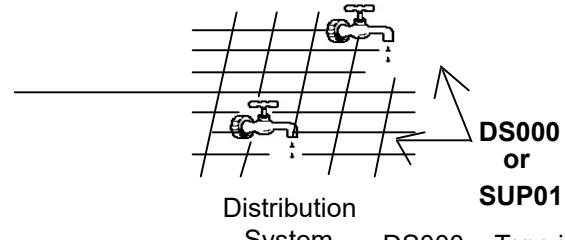

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137112 APOSTOLATE FOR FAMILY CONSECRATION

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4155360	Facility Name: APOSTOLATE FOR FAMILY CONSECRATION
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4137112 APOSTOLATE FOR FAMILY CONSECRATION

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE FOR FAMILY CONSECRATION DISTI
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE FOR FAMILY CONSECRATION DISTI
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE FOR FAMILY CONSECRATION DISTI
Location	SMP ID: DS201	KITCHEN UTILITY SINK

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4137212 APOSTOLATE SACRED HEART CENTER

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE SACRED HEART CTR DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

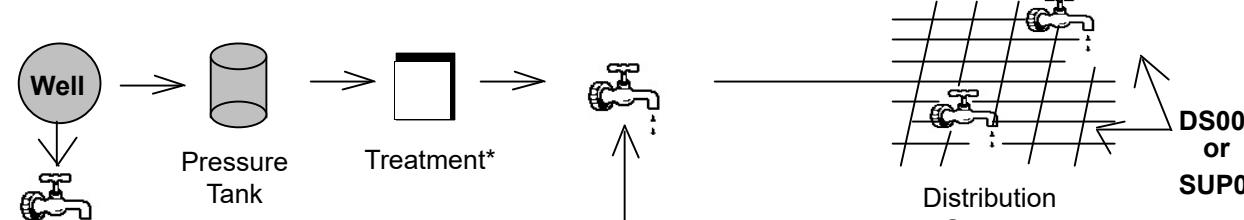

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137212 APOSTOLATE SACRED HEART CENTER

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155361 Facility Name: APOSTOLATE SACRED HEART CTR
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

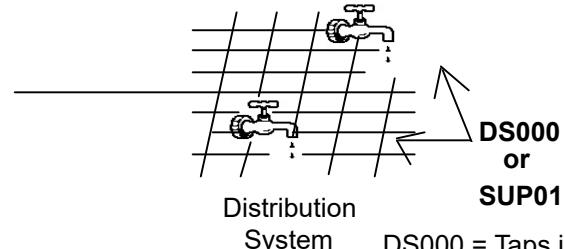

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137312 APOSTOLATE REDEEMER HALL

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE REDEEMER HALL DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

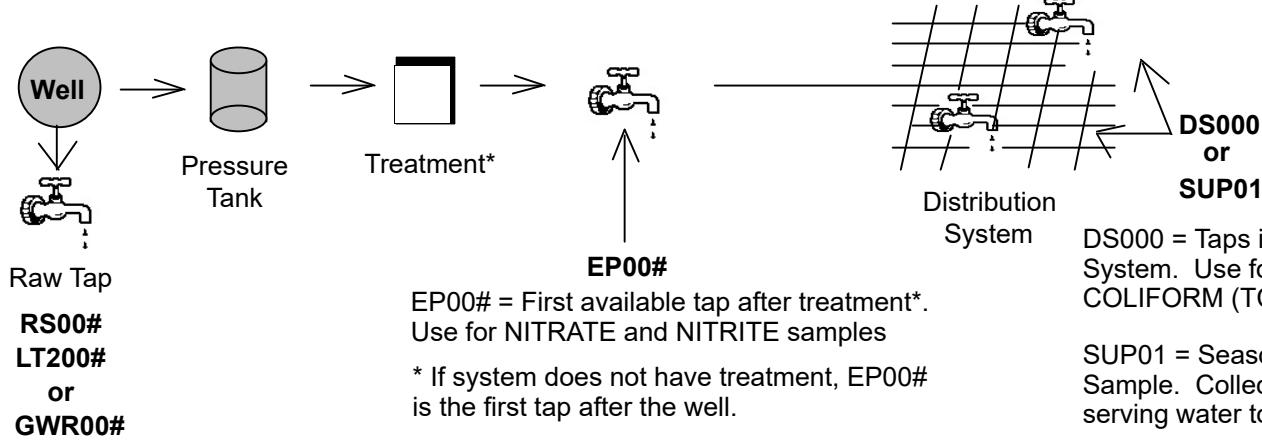

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137312 APOSTOLATE REDEEMER HALL

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155362 Facility Name: APOSTOLATE REDEEMER HALL

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

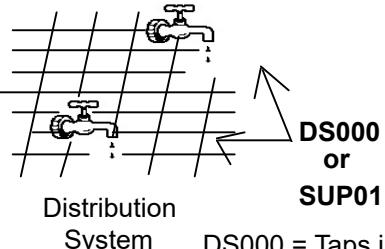

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137412 APOSTOLATE HOLY FAMILY PARK

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 5/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE HOLY FAMILY PARK DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water
Chemicals	Monitoring Requirements	
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public	

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

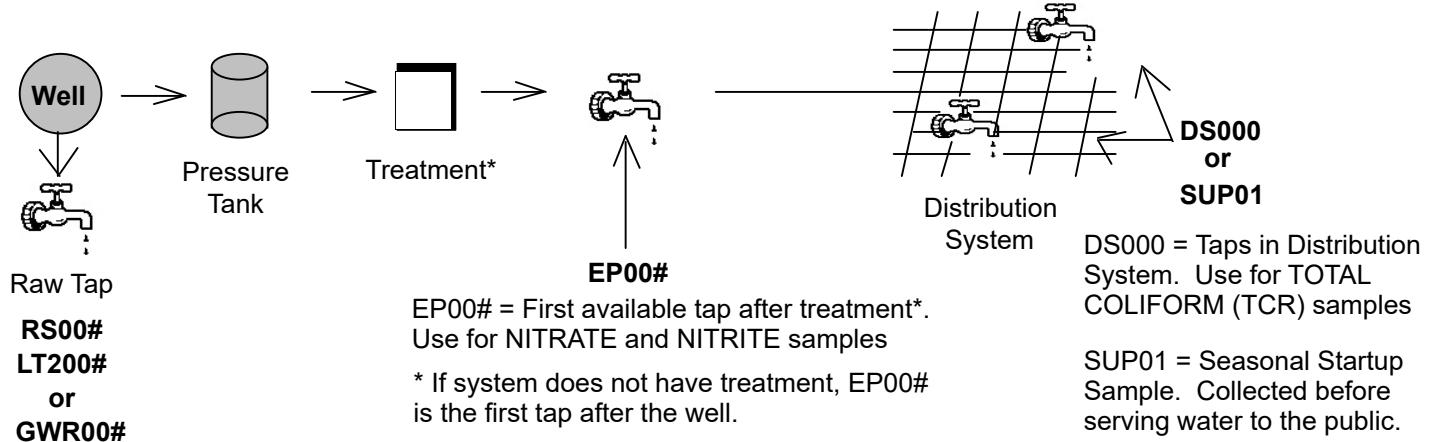

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137412 APOSTOLATE HOLY FAMILY PARK

System Type: Transient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 5/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: APOSTOLATE HOLY FAMILY PARK DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 5/1/2026 and 5/31/2026
		1 Sample(s) Required between 6/1/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 7/31/2026
		1 Sample(s) Required between 8/1/2026 and 8/31/2026
		1 Sample(s) Required between 9/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

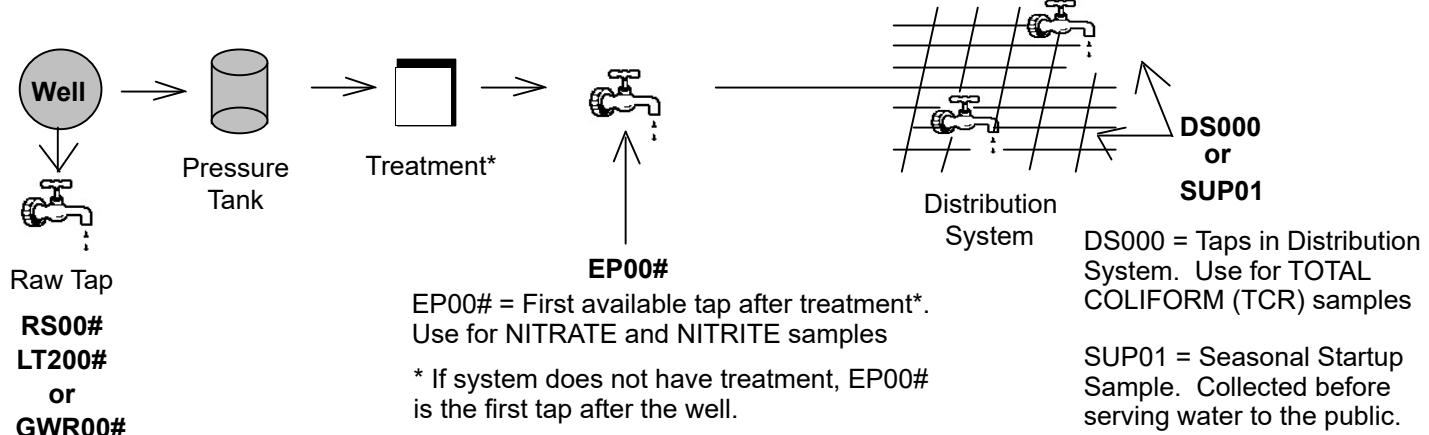

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137412 APOSTOLATE HOLY FAMILY PARK

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4155363 Facility Name: APOSTOLATE HOLY FAMILY PARK

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

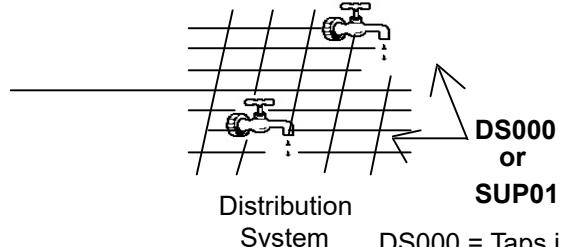

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4137912 BILL DENOON LUMBER CO MILL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4161251	Facility Name: BILL DENOON LUMBER CO/OFFICE AND MILL
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4137912 BILL DENOON LUMBER CO MILL

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: BILL DENOON LUMBER CO/OFFICE AND MILL DI
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling	Facility ID: DS1	Facility Name: BILL DENOON LUMBER CO/OFFICE AND MILL DI
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.