

Subject: 2026 PWS Monitoring Schedules Now Available

Dear Public Water System (PWS) Owner:

The 2026 Contaminant Monitoring Schedules have been created and are now available online at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

The distribution requirements only need to be met by your overall system, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
 - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
 - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
 - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

Subscribe to Updates: Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

For Transient Non-Community (TNC) PWSs Only

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Central District Office at 614-644-2752
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)



OH4200112 DANVILLE VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4260534	Facility Name: DANVILLE STU 2
Location	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4200112 DANVILLE VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DANVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: DANVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2026 and 6/30/2026 20 Sample(s) Required between 7/1/2026 and 12/31/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4200112 DANVILLE VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DANVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	OUTSIDE TAP - 109 PROGRESS ST.

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: DANVILLE, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202	OUTSIDE TAP - 14800 MILLERSBURG ROAD

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4200212 FREDERICKTOWN VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255367	Facility Name: FREDERICKTOWN WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4200212 FREDERICKTOWN VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: FREDERICKTOWN, VILLAGE O DISTRIBUTION	
Chemicals	Monitoring Requirements	
ASBESTOS - 1094		Not Required
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 3 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	3 Sample(s) Required between 3 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.



OH4200212 FREDERICKTOWN VILLAGE

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: FREDERICKTOWN, VILLAGE O DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: FREDERICKTOWN, VILLAGE O DISTRIBUTION
Location	SMP ID: DS201	20 MOHICAN DRIVE

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: FREDERICKTOWN, VILLAGE O DISTRIBUTION
Location	SMP ID: DS202	20 SHOEMAKER

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4200403 GAMBIER VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** **** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GAMBIER, VILLAGE OF DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2026 and 1/31/2026 3 Sample(s) Required between 2/1/2026 and 2/28/2026 3 Sample(s) Required between 3/1/2026 and 3/31/2026 3 Sample(s) Required between 4/1/2026 and 4/30/2026 3 Sample(s) Required between 5/1/2026 and 5/31/2026 3 Sample(s) Required between 6/1/2026 and 6/30/2026 3 Sample(s) Required between 7/1/2026 and 7/31/2026 3 Sample(s) Required between 8/1/2026 and 8/31/2026 3 Sample(s) Required between 9/1/2026 and 9/30/2026 3 Sample(s) Required between 10/1/2026 and 10/31/2026 3 Sample(s) Required between 11/1/2026 and 11/30/2026 3 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2026 and 1/31/2026 3 Sample(s) Required between 2/1/2026 and 2/28/2026 3 Sample(s) Required between 3/1/2026 and 3/31/2026 3 Sample(s) Required between 4/1/2026 and 4/30/2026 3 Sample(s) Required between 5/1/2026 and 5/31/2026 3 Sample(s) Required between 6/1/2026 and 6/30/2026 3 Sample(s) Required between 7/1/2026 and 7/31/2026 3 Sample(s) Required between 8/1/2026 and 8/31/2026 3 Sample(s) Required between 9/1/2026 and 9/30/2026 3 Sample(s) Required between 10/1/2026 and 10/31/2026 3 Sample(s) Required between 11/1/2026 and 11/30/2026 3 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GAMBIER, VILLAGE OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4200403 GAMBIER VILLAGE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GAMBIER, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201 141 MEADOW LANE	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: GAMBIER, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202 115 MEADOW LANE	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4200812 MOUNT VERNON CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255371	Facility Name: MOUNT VERNON WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
CHLORITE - 1009	1 Sample daily when Chlorine Dioxide is applied.
CHLORINE DIOXIDE - 1008	1 Sample daily when Chlorine Dioxide is applied.
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4200812 MOUNT VERNON CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MOUNT VERNON, CITY OF DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
------------------	--------------------------------

CHLORITE - 1009	3 Sample(s) Required between 1/1/2026 and 1/31/2026
	3 Sample(s) Required between 2/1/2026 and 2/28/2026
	3 Sample(s) Required between 3/1/2026 and 3/31/2026
	3 Sample(s) Required between 4/1/2026 and 4/30/2026
	3 Sample(s) Required between 5/1/2026 and 5/31/2026
	3 Sample(s) Required between 6/1/2026 and 6/30/2026
	3 Sample(s) Required between 7/1/2026 and 7/31/2026
	3 Sample(s) Required between 8/1/2026 and 8/31/2026
	3 Sample(s) Required between 9/1/2026 and 9/30/2026
	3 Sample(s) Required between 10/1/2026 and 10/31/2026
	3 Sample(s) Required between 11/1/2026 and 11/30/2026
	3 Sample(s) Required between 12/1/2026 and 12/31/2026

One sample at each of the following locations: near the first customer, at a location representative of the average residence time, and at a location reflecting maximum residence time of the water in the distribution system. Consult Chlorine Dioxide plan approval for additional distribution requirements unique to your system.

TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2026 and 1/31/2026
	15 Sample(s) Required between 2/1/2026 and 2/28/2026
	15 Sample(s) Required between 3/1/2026 and 3/31/2026
	15 Sample(s) Required between 4/1/2026 and 4/30/2026
	15 Sample(s) Required between 5/1/2026 and 5/31/2026
	15 Sample(s) Required between 6/1/2026 and 6/30/2026
	15 Sample(s) Required between 7/1/2026 and 7/31/2026
	15 Sample(s) Required between 8/1/2026 and 8/31/2026
	15 Sample(s) Required between 9/1/2026 and 9/30/2026
	15 Sample(s) Required between 10/1/2026 and 10/31/2026
	15 Sample(s) Required between 11/1/2026 and 11/30/2026
	15 Sample(s) Required between 12/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: MOUNT VERNON, CITY OF DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



OH4200812 MOUNT VERNON CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: MOUNT VERNON, CITY OF DISTRIBUTION
Location	SMP ID: DS201	11555 UPPER GILCHRIST ROAD

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: MOUNT VERNON, CITY OF DISTRIBUTION
Location	SMP ID: DS202	100 PROGRESS DRIVE

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4201512 COLONIAL TERRACE MHC LLC

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255377	Facility Name: COLONIAL TERRACE MHP STU 1
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2026 and 12/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i> BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039 ENDOTHALL - 2033	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4201512 COLONIAL TERRACE MHC LLC

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4260535	Facility Name: COLONIAL TERRACE MHP STU 2
Location	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	7/1/2026 and 9/30/2026
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between	4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>		
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039		
ENDOTHALL - 2033		
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	



OH4201512 COLONIAL TERRACE MHC LLC

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: COLONIAL TERRACE MHP DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: COLONIAL TERRACE MHP DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH4201512 COLONIAL TERRACE MHC LLC

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: COLONIAL TERRACE MHP DISTRIBUTION

Location SMP ID: DS201 OUTSIDE TAP - LOT 46

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4201712 WESTGATE MOBILE HOME COMMUNITY

System Type: Community

Source: Purchased Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WESTGATE MOBILE HOME COM DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Sampling Location	Facility ID: DS1	Facility Name: WESTGATE MOBILE HOME COM DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

Sampling Location	Facility ID: DS1	Facility Name: WESTGATE MOBILE HOME COM DISTRIBUTION
	SMP ID: DS201	OUTSIDE TAP - 900 HARCOURT ROAD

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4202012 KNOX COUNTY WATER AND WASTEWATER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255379	Facility Name: KNOX CO W & WW
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4202012 KNOX COUNTY WATER AND WASTEWATER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KNOX CO W & WW DIST
Location	SMP ID: DS000	
Chemicals	Monitoring Requirements	
TOTAL COLIFORM (TCR) - 3100	9 Sample(s) Required between 9 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	9 Sample(s) Required between 9 Sample(s) Required between	1/1/2026 and 1/31/2026 2/1/2026 and 2/28/2026 3/1/2026 and 3/31/2026 4/1/2026 and 4/30/2026 5/1/2026 and 5/31/2026 6/1/2026 and 6/30/2026 7/1/2026 and 7/31/2026 8/1/2026 and 8/31/2026 9/1/2026 and 9/30/2026 10/1/2026 and 10/31/2026 11/1/2026 and 11/30/2026 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: KNOX CO W & WW DIST
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs
Chemicals	Monitoring Requirements	
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between	6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4202012 KNOX COUNTY WATER AND WASTEWATER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: KNOX CO W & WW DIST

Location SMP ID: DS201 586 TERRACE RIDGE CIRCLE

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: KNOX CO W & WW DIST

Location SMP ID: DS202 494 GRAND VALLEY DRIVE

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4202112 GRANDVIEW MHP B

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255380	Facility Name: GRANDVIEW MHP B STU
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4202112 GRANDVIEW MHP B

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: GRANDVIEW MHP B DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: GRANDVIEW MHP B DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4202112 GRANDVIEW MHP B

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GRANDVIEW MHP B DISTRIBUTION
Location	SMP ID: DS201	OUTSIDE TAP - LOT 158 8750 COL. ROAD
Chemicals		Monitoring Requirements
DISINFECTION BYPRODUCTS		Dual Sample Required between 2/1/2026 and 2/7/2026 at: DS201
		Dual Sample Required between 5/1/2026 and 5/7/2026 at: DS201
		Dual Sample Required between 8/1/2026 and 8/7/2026 at: DS201
		Dual Sample Required between 11/1/2026 and 11/7/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4202312 MARTINSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255381	Facility Name: MARTINSBURG VILLAGE
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4202312 MARTINSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: MARTINSBURG, VILLAGE OF DISTRIBUTION	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: MARTINSBURG, VILLAGE OF DISTRIBUTION	Monitoring Requirements
	SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	
Chemicals		Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH4202312 MARTINSBURG VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MARTINSBURG, VILLAGE OF DISTRIBUTION

Location SMP ID: DS201 2860 MILLERSBURG ROAD

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4202712 GRANDVIEW MHP A PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4255368	Facility Name: GRANDVIEW MHP A STU
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4202712 GRANDVIEW MHP A PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GRANDVIEW MHP A DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: GRANDVIEW MHP A DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH4202712 GRANDVIEW MHP A PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GRANDVIEW MHP A DISTRIBUTION
Location	SMP ID: DS201	OUTSIDE SPIGOT LOT #42A
Chemicals	Monitoring Requirements	
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2026 and 2/7/2026 at: DS201	
	Dual Sample Required between 5/1/2026 and 5/7/2026 at: DS201	
	Dual Sample Required between 8/1/2026 and 8/7/2026 at: DS201	
	Dual Sample Required between 11/1/2026 and 11/7/2026 at: DS201	

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH4230112 BLADENSBURG COMMUNITY CENTER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255384 Facility Name: **BLADENSBURG COMMUNITY CENTER**

Location SMP ID: EP001 Facility Source: **Ground Water**


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

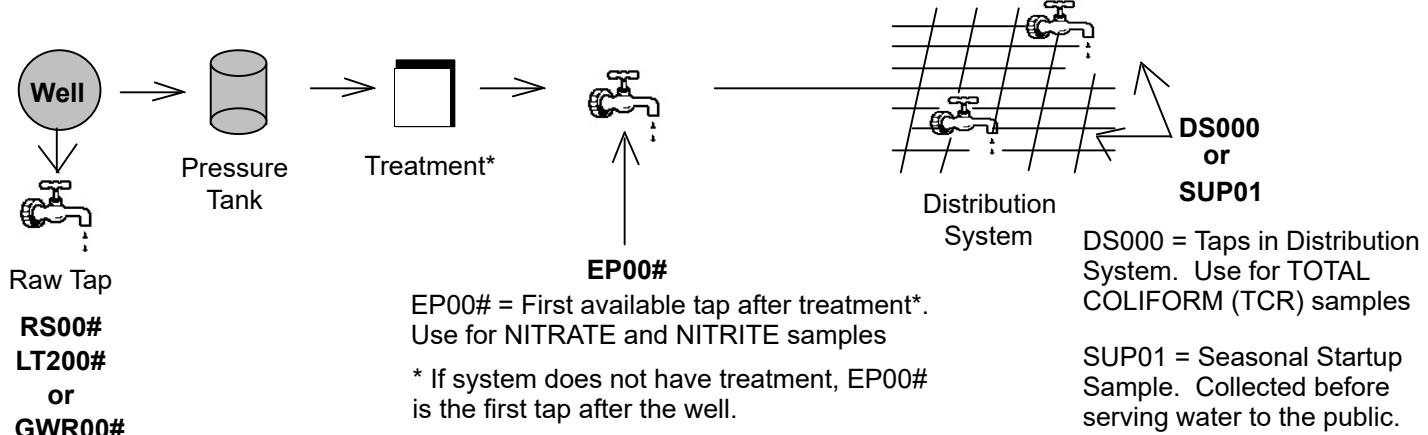

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4230412 BLADENSBURG DINER

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

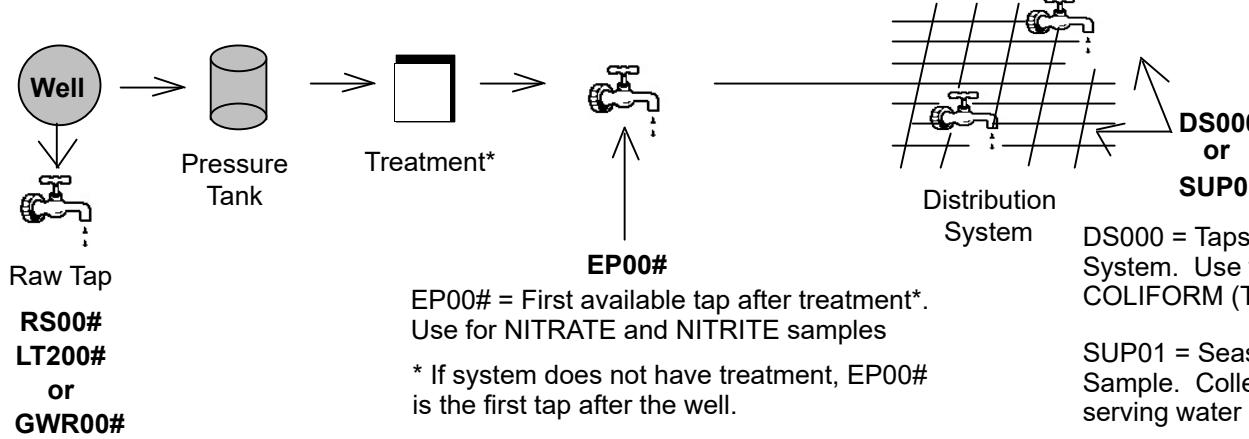

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4230412 BLADENSBURG DINER

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255386 Facility Name: BLADENSBURG DINER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

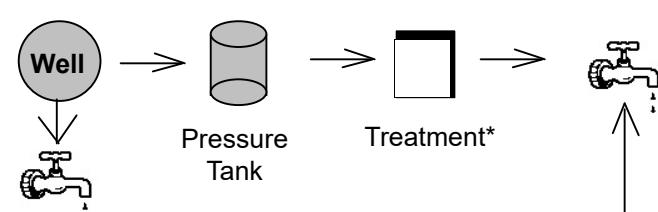

Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

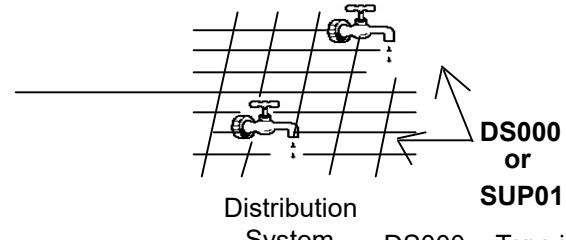

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4231312 DREXEL J THRASH TRAINING

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DREXEL J THRASH TRAINING DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

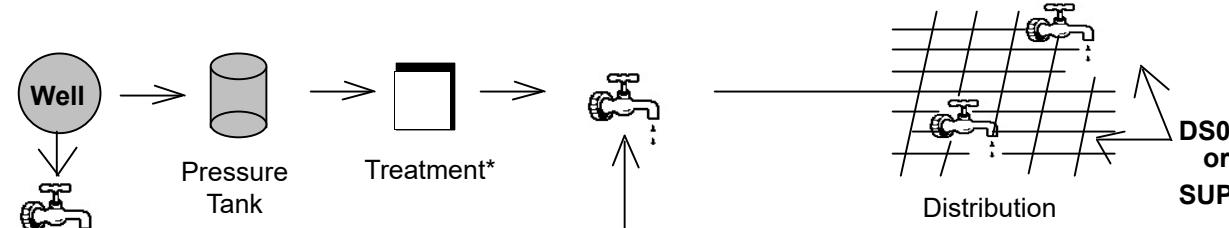

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4231312 DREXEL J THRASH TRAINING

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255391 Facility Name: DREXEL J THRASH TRAINING CENTER

Location SMP ID: EP001 Facility Source: Ground Water


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

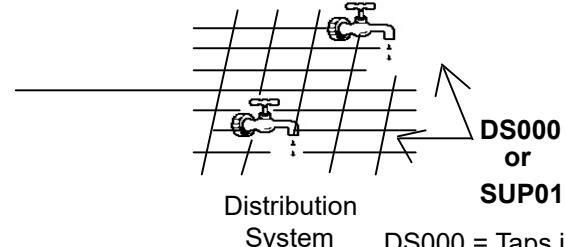

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4231412 PALMYRA CHURCH OF CHRIST PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PALMYRA CHURCH OF CHRIST DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

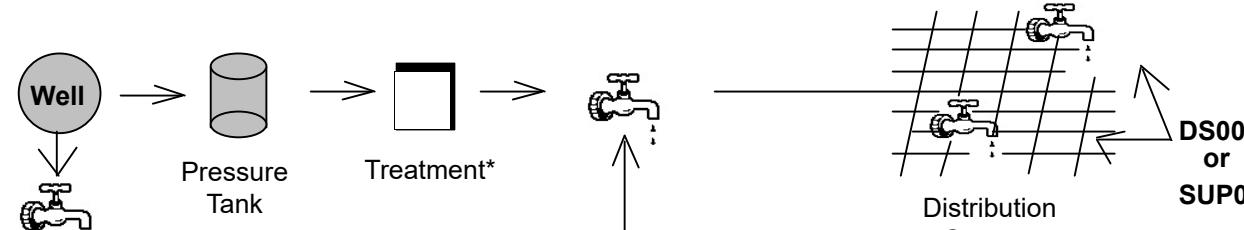

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4231412 PALMYRA CHURCH OF CHRIST PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255392 Facility Name: PALMYRA CHURCH OF CHRIST

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

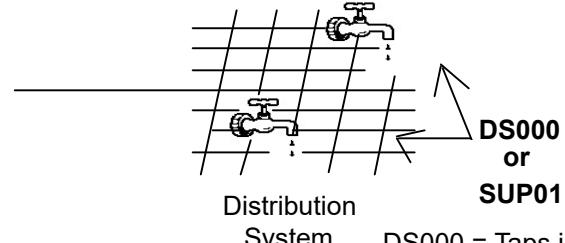

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232312 RAINBOW SPRINGS FAMILY

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 5/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: RAINBOW SPRINGS FAMILY DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

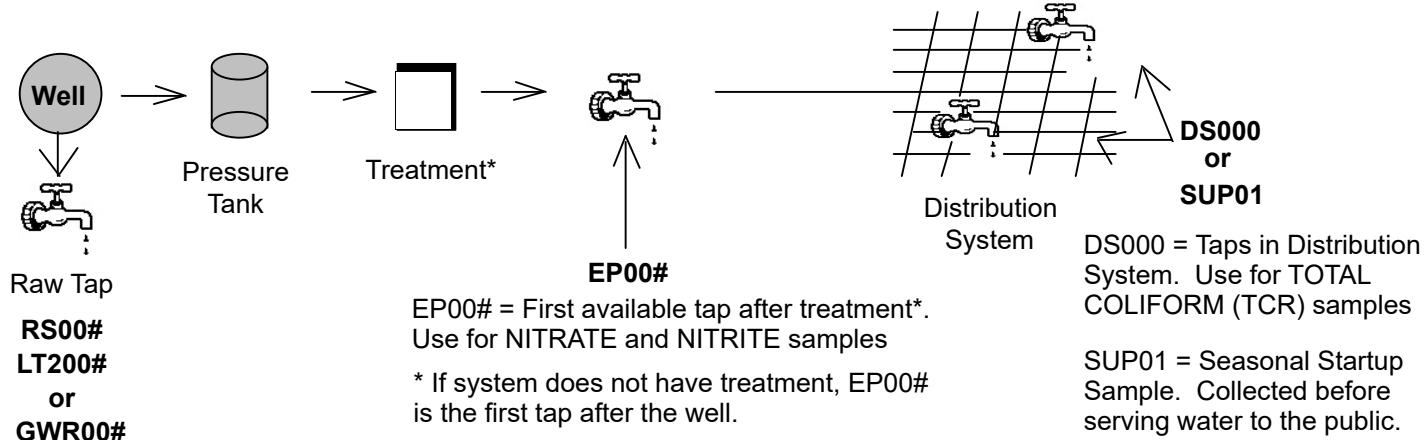

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232312 RAINBOW SPRINGS FAMILY

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility	Facility ID: DS1	Facility Name: RAINBOW SPRINGS FAMILY DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/2/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/15/2026

Where to Collect Samples For a Small Public Water System

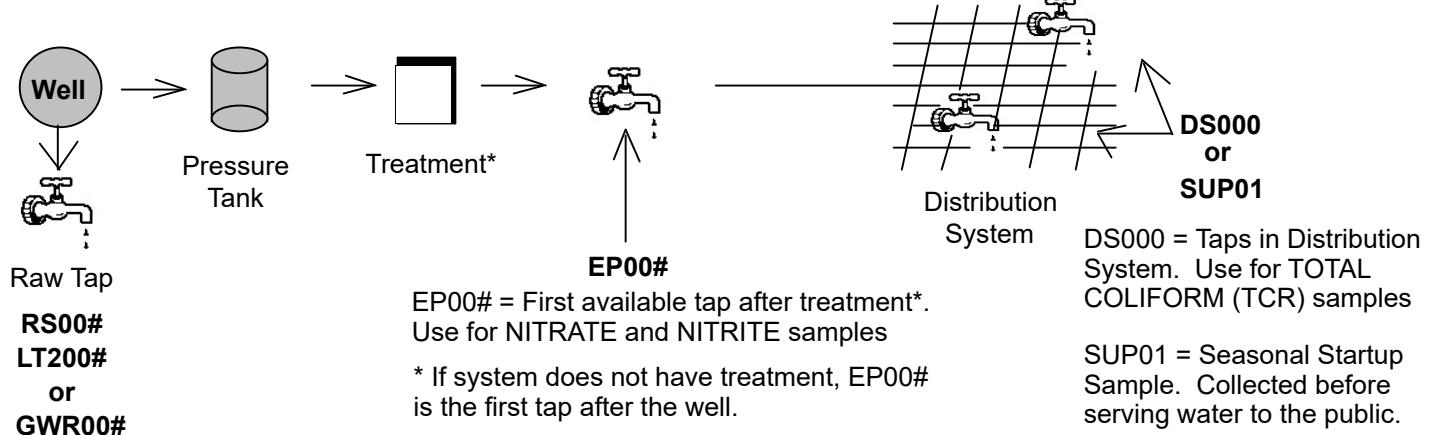

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232312 RAINBOW SPRINGS FAMILY

System Type: Transient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 5/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255396 Facility Name: RAINBOW SPRINGS FAMILY CAMPGRD

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

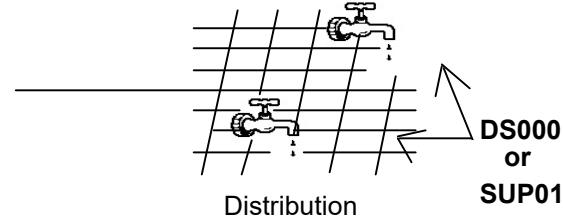

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232612 LEGACY SPRINGS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CAMP MCPHERSON DISTRIBUTION**

Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

**** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative. ****

Where to Collect Samples For a Small Public Water System

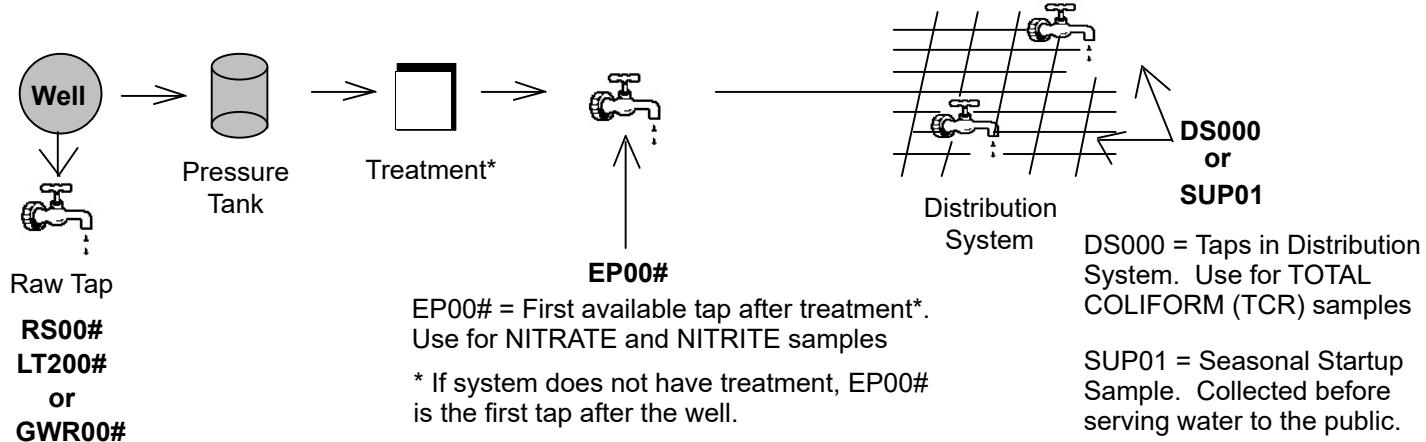

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232612 LEGACY SPRINGS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: CAMP MCPHERSON DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 6/16/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

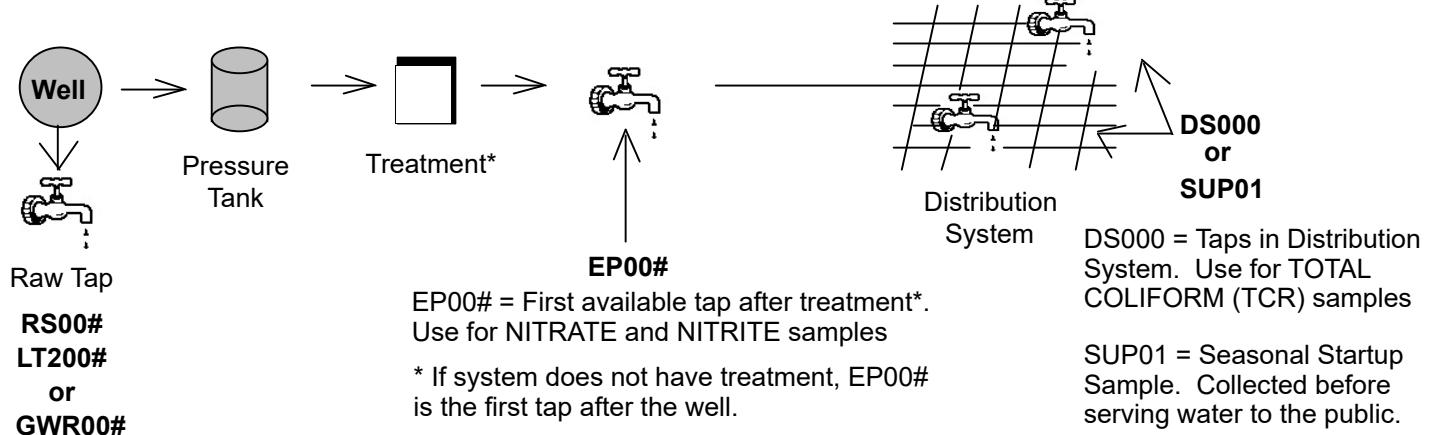

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232612 LEGACY SPRINGS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255398 Facility Name: CAMP MCPHERSON
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

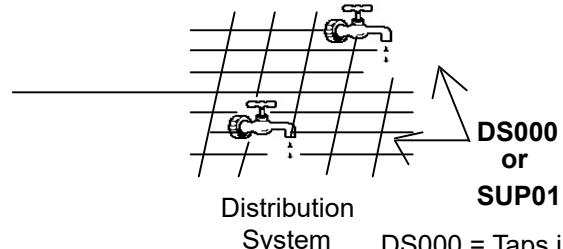

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232812 CAMP MOHAVEN

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CAMP MOHAVEN DISTRIBUTION


Location SMP ID: DS000 Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2026 and 3/31/2026
	1 Sample(s) Required between	4/1/2026 and 6/30/2026
	1 Sample(s) Required between	7/1/2026 and 9/30/2026
	1 Sample(s) Required between	10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

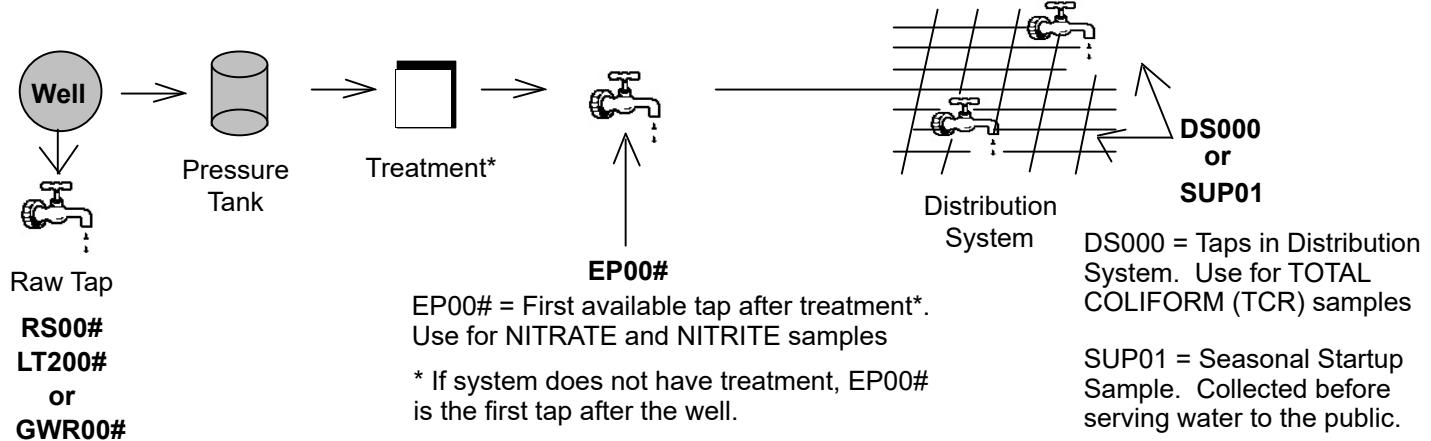

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4232812 CAMP MOHAVEN

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255399 Facility Name: CAMP MOHAVEN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

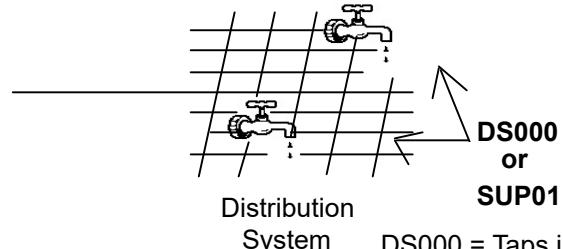

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4234512 IRISH HILLS GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1 Facility Name: **IRISH HILLS GOLF COURSE DISTRIBUTION**
Location SMP ID: SUP01 Facility Source: **Ground Water**

Chemicals **Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

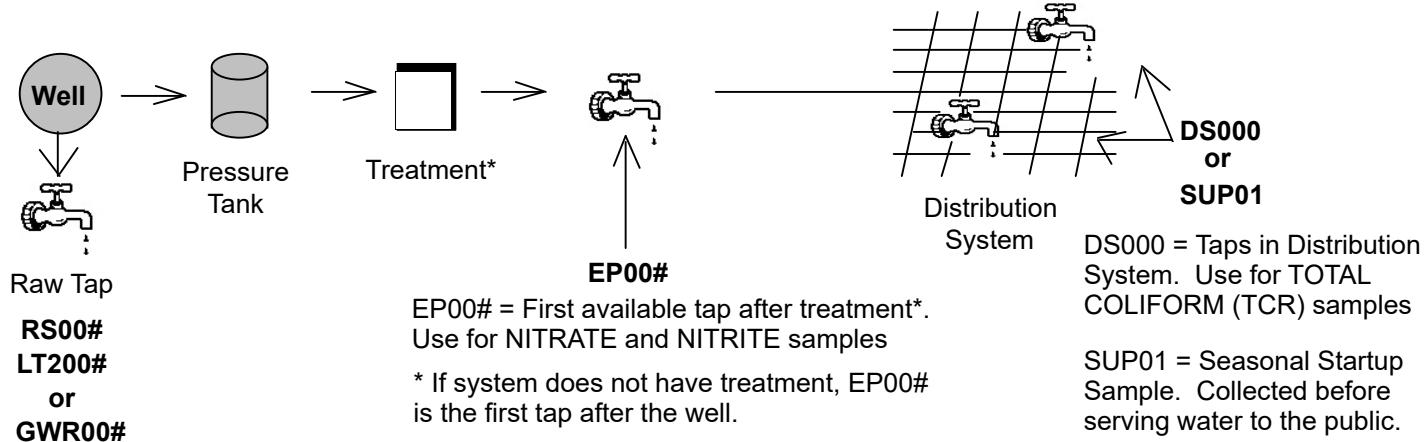

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4234512 IRISH HILLS GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility	Facility ID: DS1	Facility Name: IRISH HILLS GOLF COURSE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

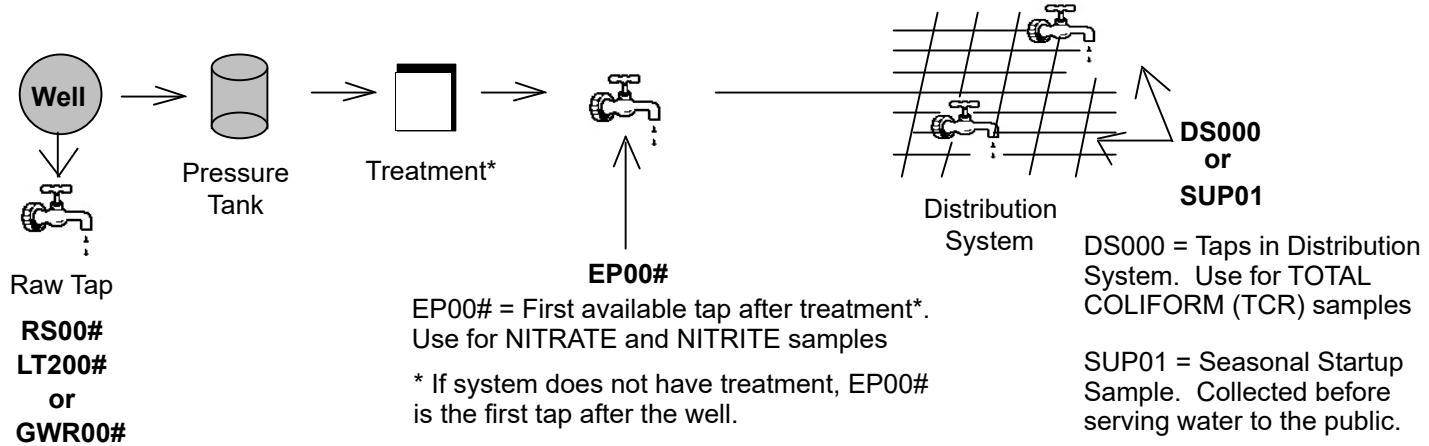

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4234512 IRISH HILLS GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255405 Facility Name: **IRISH HILLS GOLF COURSE**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

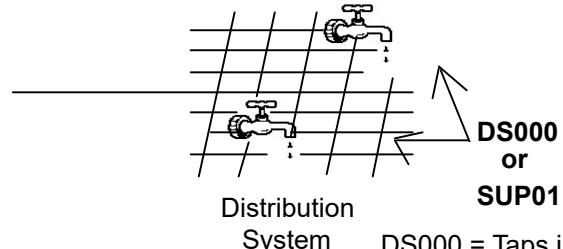

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4235712 MOHICAN WILDERNESS CAMP

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: MOHICAN WILDERNESS CAMP DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

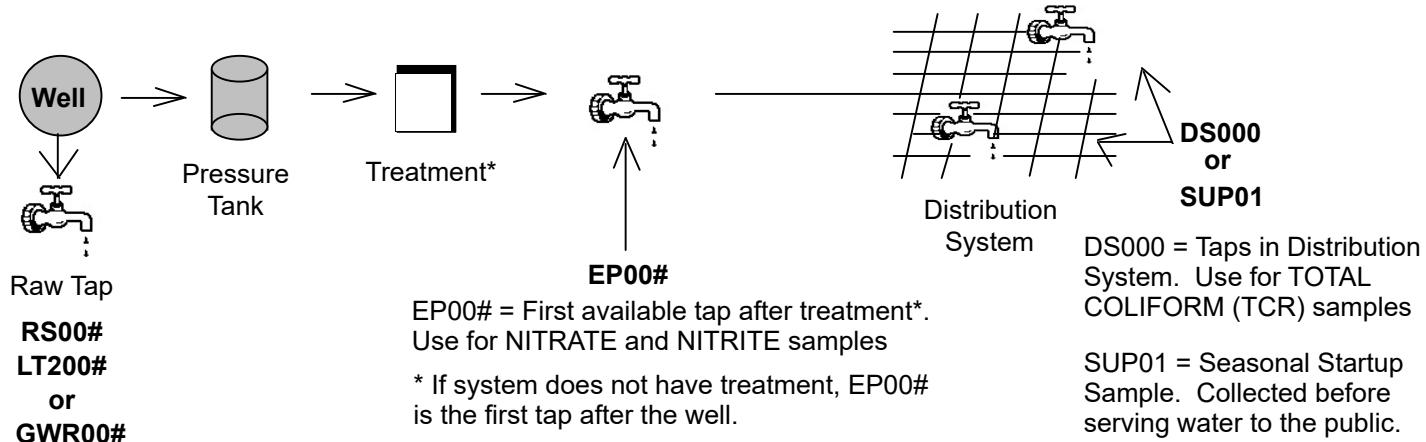

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4235712 MOHICAN WILDERNESS CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID:	DS1	Facility Name:	MOHICAN WILDERNESS CAMP DISTRIBUTION
Location	SMP ID: DS000	Facility Source:	Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

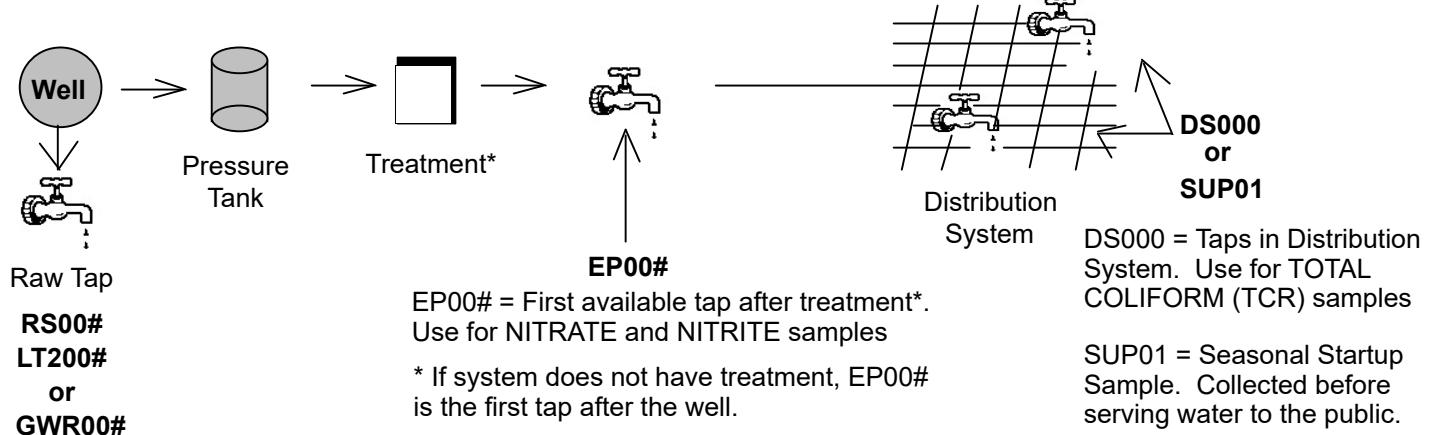

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4235712 MOHICAN WILDERNESS CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4260537 Facility Name: MOHICAN WILDERNESS CAMP STU 3

Location SMP ID: EP003 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2026 and 6/30/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

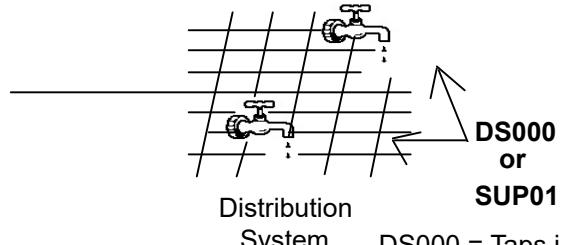

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4235712 MOHICAN WILDERNESS CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4260536 Facility Name: MOHICAN WILDERNESS CAMP STU 2

Location SMP ID: EP002 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

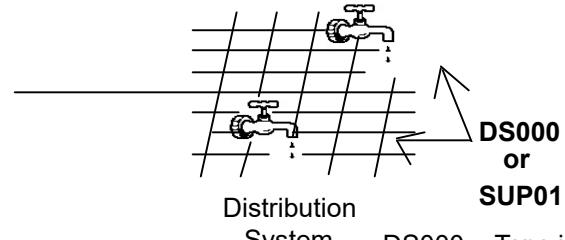

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4235712 MOHICAN WILDERNESS CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255410 Facility Name: MOHICAN WILDERNESS CAMP STU 1

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

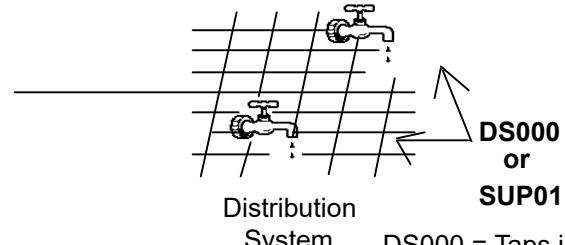

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4236212 RUSTIC KNOLLS CAMPGROUND

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: RUSTIC KNOLLS CAMPGROUND DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

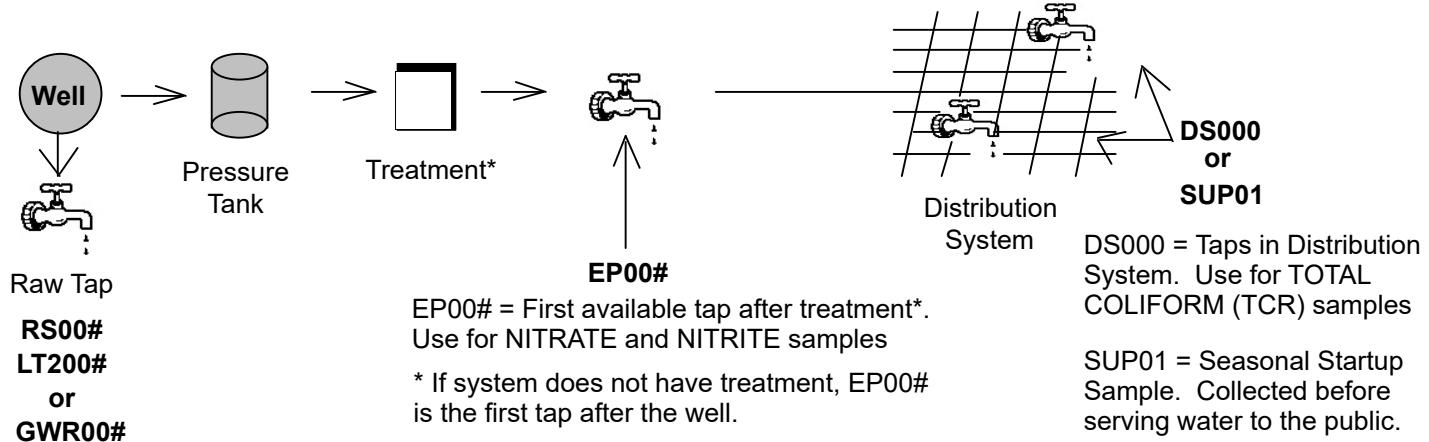

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4236212 RUSTIC KNOLLS CAMPGROUND

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility	Facility ID: DS1	Facility Name: RUSTIC KNOLLS CAMPGROUND DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/11/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

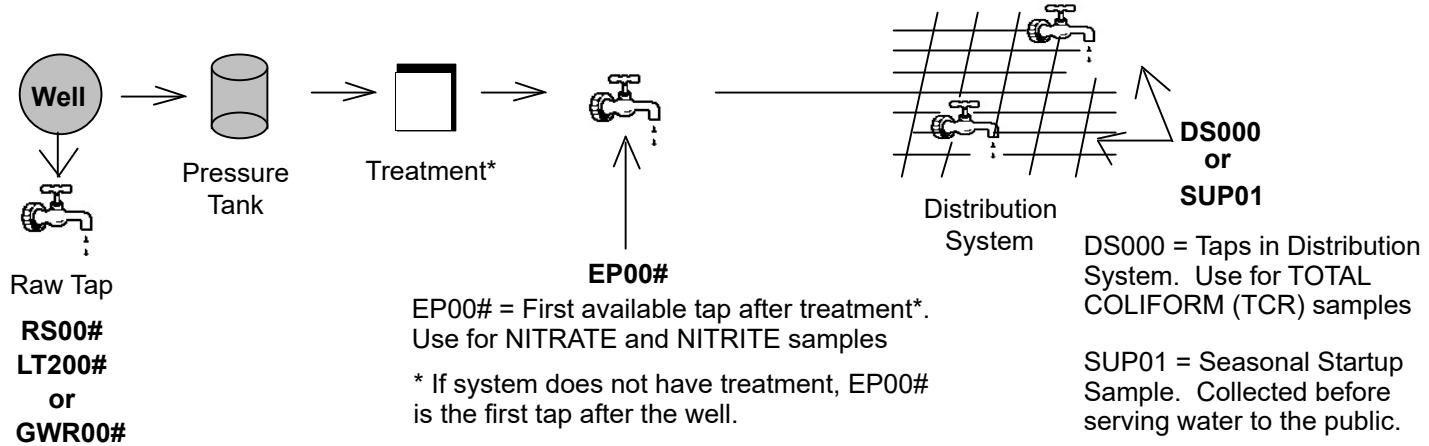

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4236212 RUSTIC KNOLLS CAMPGROUND

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255412 Facility Name: RUSTIC KNOLLS CAMPGROUNDS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

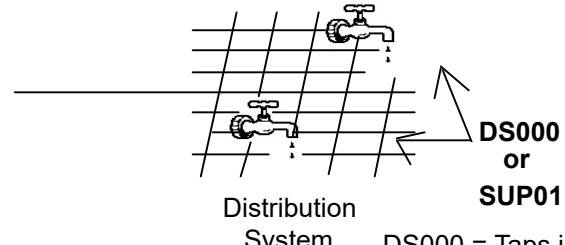

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4236412 TABLE ROCK GOLF CLUB

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: TABLE ROCK GOLF CLUB DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

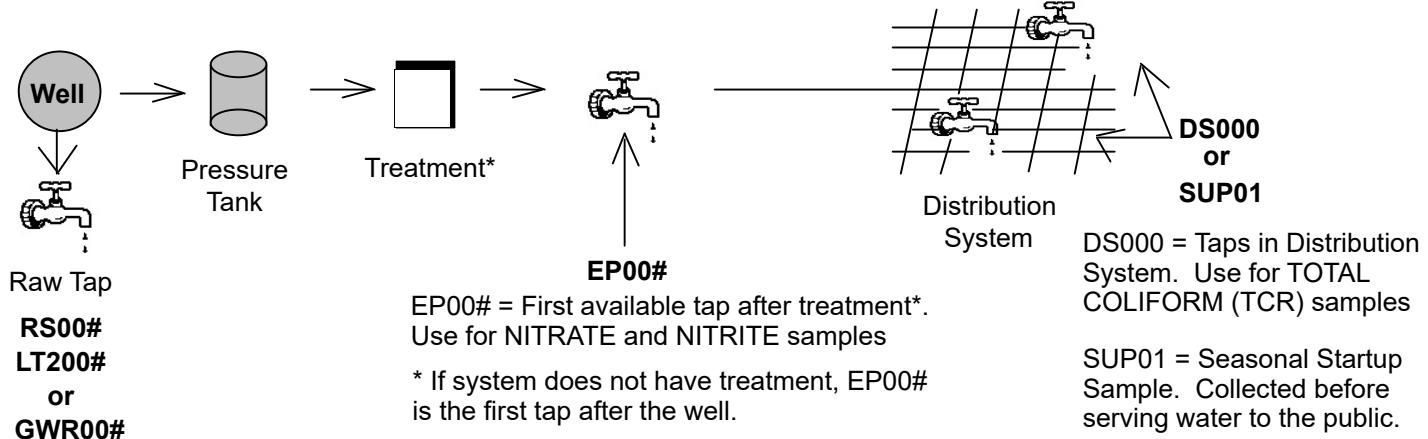

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4236412 TABLE ROCK GOLF CLUB

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255414 Facility Name: TABLE ROCK GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

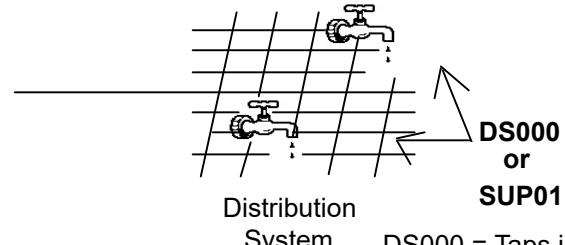

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4237312 NORTH BRANCH KOKOSING DAM CAMP PWS

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: NORTH BRANCH KOKOSING DAM CAMP DISTRIBUT
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

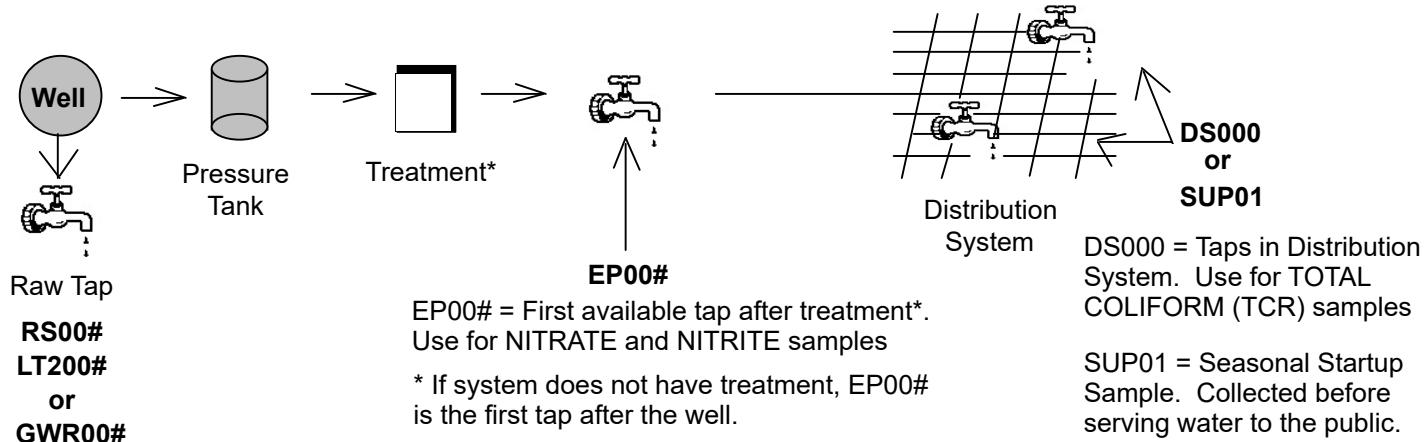

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4237312 NORTH BRANCH KOKOSING DAM CAMP PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1	Facility Name: NORTH BRANCH KOKOSING DAM CAMP DISTRIBUT
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

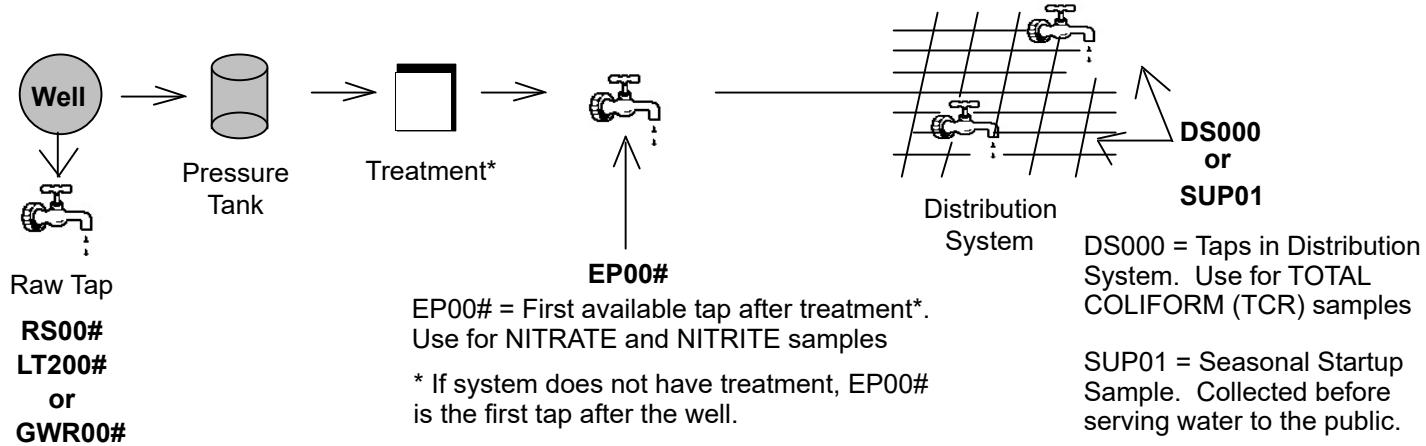

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4237312 NORTH BRANCH KOKOSING DAM CAMP PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255419 Facility Name: NORTH BRANCH KOKOSING DAM CAMP

Location SMP ID: EP001 Facility Source: Ground Water


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#


Pressure Tank

Treatment*

EP00#

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

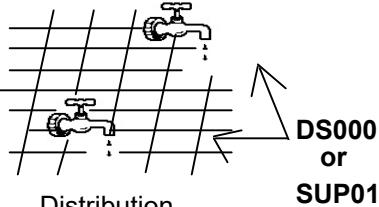

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4238312 MOHICAN RESERVATION CAMP

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: MOHICAN RESERVATION CAMP DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

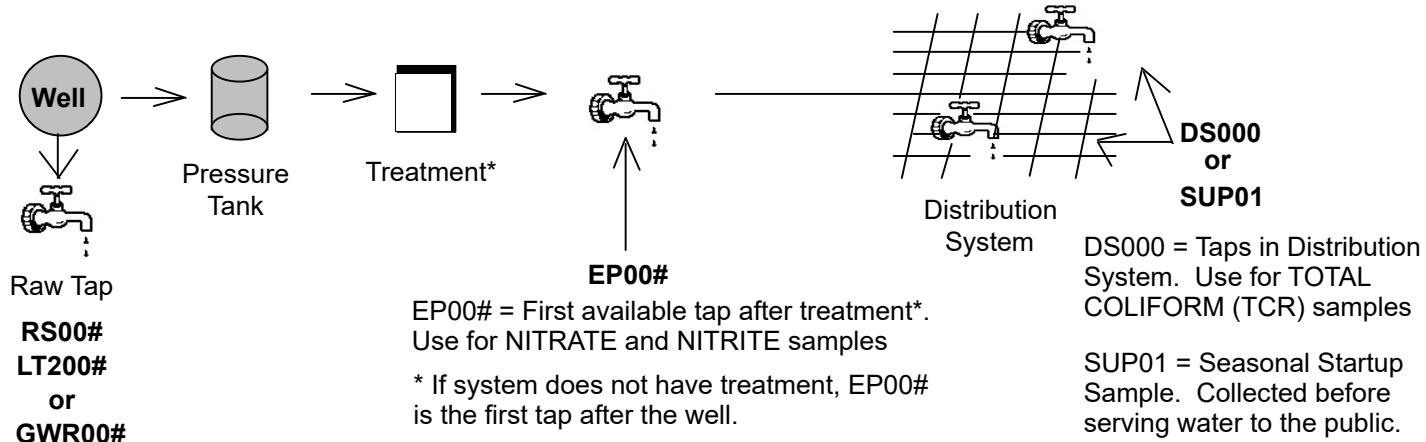

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4238312 MOHICAN RESERVATION CAMP

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID:	DS1	Facility Name:	MOHICAN RESERVATION CAMP DISTRIBUTION	
Location	SMP ID:	DS000	Facility Source:	Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/12/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

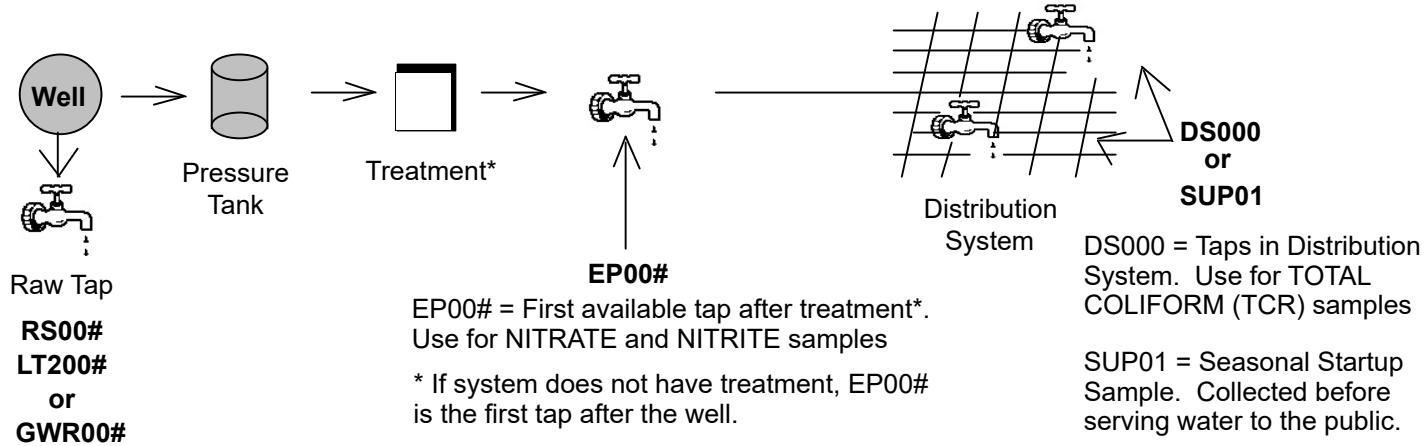

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4238312 MOHICAN RESERVATION CAMP

System Type: Transient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4260538 Facility Name: MOHICAN RESERVATION CAMP STU 2

Location SMP ID: EP002 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

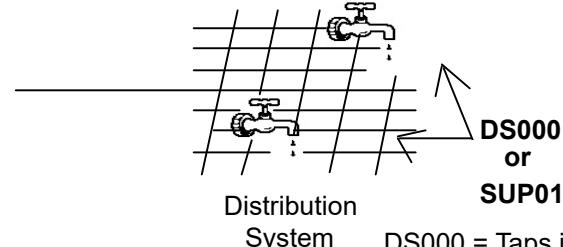

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4238312 MOHICAN RESERVATION CAMP

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255426 Facility Name: MOHICAN RESERVATION CAMP GROUND STU 1
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

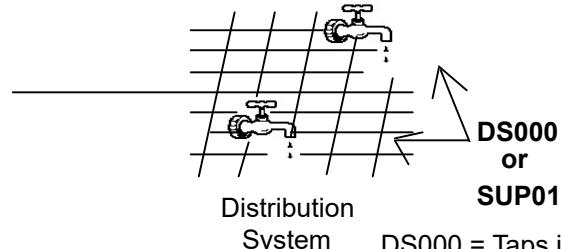

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239112 KOKOSING VALLEY CAMPGROUND PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KOKOSING VALLEY CAMPGROUND DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water
Chemicals	Monitoring Requirements	
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public	

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

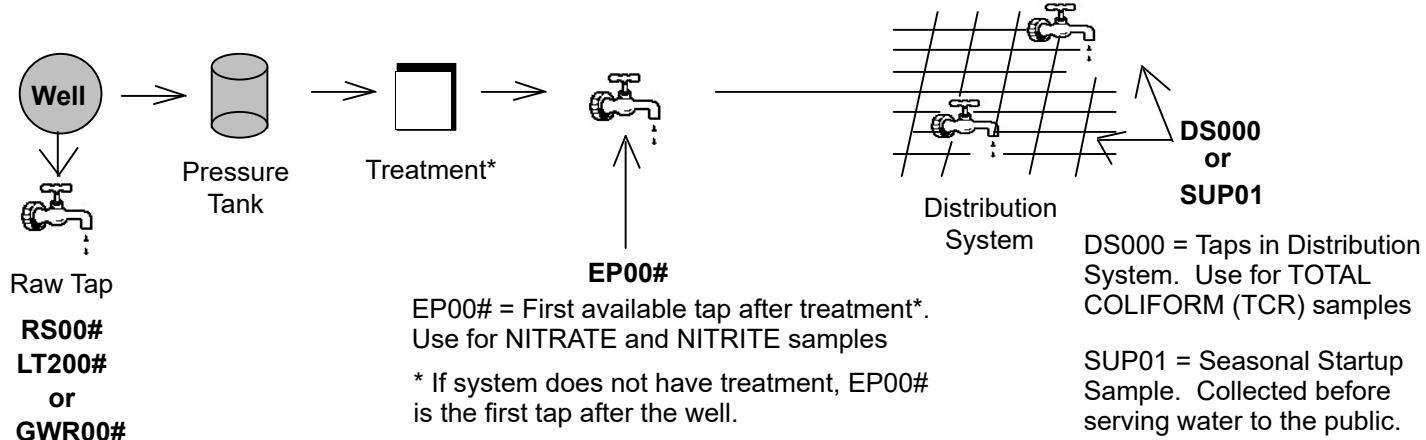

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239112 KOKOSING VALLEY CAMPGROUND PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KOKOSING VALLEY CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water
Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026

Where to Collect Samples For a Small Public Water System

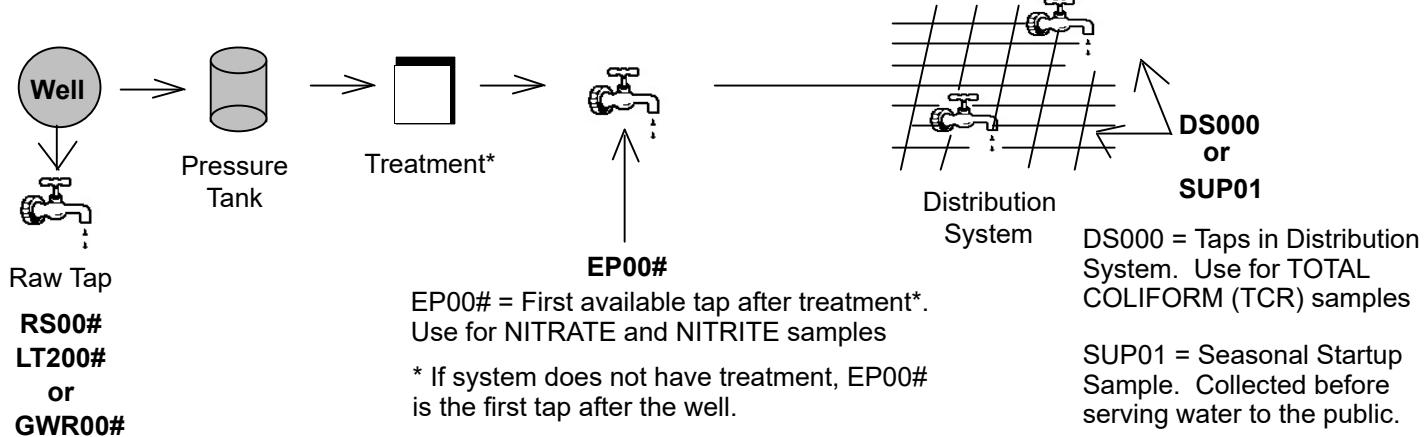

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239112 KOKOSING VALLEY CAMPGROUND PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4260539 Facility Name: KOKOSING VALLEY CAMPGROUND STU 2
Location SMP ID: EP002 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

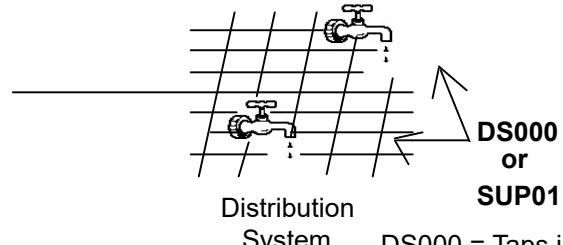

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239112 KOKOSING VALLEY CAMPGROUND PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 9/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255431 Facility Name: KOKOSING VALLEY CAMPGROUND STU 1

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

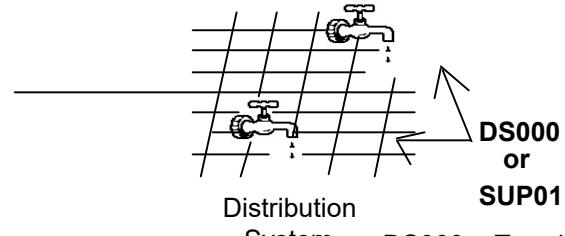

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239812 MT VERNON CHURCH OF GOD

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: MT VERNON CHURCH OF GOD DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

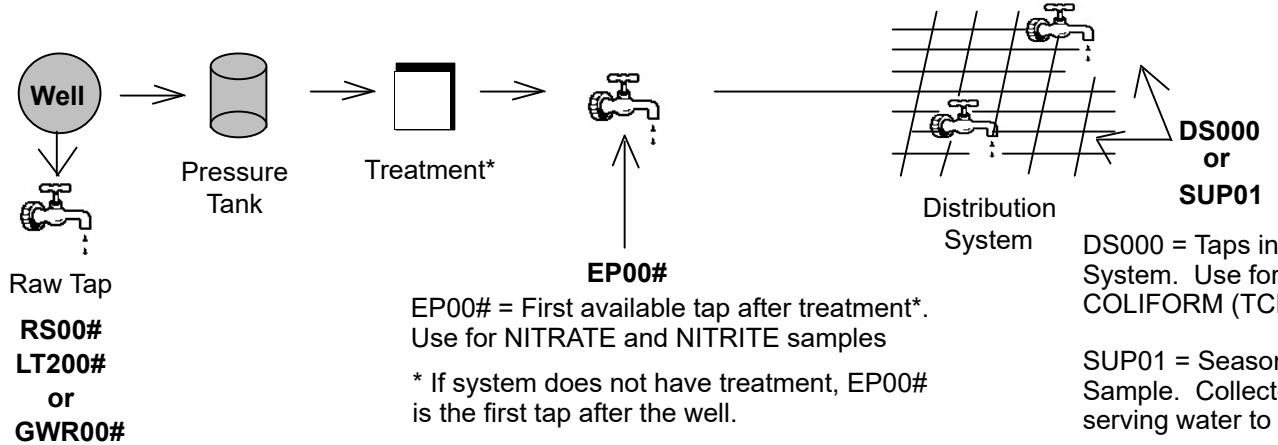

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4239812 MT VERNON CHURCH OF GOD

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255434 Facility Name: **MT VERNON CHURCH OF GOD**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

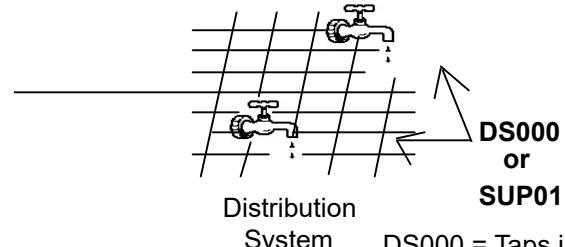

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4240012 CHAPEL HILL GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: CHAPEL HILL GOLF COURSE DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

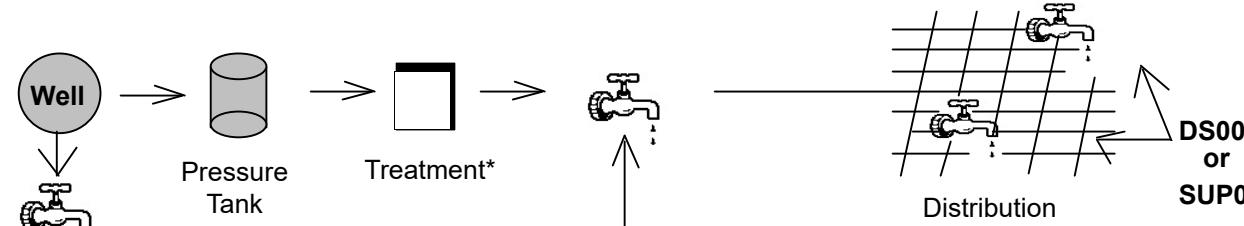

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4240012 CHAPEL HILL GOLF COURSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4255436 Facility Name: CHAPEL HILL GOLF COURSE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

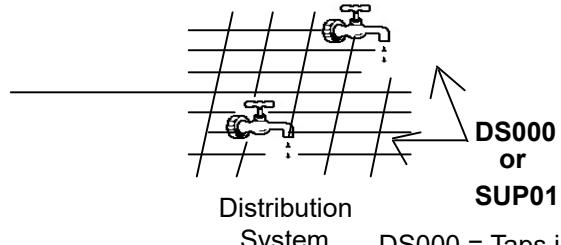

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4240812 KENYON COLLEGE BROWN FAMILY ENVIRONMENTA

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: KENYON COLLEGE ENVIRONMENTAL SCIENCES SE
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

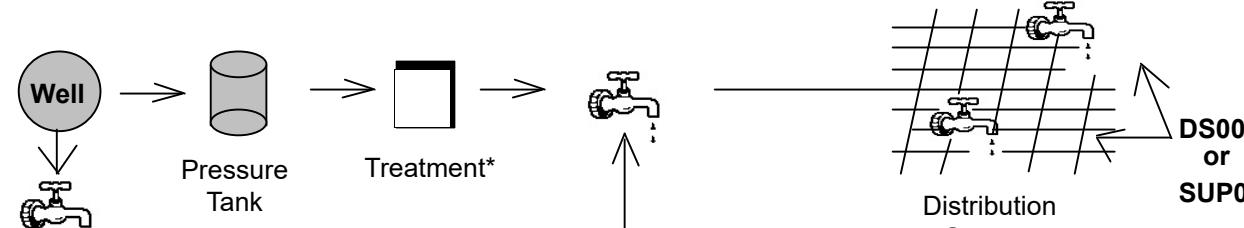

Raw Tap

RS00#

LT200#

or

GWR00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4240812 KENYON COLLEGE BROWN FAMILY ENVIRONMENTA

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4261035 Facility Name: KENYON COLLEGE ENVIRONMENTAL SCIENCES VI
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

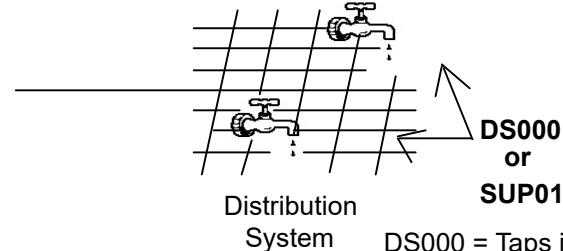

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4241412 CHRIST THE KING COMMUNITY CHURCH PWS

System Type: Transient Noncommunity Source: Ground Water Operating Period: 1/1 to 12/31
Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: CHRIST THE KING COMMUNITY CHURCH DISTRIB
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

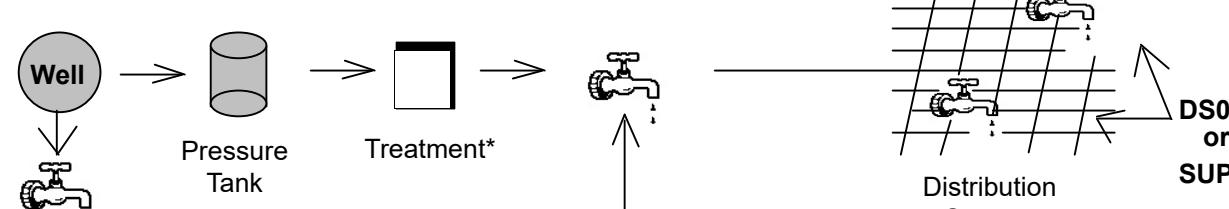

Raw Tap

RS00#

LT200#

or

GWR00#

Pressure
Tank

Treatment*

EP00#

Distribution
System

**DS000
or
SUP01**

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4241412 CHRIST THE KING COMMUNITY CHURCH PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4260763	Facility Name: CHRIST THE KING COMMUNITY CHURCH
Location	SMP ID: EP001	Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

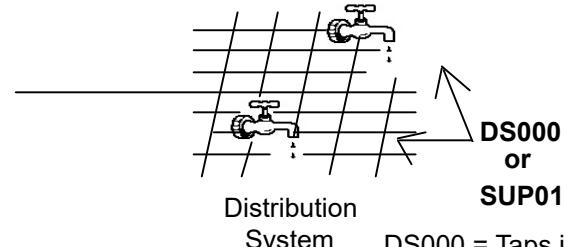

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4241512 MT ZION HOUSE OF PRAYER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: MT ZION HOUSE OF PRAYER DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

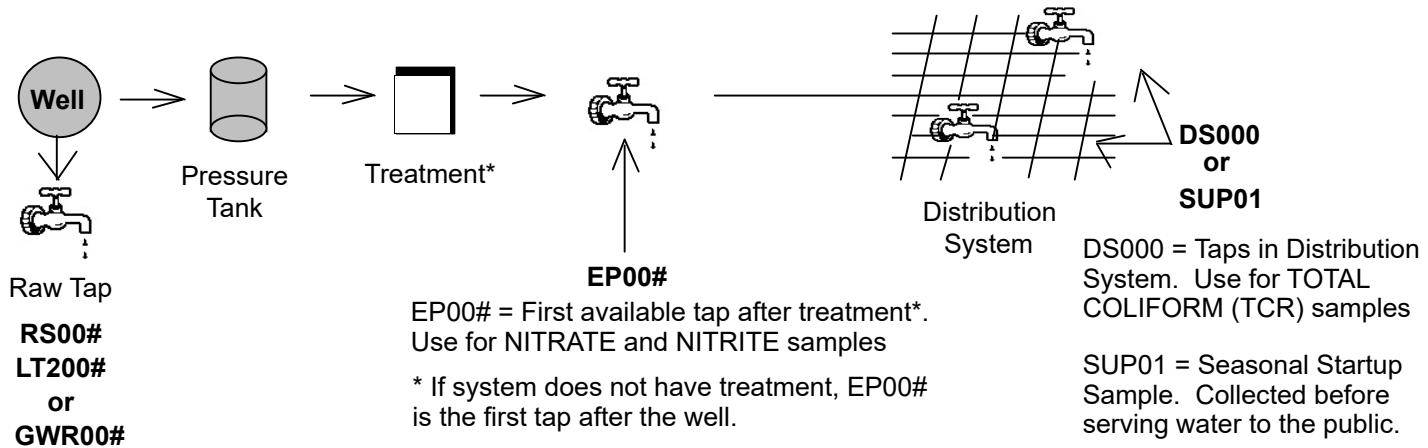

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4241512 MT ZION HOUSE OF PRAYER PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4261253 Facility Name: **MT ZION HOUSE OF PRAYER**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

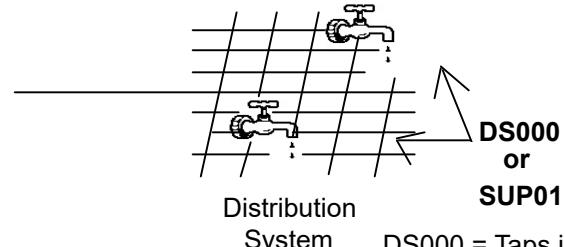

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4242012 COMPLETE CARE ANIMAL HOSPITAL PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: COMPLETE CARE ANIMAL HOSPITAL DIST.
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

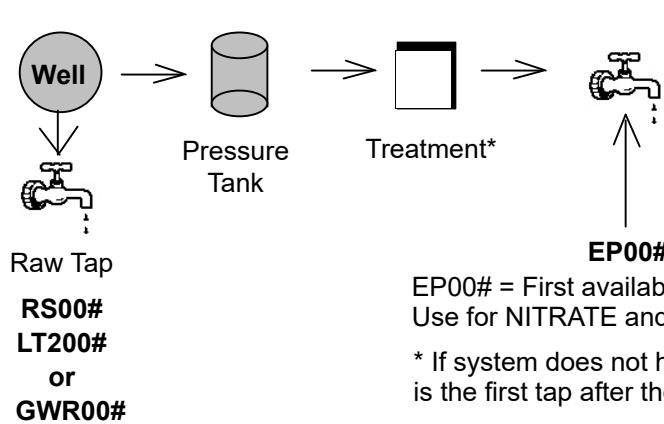

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4242012 COMPLETE CARE ANIMAL HOSPITAL PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4261331 Facility Name: **COMPLETE CARE ANIMAL HOSPITAL**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

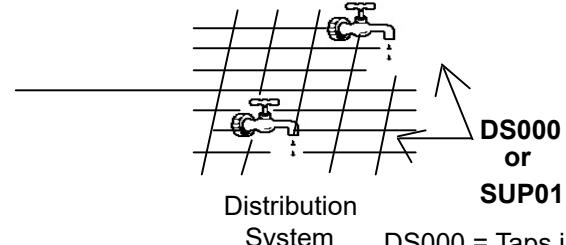

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4242412 GLEN HILL ORCHARDS - AG CAMP PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 8/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: GLEN HILL ORCHARD AG CAMP DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

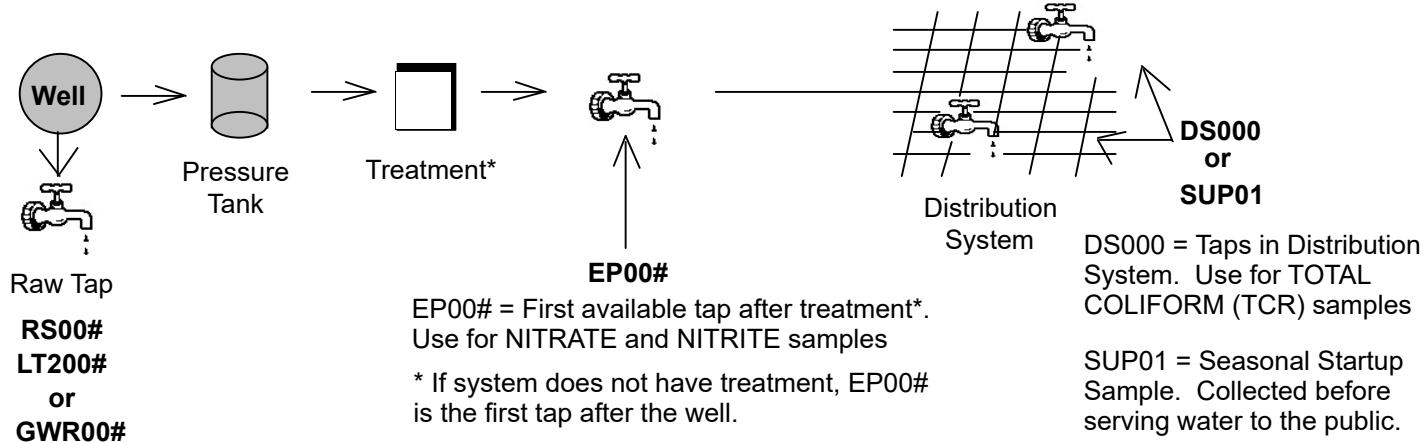

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4242412 GLEN HILL ORCHARDS - AG CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 8/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: GLEN HILL ORCHARD AG CAMP DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 8/18/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026

Where to Collect Samples For a Small Public Water System

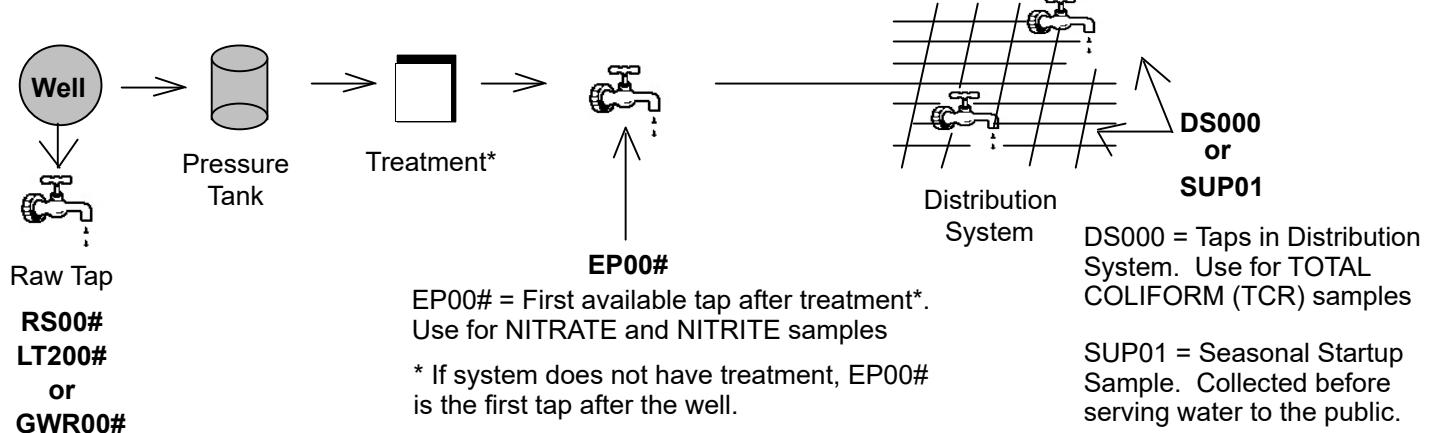

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4242412 GLEN HILL ORCHARDS - AG CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 8/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4260852 Facility Name: GLEN HILL ORCHARD - AG CAMP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

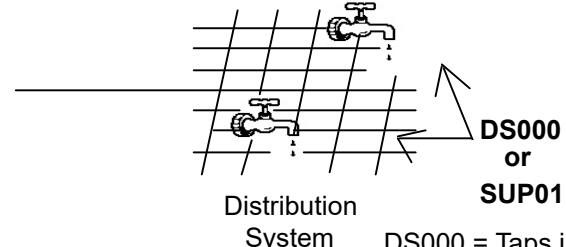

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243312 JOY OF LIVING MINISTRIES INC PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: JOY OF LIVING MINISTRIES DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------


TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

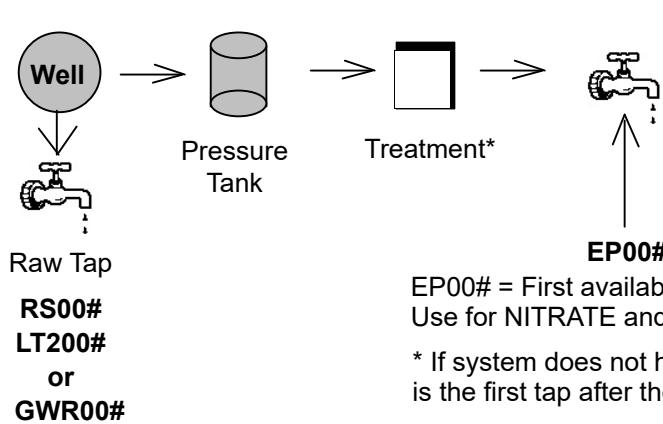

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

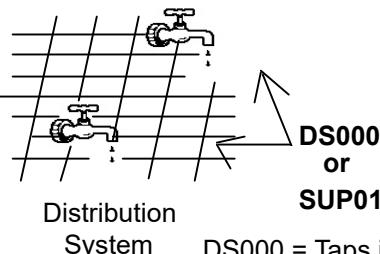

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243312 JOY OF LIVING MINISTRIES INC PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4261780 Facility Name: **JOY OF LIVING MINISTRIES INC**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

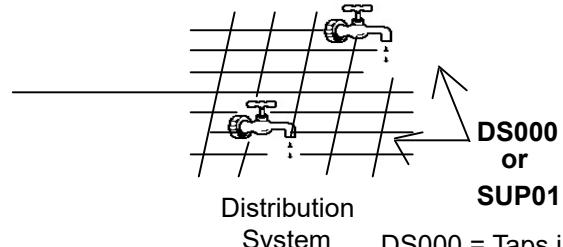

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243512 NEW LIFE COMMUNITY CHURCH

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: NEW LIFE COMMUNITY CHURCH DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

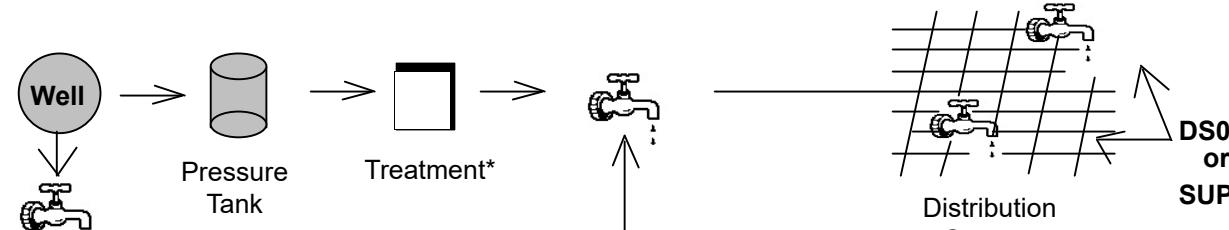

Raw Tap

RS00#

LT200#

or

GWR00#

Pressure
Tank

Treatment*

EP00#

EP00# = First available tap after treatment*.

Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

Distribution
System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243512 NEW LIFE COMMUNITY CHURCH

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262113 Facility Name: NEW LIFE COMMUNITY CHURCH PWS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

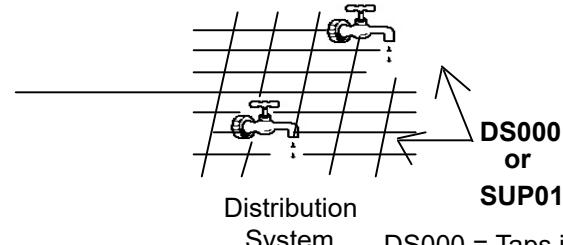

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243612 MOOSES ON CUE

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262213 Facility Name: **MOOSES ON CUE WTP**


Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals **Monitoring Requirements**

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System

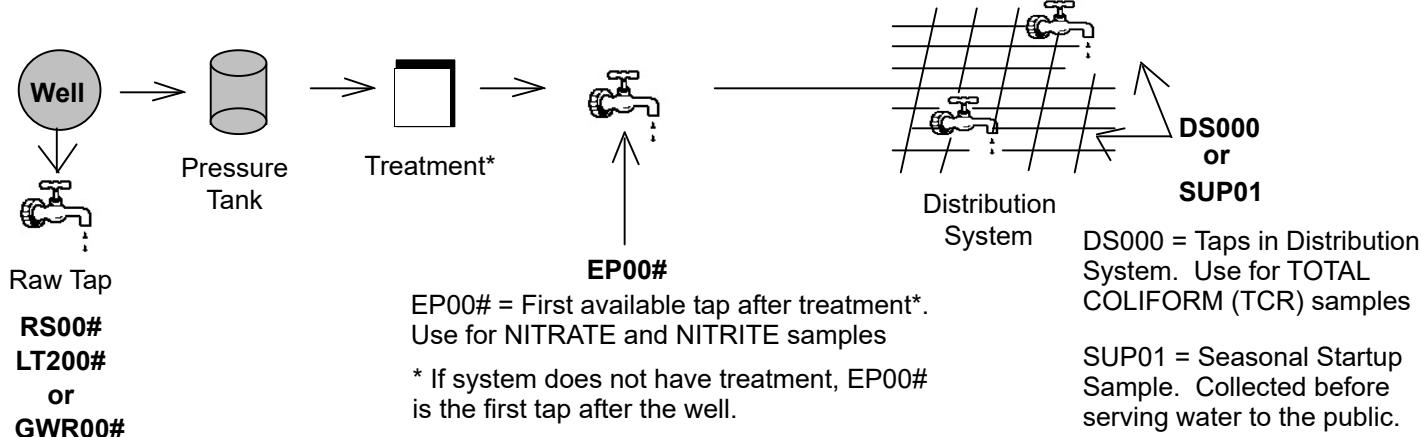

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4243912 LANNINGS FOODS

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4262347	Facility Name: LANNINGS FOODS
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH4243912 LANNINGS FOODS

System Type: Nontransient Noncommunity Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: LANNINGS FOODS DISTRIBUTION

Location SMP ID: DS000

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Sampling Facility ID: DS1 Facility Name: LANNINGS FOODS DISTRIBUTION

Location SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH4244012 SMITHHISLER MEATS INC PWS

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SMITHHISLER MEATS INC DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		1 Sample(s) Required between 1/1/2026 and 1/31/2026
		1 Sample(s) Required between 2/1/2026 and 2/28/2026
		1 Sample(s) Required between 3/1/2026 and 3/31/2026
		1 Sample(s) Required between 4/1/2026 and 4/30/2026
		1 Sample(s) Required between 5/1/2026 and 5/31/2026
		1 Sample(s) Required between 6/1/2026 and 6/30/2026
		1 Sample(s) Required between 7/1/2026 and 7/31/2026
		1 Sample(s) Required between 8/1/2026 and 8/31/2026
		1 Sample(s) Required between 9/1/2026 and 9/30/2026
		1 Sample(s) Required between 10/1/2026 and 10/31/2026
		1 Sample(s) Required between 11/1/2026 and 11/30/2026
		1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

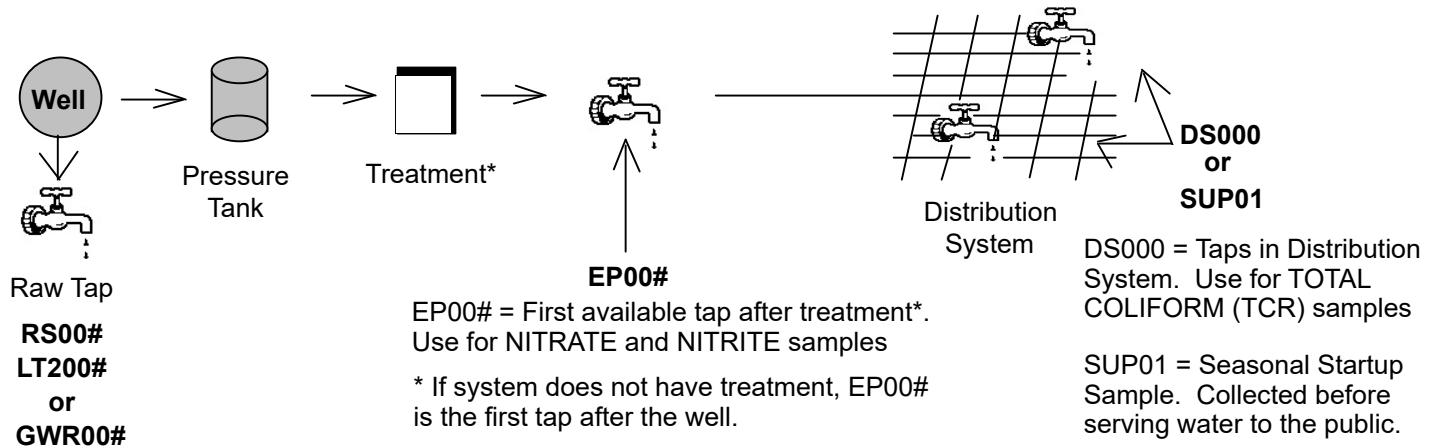

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244012 SMITHHISLER MEATS INC PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262348 Facility Name: SMITHHISLER MEATS INC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

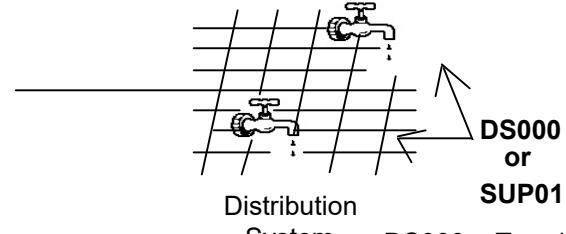

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244112 LIVING HOPE CONSERVATIVE MENNONITE PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: LIVING HOPE CONCERTED MENNONITE CH DIST
Location	SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

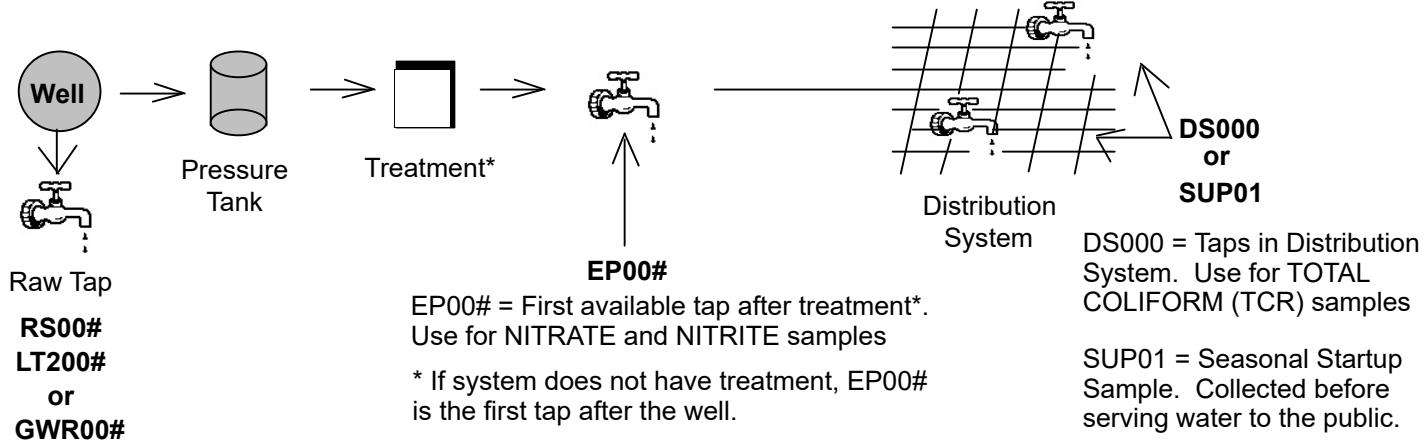

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244112 LIVING HOPE CONSERVATIVE MENNONITE PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4262355	Facility Name: LIVING HOPE CONCERTED MENNONITE CHURCH
Location	SMP ID: EP001	Facility Source: Ground Water
Chemicals		Monitoring Requirements
NITRITE - 1041		Not Required
NITRATE - 1040		1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

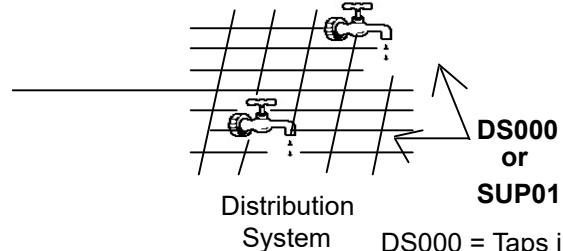

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244713 CATHOLIC YOUTH SUMMER CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water
Chemicals		Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

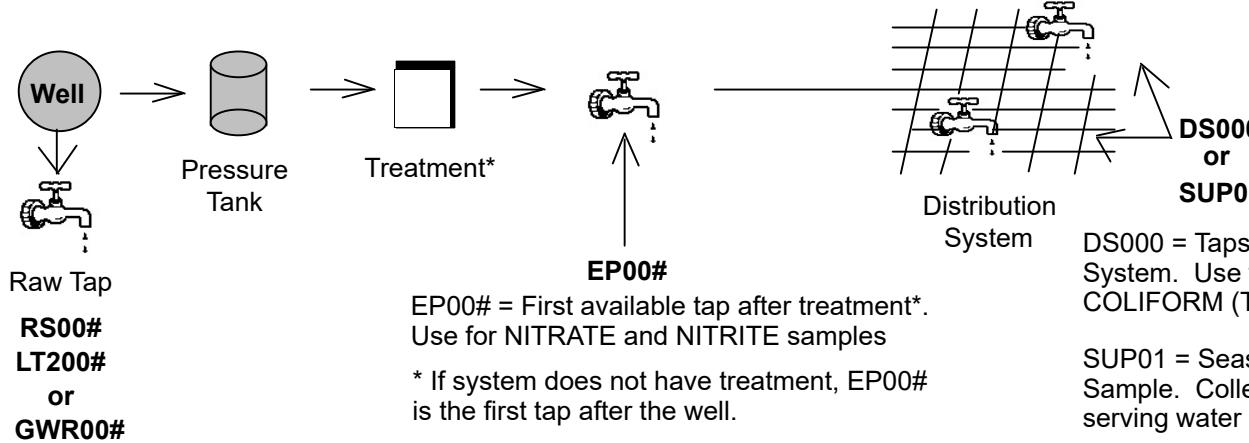

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244713 CATHOLIC YOUTH SUMMER CAMP PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262435 Facility Name: CATHOLIC YOUTH SUMMER CAMP WATER TP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

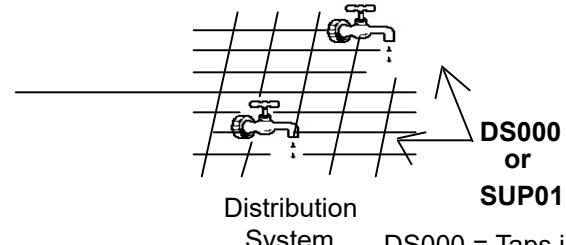

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244714 THE MOHICANS PWS

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: THE MOHICANS DISTRIBUTION


Location SMP ID: DS000 Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

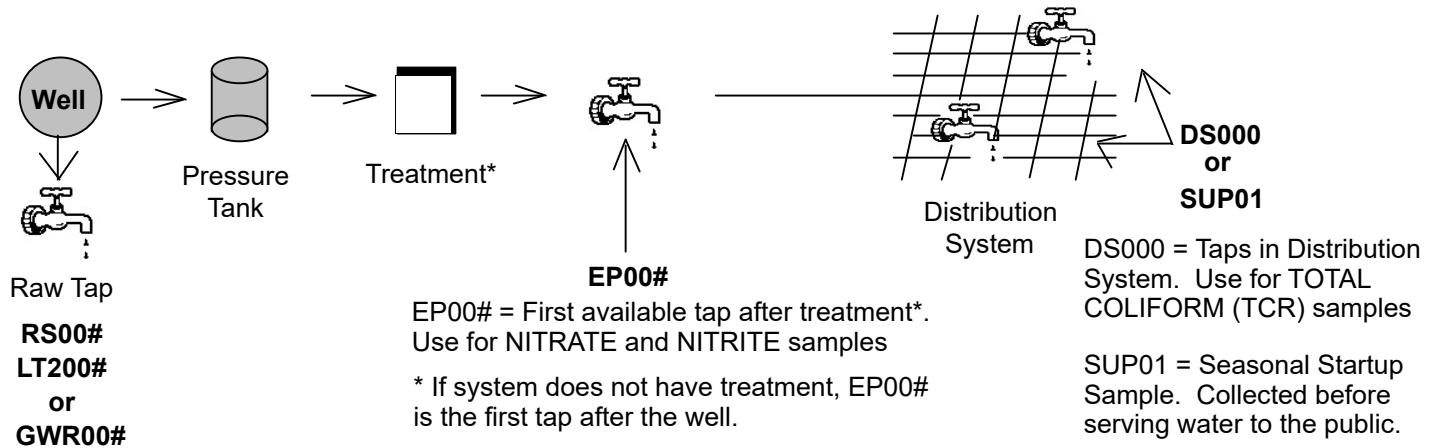

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244714 THE MOHICANS PWS

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262436 Facility Name: **THE MOHICANS**

Location SMP ID: EP001 Facility Source: **Ground Water**


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#

LT200#

or

GWR00#

Pressure


Tank

Treatment*

EP00#

EP00# = First available tap after treatment*.
Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00#
is the first tap after the well.

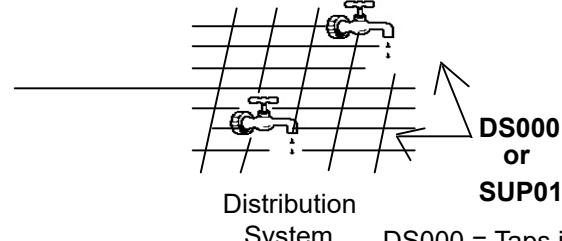

Distribution
System

DS000
or
SUP01

DS000 = Taps in Distribution
System. Use for TOTAL
COLIFORM (TCR) samples

SUP01 = Seasonal Startup
Sample. Collected before
serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244717 DOLLAR GENERAL #20078 - MT VERNON

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DOLLAR GENERAL #20078 - MT VERNON DIST.
Location	SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

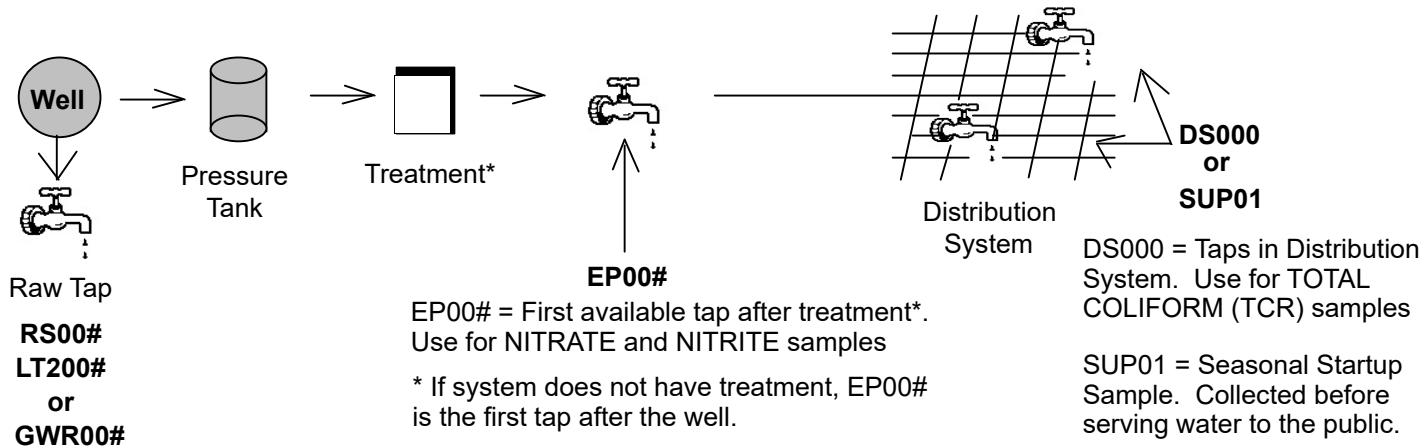

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244717 DOLLAR GENERAL #20078 - MT VERNON

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 4262439	Facility Name: DOLLAR GENERAL #20078 - MT VERNON PLANT
Location	SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

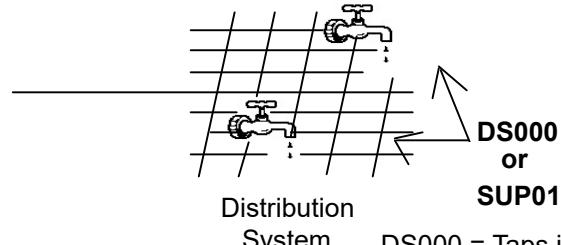

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244720 MOHICAN WILDERNESS WINDMILL

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**

Location SMP ID: **SUP01** Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

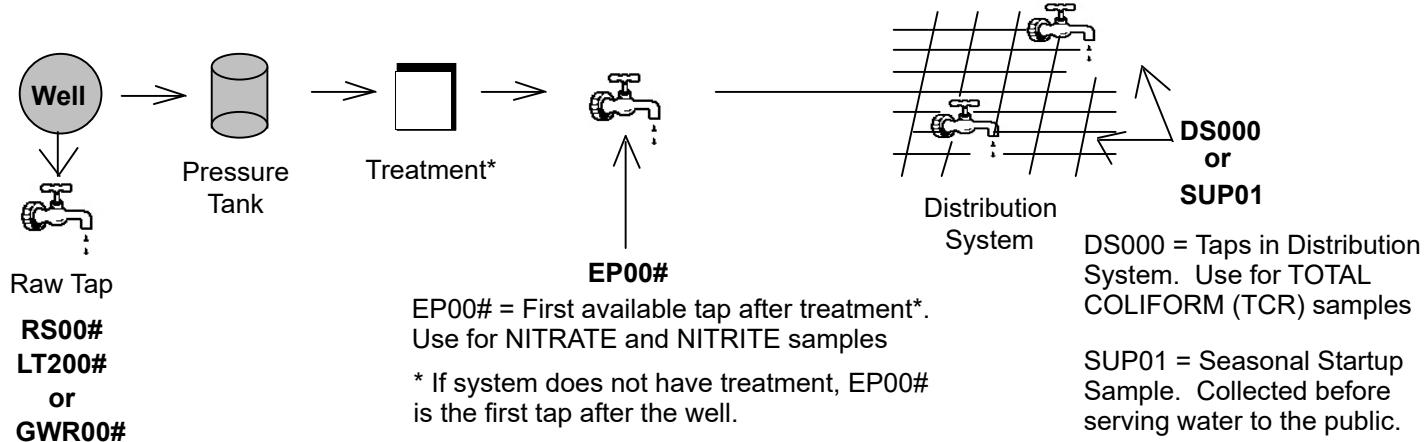

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244720 MOHICAN WILDERNESS WINDMILL

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: **DISTRIBUTION**
Location SMP ID: DS000 Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/5/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

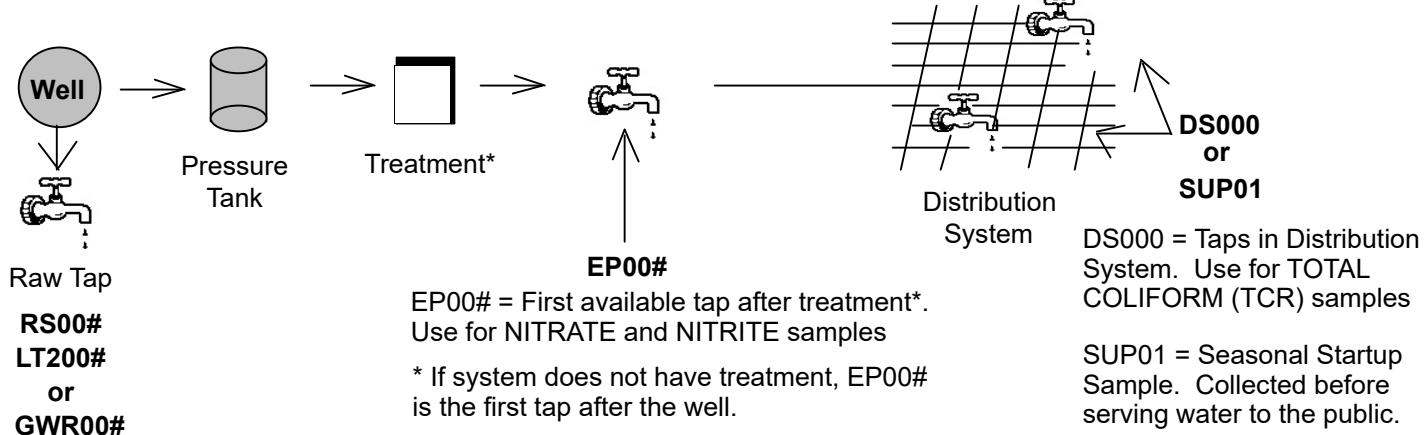

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244720 MOHICAN WILDERNESS WINDMILL

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262442 Facility Name: MOHICAN WILDERNESS WINDMILL PLANT
Location SMP ID: EP001 Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

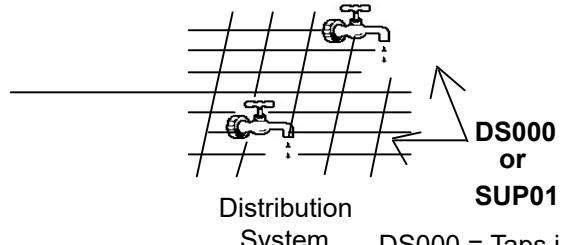

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244721 SPARTA HOUSE

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION


Location SMP ID: DS000 Facility Source:

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between 1 Sample(s) Required between	1/1/2026 and 3/31/2026 4/1/2026 and 6/30/2026 7/1/2026 and 9/30/2026 10/1/2026 and 12/31/2026
-----------------------------	--	--

Where to Collect Samples For a Small Public Water System

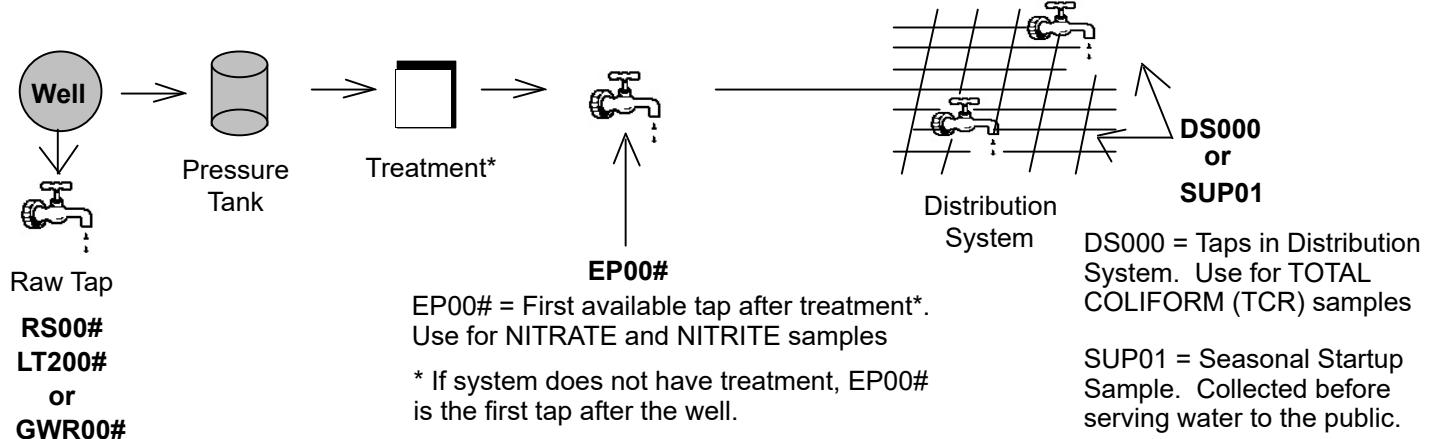

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH4244721 SPARTA HOUSE

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4262443 Facility Name: **SPARTA HOUSE PLANT**

Location SMP ID: EP001 Facility Source:


Chemicals

Monitoring Requirements

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 1/1/2026 and 5/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

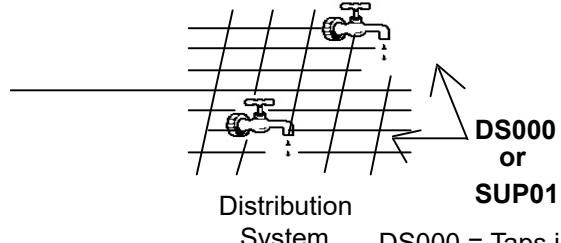

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!