

Subject: 2026 PWS Monitoring Schedules Now Available

Dear Public Water System (PWS) Owner:

The 2026 Contaminant Monitoring Schedules have been created and are now available online at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/monitoring-and-reporting>. The schedules are separated by principal county served and listed in PWS ID order. By using the “Ctrl” + “F” search tool, you can search for your schedule(s) by PWS ID or by your business/system name.

Please find and view your schedule(s). Review both the Entry Point and Distribution Schedules (if applicable). Ohio EPA recommends that you print the schedules and keep them in a visible location as a reminder of when to sample. **Be sure to check all pages for sampling requirements; some contaminants may span multiple pages.**

Your schedule(s) may be revised during the year based on your sample results. A targeted monthly email will be sent to any PWS that has a schedule revision. If you would like to be notified when Ohio EPA posts revised schedules, please see the “Subscribe to Updates” section below.

IMPORTANT REMINDERS ABOUT DRINKING WATER SAMPLING

We recommend collecting samples **early in the scheduled monitoring period** to ensure prompt reporting of results and to allow time if a resample is required. Samples collected before or after the scheduled monitoring period(s) will not meet your compliance requirements. Failure to properly sample for total coliform or nitrate could cost you \$150 or more in penalties for each monitoring violation. [Save a Dime. Sample on Time!](#)

When you submit your samples to the laboratory, identify the tap location/address where each sample was collected, your PWS ID, the sample monitoring point (SMP) for this location, and the Facility ID.

- For the chemicals listed on the Entry Point Schedule, the samples should be collected at the first available tap after all treatment and marked with the EP00# listed at the top of the schedule.
- For the Distribution Schedule, sampling location information is listed for each individual contaminant.
- Additionally, for all routine samples, please include a description of the tap from which the sample was collected, such as “women’s restroom sink” or “kitchen hand sink”, in the “Street Address and Tap Location” field on the laboratory sample submittal form.

A list of certified laboratories can be found online at:

<https://epa.ohio.gov/static/Portals/28/documents/labcert/Combined-Lab-List.pdf>. Should you wish to hire someone to collect samples for you, a list of drinking water sampling services that can assist

you with collecting water samples is located online at:

<https://dam.assets.ohio.gov/image/upload/epa.ohio.gov/Portals/28/documents/pws/DWSample.pdf>.

The distribution requirements only need to be met by your overall system, not for individual treatment plants. For water systems with more than one Entry Point Schedule, the individual entry point schedules will be listed first, followed by the single distribution system schedule.

- **Lead and Copper Monitoring:** PWSs whose application for reduced triennial monitoring was denied, or that did not apply, will find the annual monitoring requirement for lead and copper on the 2026 monitoring schedule.
- **Disinfection Byproducts (DBP) Monitoring:** Pay special attention to the number of locations and date ranges listed; there may be multiple pages with monitoring requirements for these contaminants. Each locational requirement is listed separately with a unique SMP ID (DS20# or MM00#). The MM00# location will only be listed if your PWS has been notified by Ohio EPA of the requirement to conduct sampling at your designated master meter location per requirements set forth in OAC 3745-81-24. The DBP sampling requirements also state that a “dual sample set” must be collected. **A dual sample set means that both HAA5 and TTHM should be collected at the same location, and at the same time, for each required DBP sample.**
- **Total Coliform Monitoring:**
 - All PWSs must follow their written sample siting plan which identifies the required sampling site taps. Please contact your Ohio EPA District Office if you have any questions regarding sampling for this contaminant and/or updates to your sample siting plan(s). Additional information can be found at: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/revised-total-coliform-rule>.
 - Routine and seasonal startup total coliform monitoring requirements are listed on the schedule. If you operate a seasonal system, please note that the seasonal startup sample is required to be collected before you open for the season; this sample is in addition to the routine samples listed on the distribution system schedule.
 - If your schedule denotes your system as a *Ground Water Rule Substantial System*, you will be required to conduct additional triggered source monitoring along with collecting the required repeat samples should any routine sample be determined to have total coliform bacteria present.
- **Harmful Algal Bloom (HAB) Monitoring – Surface Water PWSs Only:** Please visit the following website for monitoring information and schedules (both routine and/or increased) specific to your PWS: <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/harmful-algal-blooms>.
- **Asbestos Monitoring:** Community and NTNC PWSs are required to report any discovery of previously unidentified asbestos-cement (A/C) pipe to Ohio EPA. Systems that do not contain

A/C pipes may qualify for a waiver. The next round of asbestos monitoring will begin in 2029. Please contact Ohio EPA for more information about historical A/C pipe certifications or waivers.

Subscribe to Updates: Sign up for and manage subscriptions for Ohio EPA electronic message updates including monitoring reminders, notification of revised monitoring schedules, and rule updates at: <https://public.govdelivery.com/accounts/OHEPA/subscriber/new>.

For Transient Non-Community (TNC) PWSs Only

Ohio EPA has issued a TNC guide that provides information about how to meet Ohio EPA's requirements. Using this guide may help you avoid many of the common mistakes that lead to violations, including missed monitoring. You can request a hard copy, or view this document online at: <https://epa.ohio.gov/static/Portals/28/documents/transientPWS-guide.pdf>.

**Questions? Call your Southeast District Office at: 740-385-8501
or the DDAGW Central Office at (614) 644-2752.**

Total Coliform Bacteria – [County Inspector](#)

Disinfection Byproducts – Compliance Assurance Section 614-644-2752

Volatile Organic Chemicals – Compliance Assurance Section 614-644-2752

Nitrate, Nitrite, Synthetic Organic Chemicals – [Nikki Stiteler](#)

Radiologicals – [Isabel Leitholf](#)

Inorganic Chemicals, Asbestos – [Yun Yi Amelie Thomas](#)

Lead & Copper – [Jodi Hall, Zach Anderson](#)

Harmful Algal Blooms – [Haley McLean](#)



OH6600012 BEAVER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657250	Facility Name: BEAVER WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026	
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026	
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051	ATRAZINE - 2050	SIMAZINE - 2037
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	



OH6600012 BEAVER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: BEAVER DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: BEAVER DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6600012 BEAVER PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BEAVER DISTRIBUTION

Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6600312 AQUA OHIO - LAKE WHITE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: AQUA OHIO - WHITE DISTRICT DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 2/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

Samples should be collected at the same time and place as the Total Coliform samples.



OH6600312 AQUA OHIO - LAKE WHITE PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: AQUA OHIO - WHITE DISTRICT DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.

Sampling	Facility ID: DS1	Facility Name: AQUA OHIO - WHITE DISTRICT DISTRIBUTION
Location	SMP ID: DS201	379 VALLERY WAVERLY OH

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: AQUA OHIO - WHITE DISTRICT DISTRIBUTION
Location	SMP ID: DS202	11875 RT.104

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6600712 PIKETON VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657253	Facility Name: PIKETON VILLAGE
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6600712 PIKETON VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PIKETON, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: PIKETON, VILLAGE OF DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6600712 PIKETON VILLAGE PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PIKETON, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS201	118 FAIRWAY AVE.

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2026 and 3/14/2026 at: DS201
	Dual Sample Required between 6/8/2026 and 6/14/2026 at: DS201
	Dual Sample Required between 9/8/2026 and 9/14/2026 at: DS201
	Dual Sample Required between 12/8/2026 and 12/14/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: PIKETON, VILLAGE OF DISTRIBUTION
Location	SMP ID: DS202	626 PIKETON RD.

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2026 and 3/14/2026 at: DS202
	Dual Sample Required between 6/8/2026 and 6/14/2026 at: DS202
	Dual Sample Required between 9/8/2026 and 9/14/2026 at: DS202
	Dual Sample Required between 12/8/2026 and 12/14/2026 at: DS202

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6600912 WAVERLY CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657254	Facility Name: WAVERLY WTP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 12/31/2026
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6600912 WAVERLY CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: WAVERLY, CITY OF DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		5 Sample(s) Required between 1/1/2026 and 1/31/2026 5 Sample(s) Required between 2/1/2026 and 2/28/2026 5 Sample(s) Required between 3/1/2026 and 3/31/2026 5 Sample(s) Required between 4/1/2026 and 4/30/2026 5 Sample(s) Required between 5/1/2026 and 5/31/2026 5 Sample(s) Required between 6/1/2026 and 6/30/2026 5 Sample(s) Required between 7/1/2026 and 7/31/2026 5 Sample(s) Required between 8/1/2026 and 8/31/2026 5 Sample(s) Required between 9/1/2026 and 9/30/2026 5 Sample(s) Required between 10/1/2026 and 10/31/2026 5 Sample(s) Required between 11/1/2026 and 11/30/2026 5 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: WAVERLY, CITY OF DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs
-------------------	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6600912 WAVERLY CITY PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: WAVERLY, CITY OF DISTRIBUTION

Location SMP ID: DS201 827 ARMBRUSTER PARKWAY

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling Facility ID: DS1 Facility Name: WAVERLY, CITY OF DISTRIBUTION

Location SMP ID: DS202 505 NORTH HIGH STREET

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6601412 DAWSONS MOBILE HOME PARK PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657255	Facility Name: DAWSONS MHP
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2026 and 3/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	1 Sample(s) Required between 4/1/2026 and 6/30/2026
<i>Sample for all the analytes listed below:</i>	
BENZO (A) PYRENE - 2306 DI(2-ETHYLHEXYL) - ADIPATE - 2035 DI(2-ETHYLHEXYL) - PHTHALATE - 2039	
ENDOTHALL - 2033	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6601412 DAWSONS MOBILE HOME PARK PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: DAWSONS MOBILE HOME PAR DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: DAWSONS MOBILE HOME PAR DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6601412 DAWSONS MOBILE HOME PARK PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DAWSONS MOBILE HOME PAR DISTRIBUTION

Location SMP ID: DS201 4097 WAKEFIELD MOUND ROAD LOT 416

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6601803 PIKE WATER, INC.-ROSS 2 PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** **** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 2 DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------------	--

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026 1 Sample(s) Required between 2/1/2026 and 2/28/2026 1 Sample(s) Required between 3/1/2026 and 3/31/2026 1 Sample(s) Required between 4/1/2026 and 4/30/2026 1 Sample(s) Required between 5/1/2026 and 5/31/2026 1 Sample(s) Required between 6/1/2026 and 6/30/2026 1 Sample(s) Required between 7/1/2026 and 7/31/2026 1 Sample(s) Required between 8/1/2026 and 8/31/2026 1 Sample(s) Required between 9/1/2026 and 9/30/2026 1 Sample(s) Required between 10/1/2026 and 10/31/2026 1 Sample(s) Required between 11/1/2026 and 11/30/2026 1 Sample(s) Required between 12/1/2026 and 12/31/2026
-----------------------	--

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 2 DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2026 and 9/30/2026
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6601803 PIKE WATER, INC.-ROSS 2 PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 2 DISTRIBUTION
Location	SMP ID: DS201	262 WOODS HOLLOW RD

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 2 DISTRIBUTION
Location	SMP ID: DS202	700 HIGBY RD

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6602303 PIKE WATER, INC.-ROSS 3 PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 3 DISTRIBUTION
		SMP ID: DS000

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2026 and 1/31/2026
	1 Sample(s) Required between 2/1/2026 and 2/28/2026
	1 Sample(s) Required between 3/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026
	1 Sample(s) Required between 11/1/2026 and 11/30/2026
	1 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: PIKE WATER, INC.-ROSS 3 DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



OH6602303 PIKE WATER, INC.-ROSS 3 PWS

System Type: Community

Source: Purchased Ground Water
Ground Water Rule Substantial System

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PIKE WATER, INC.-ROSS 3 DISTRIBUTION

Location SMP ID: DS201 14 WOODLAND PARKS

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6602412 PIKE WATER, INC.-PLANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657259	Facility Name: PIKE WATER INC PLANT 1
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements	
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026	
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026	
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051	ATRAZINE - 2050	SIMAZINE - 2037
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	



OH6602412 PIKE WATER, INC.-PLANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6662136	Facility Name: PIKE WATER INC WTP 2
Location	SMP ID: EP002	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2026 and 10/31/2026
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6602412 PIKE WATER, INC.-PLANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2026**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-PLANT DISTRIBUTION
Location	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000	15 Sample(s) Required between 1/1/2026 and 1/31/2026 15 Sample(s) Required between 2/1/2026 and 2/28/2026 15 Sample(s) Required between 3/1/2026 and 3/31/2026 15 Sample(s) Required between 4/1/2026 and 4/30/2026 15 Sample(s) Required between 5/1/2026 and 5/31/2026 15 Sample(s) Required between 6/1/2026 and 6/30/2026 15 Sample(s) Required between 7/1/2026 and 7/31/2026 15 Sample(s) Required between 8/1/2026 and 8/31/2026 15 Sample(s) Required between 9/1/2026 and 9/30/2026 15 Sample(s) Required between 10/1/2026 and 10/31/2026 15 Sample(s) Required between 11/1/2026 and 11/30/2026 15 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-PLANT DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6602412 PIKE WATER, INC.-PLANT PWS

System Type: Community

Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2026

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-PLANT DISTRIBUTION
Location	SMP ID: DS201 781 ST. RT. 104 LUCASVILLE	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: PIKE WATER, INC.-PLANT DISTRIBUTION
Location	SMP ID: DS202 6100 CLINES CHAPEL ROAD	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6630712 LONGS RETREAT MAIN SYSTEM

System Type: Transient Noncommunity

Source: Ground Water

Ground Water Rule Substantial System

Operating Period: 4/1 to 10/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT MAIN DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water
Chemicals	Monitoring Requirements	
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public	

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

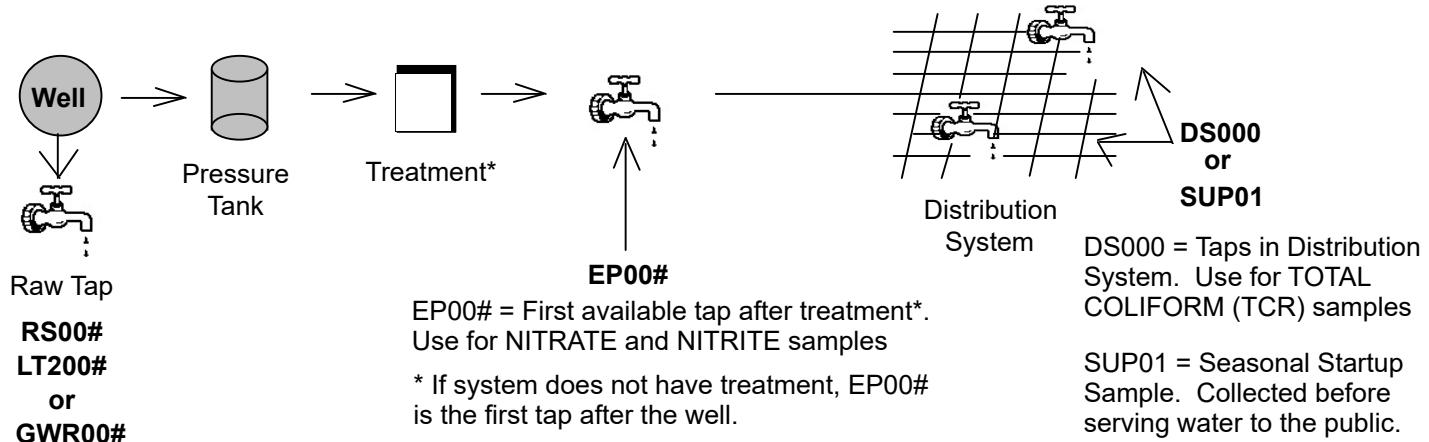

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6630712 LONGS RETREAT MAIN SYSTEM

System Type: Transient Noncommunity

Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT MAIN DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

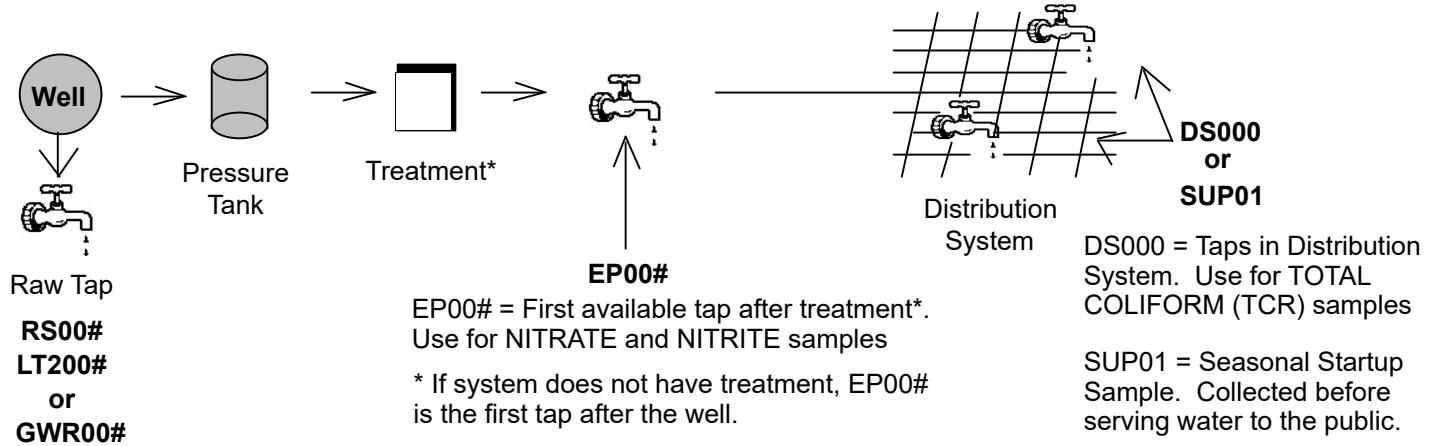

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6630712 LONGS RETREAT MAIN SYSTEM

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6657263 Facility Name: LONGS RETREAT MAIN SYSTEM-NT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

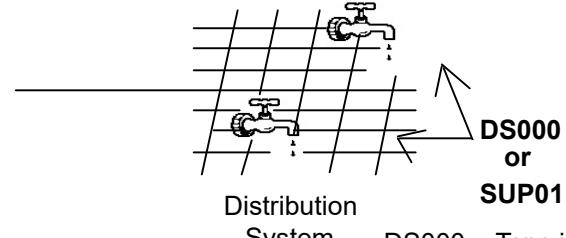

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6631012 LONGS RETREAT WELL 14

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT WELLS 14 DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

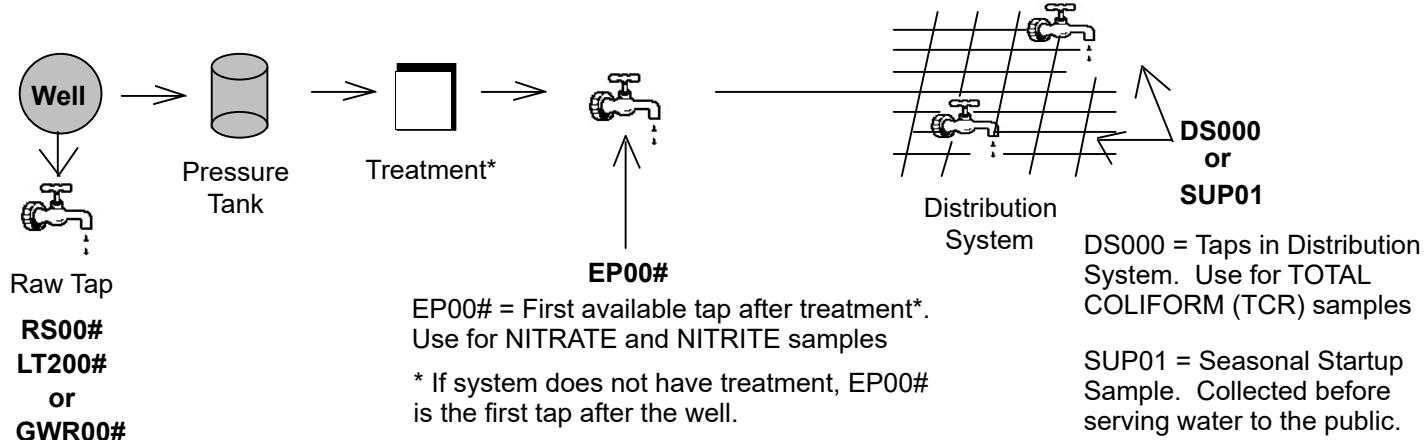

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6631012 LONGS RETREAT WELL 14

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility	ID: DS1	Facility Name: LONGS RETREAT WELLS 14 DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

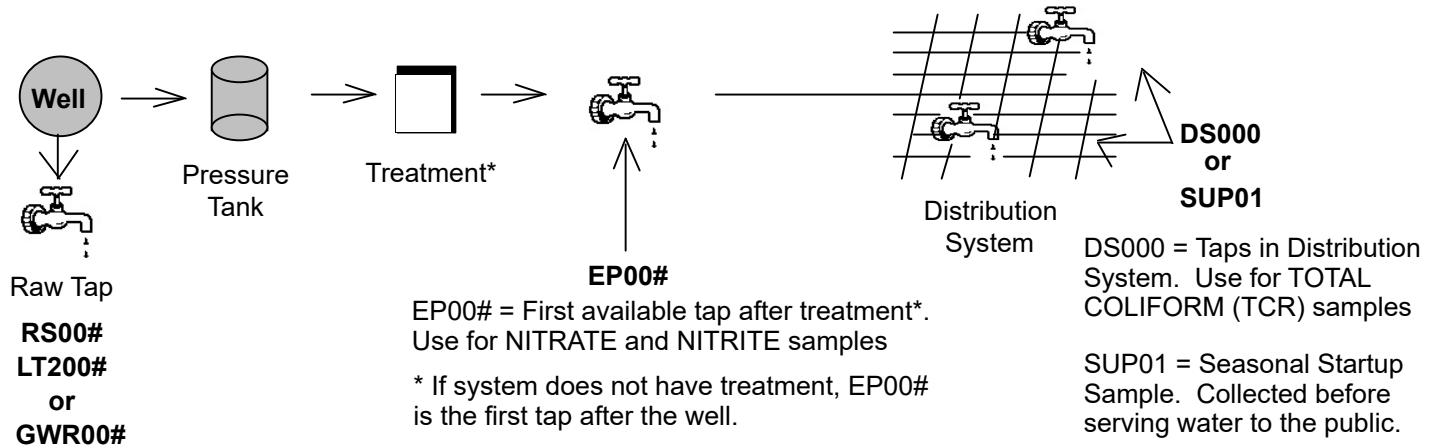

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6631012 LONGS RETREAT WELL 14

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6657266 Facility Name: **LONGS RETREAT WELLS 14**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

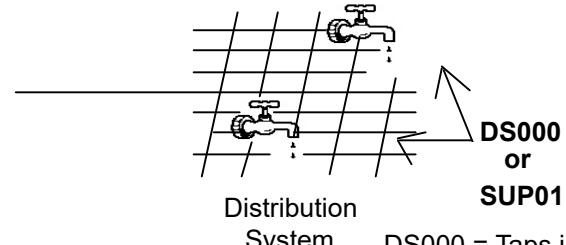

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6632414 MISSION CONVERSION SERVICES ALLIANCE LLC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6657269	Facility Name: PORTSMOUTH GASEOUS DIFFUSION PLANT
Location	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH6632414 MISSION CONVERSION SERVICES ALLIANCE LLC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 Facility Name: PORTSMOUTH GAS DIFFUSION DISTRIBUTION SMP ID: DS000	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100		2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026
TOTAL CHLORINE - 1000		2 Sample(s) Required between 1/1/2026 and 1/31/2026 2 Sample(s) Required between 2/1/2026 and 2/28/2026 2 Sample(s) Required between 3/1/2026 and 3/31/2026 2 Sample(s) Required between 4/1/2026 and 4/30/2026 2 Sample(s) Required between 5/1/2026 and 5/31/2026 2 Sample(s) Required between 6/1/2026 and 6/30/2026 2 Sample(s) Required between 7/1/2026 and 7/31/2026 2 Sample(s) Required between 8/1/2026 and 8/31/2026 2 Sample(s) Required between 9/1/2026 and 9/30/2026 2 Sample(s) Required between 10/1/2026 and 10/31/2026 2 Sample(s) Required between 11/1/2026 and 11/30/2026 2 Sample(s) Required between 12/1/2026 and 12/31/2026

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 Facility Name: PORTSMOUTH GAS DIFFUSION DISTRIBUTION SMP ID: LC### Refer to your Lead and Copper plan for SMP IDs	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022		10 Sample(s) Required between 6/1/2026 and 9/30/2026

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <https://epa.ohio.gov/divisions-and-offices/drinking-and-ground-waters/public-water-systems/lead-and-copper-in-public-water-systems>.



OH6632414 MISSION CONVERSION SERVICES ALLIANCE LLC

System Type: Nontransient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PORTSMOUTH GAS DIFFUSION DISTRIBUTION
Location	SMP ID: DS201	X-1000 BUILDING

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS201
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.

Sampling	Facility ID: DS1	Facility Name: PORTSMOUTH GAS DIFFUSION DISTRIBUTION
Location	SMP ID: DS202	X-1007 BUILDING

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2026 and 9/30/2026 at: DS202
-------------------------	---

Sample for all the analytes listed below:

TOTAL HALOACETIC ACIDS (HAA5) – 2456 and TTHM - 2950

A dual sample set means that both HAA5 and TTHM should be collected at the same location and at the same time, for each required sample.



OH6633312 LONGS RETREAT WELL 11

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1 Facility Name: **LONGS RETREAT WELL 11 DISTRIBUTION**
Location SMP ID: SUP01 Facility Source: **Ground Water**

Chemicals **Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

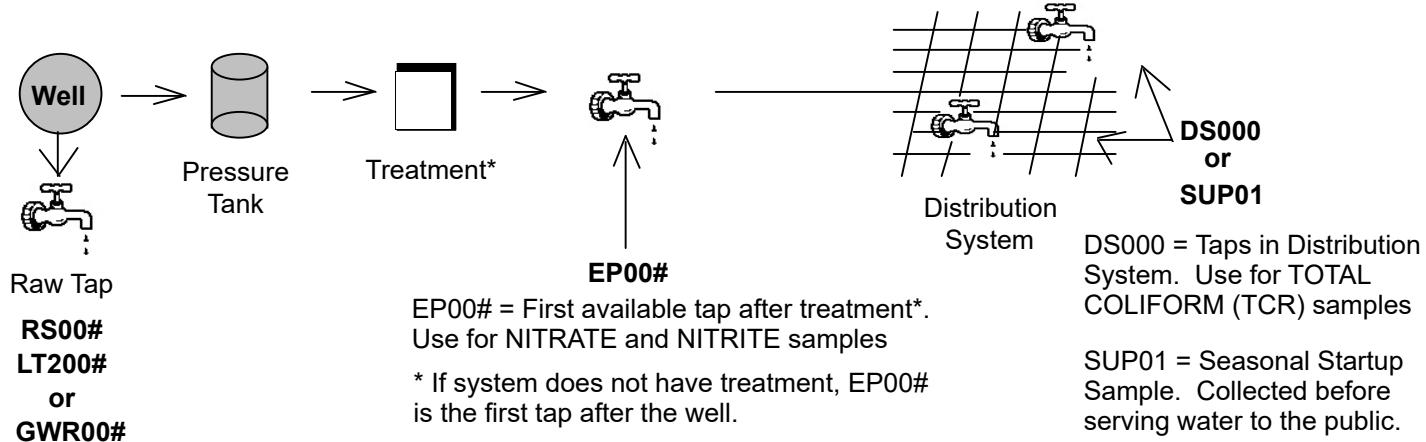

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633312 LONGS RETREAT WELL 11

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT WELL 11 DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

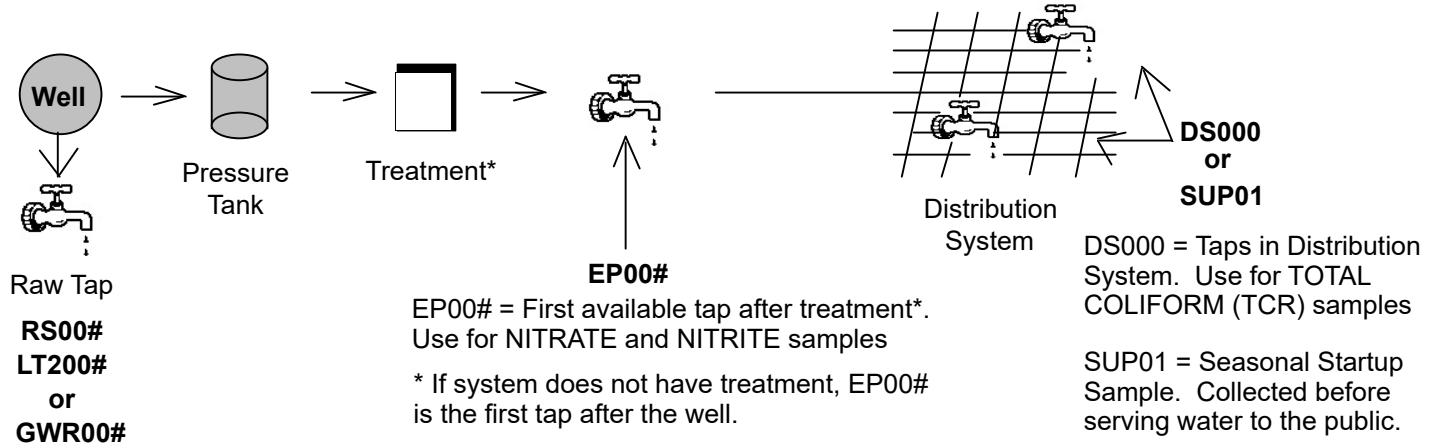

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633312 LONGS RETREAT WELL 11

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6657273 Facility Name: **LONGS RETREAT WELL 11 -NT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

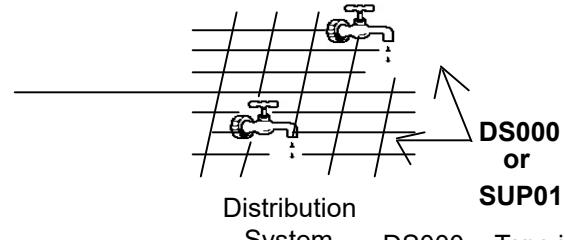

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633612 LONGS RETREAT WELL 18

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT WELL 18 DISTRIBUTION
Location	SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	---

**** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative. ****

Where to Collect Samples For a Small Public Water System

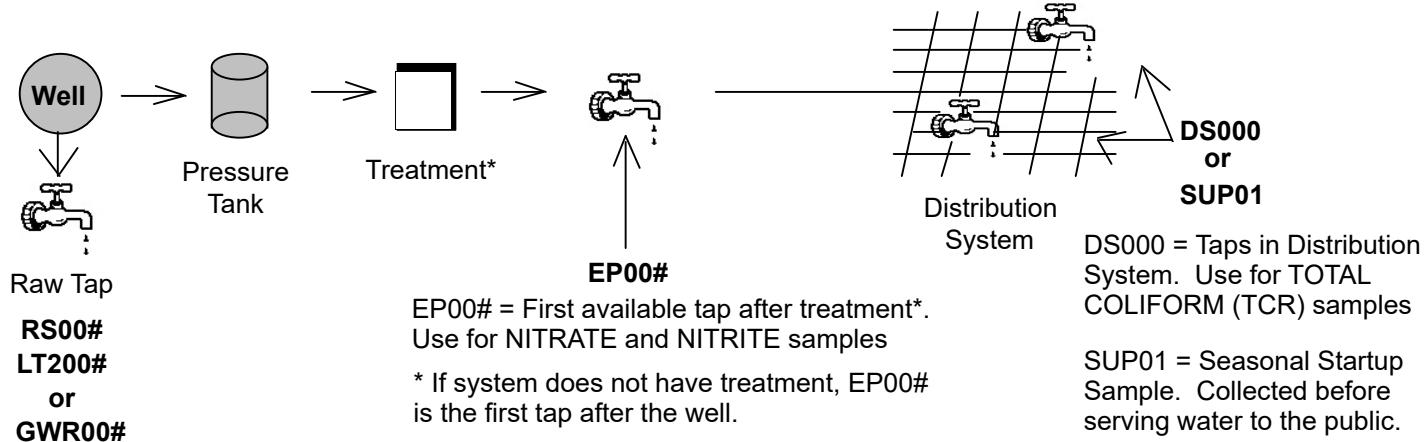

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633612 LONGS RETREAT WELL 18

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT WELL 18 DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

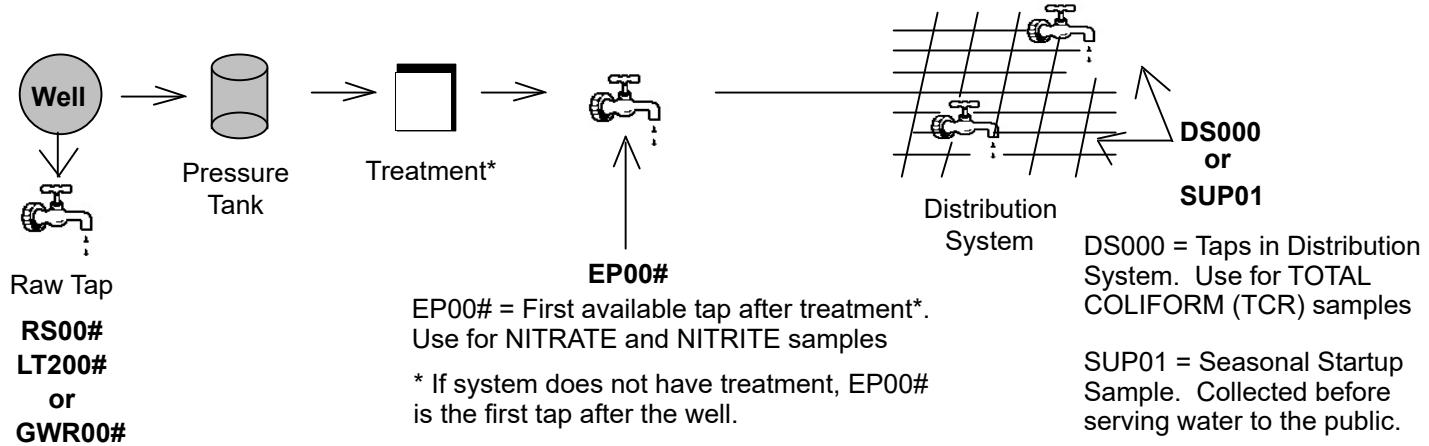

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633612 LONGS RETREAT WELL 18

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6657274 Facility Name: **LONGS RETREAT WELL 18 -NT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

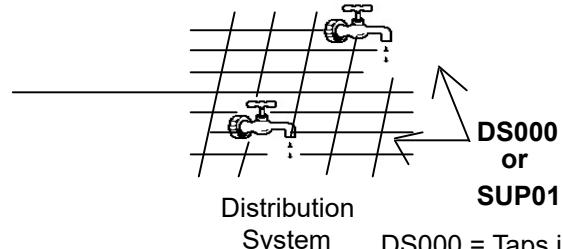

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633712 LONGS RETREAT WELL 16

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1 Facility Name: **LONGS RETREAT WELL 16 DISTRIBUTION**
Location SMP ID: SUP01 Facility Source: **Ground Water**

Chemicals **Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

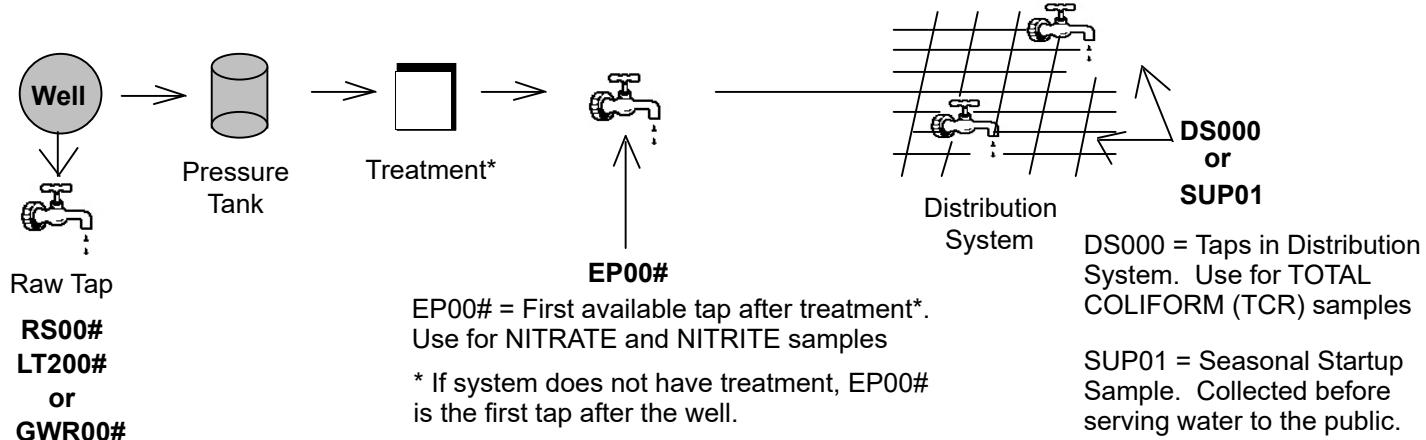

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633712 LONGS RETREAT WELL 16

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: LONGS RETREAT WELL 16 DISTRIBUTION
Location	SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2026 and 4/30/2026
	1 Sample(s) Required between 5/1/2026 and 5/31/2026
	1 Sample(s) Required between 6/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 7/31/2026
	1 Sample(s) Required between 8/1/2026 and 8/31/2026
	1 Sample(s) Required between 9/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System

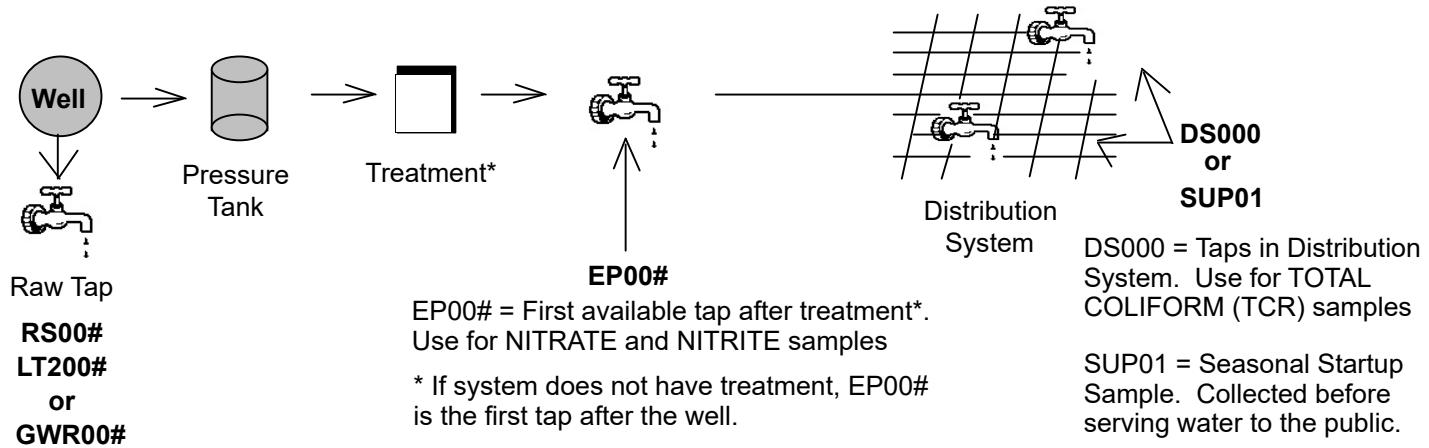

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633712 LONGS RETREAT WELL 16

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6660714 Facility Name: **LONGS RETREAT WELL 16-NT**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026


Where to Collect Samples For a Small Public Water System



Raw Tap
RS00#
LT200#
or
GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

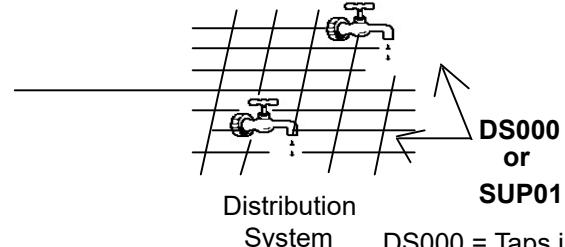

Distribution System

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633812 ROCKWATER CAMPGROUND PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: ROCKWATER CAMPGROUND DISTRIBUTION
Location	SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2026 and 3/31/2026
	1 Sample(s) Required between 4/1/2026 and 6/30/2026
	1 Sample(s) Required between 7/1/2026 and 9/30/2026
	1 Sample(s) Required between 10/1/2026 and 12/31/2026

Where to Collect Samples For a Small Public Water System

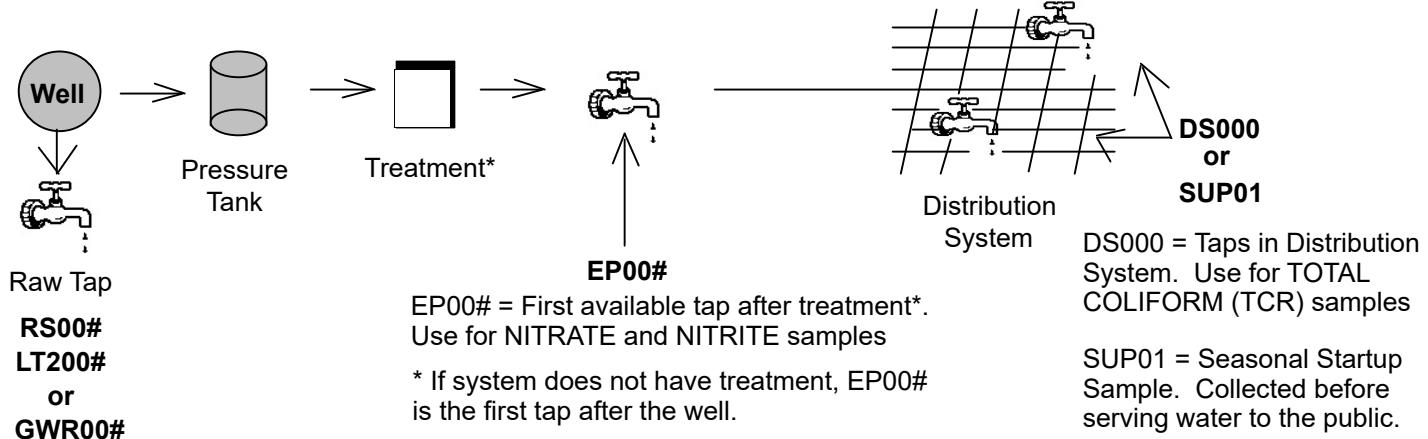

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!



OH6633812 ROCKWATER CAMPGROUND PWS

System Type: Transient Noncommunity Source: Ground Water

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6662447 Facility Name: **ROCKWATER CAMPGROUND**

Location SMP ID: EP001 Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2026 and 10/31/2026

Where to Collect Samples For a Small Public Water System



Raw Tap

RS00#


LT200#

or

GWR00#

EP00# = First available tap after treatment*. Use for NITRATE and NITRITE samples

* If system does not have treatment, EP00# is the first tap after the well.

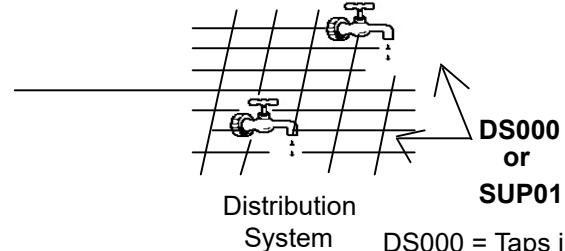

Distribution System

DS000
or
SUP01

DS000 = Taps in Distribution System. Use for TOTAL COLIFORM (TCR) samples

SUP01 = Seasonal Startup Sample. Collected before serving water to the public.

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<https://epa.ohio.gov/static/Portals/28/documents/pws/DWSample.pdf>

Save a dime. Sample on time!